DATE 8/28/2015 **REVISED DATE**

SHEET

E5.5

MOUNT 12" ABOVE SHELF UVING AREA MOUNT ABOVE DOOR-

B1 SCALE: 1/4"=1'-0" SEE MECH PLANS

MOUNT 6" A.F.F. TYP:

MOUNT 6" A.F.F. TYP:— Q_{(F)CF} LIVING ROOM SD

(F)CF Q2


LIVING/BEDROO

SD


A19


SCALE: 1/4"=1'-0"


B3 SCALE: 1/4"=1'-0"

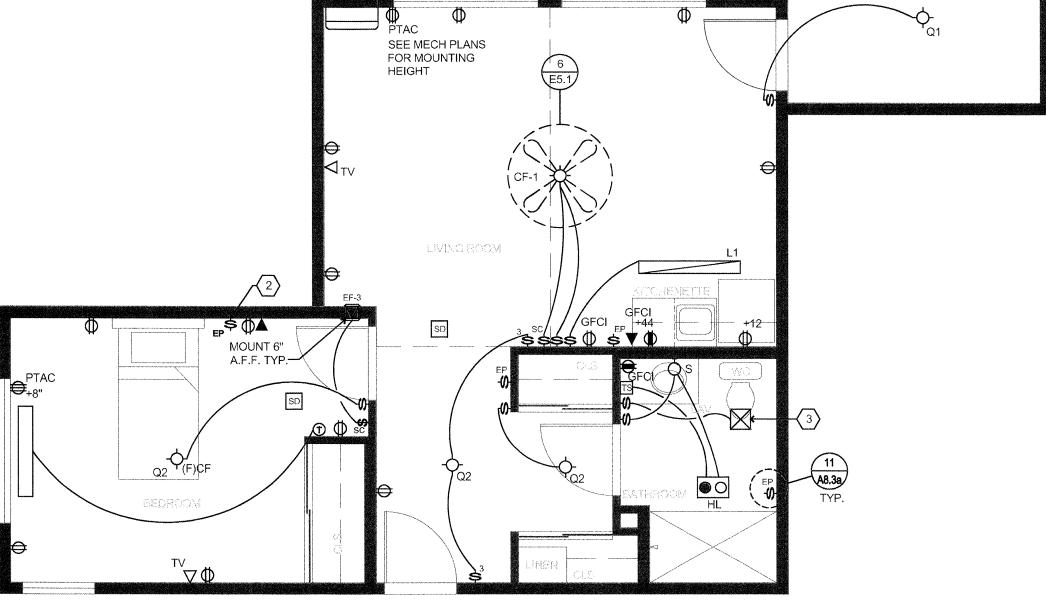

B4 SCALE: 1/4"=1'-0"

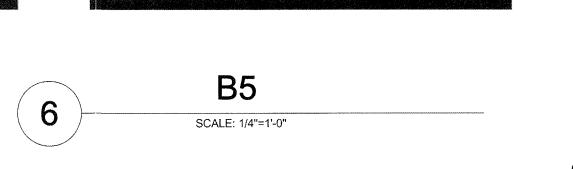

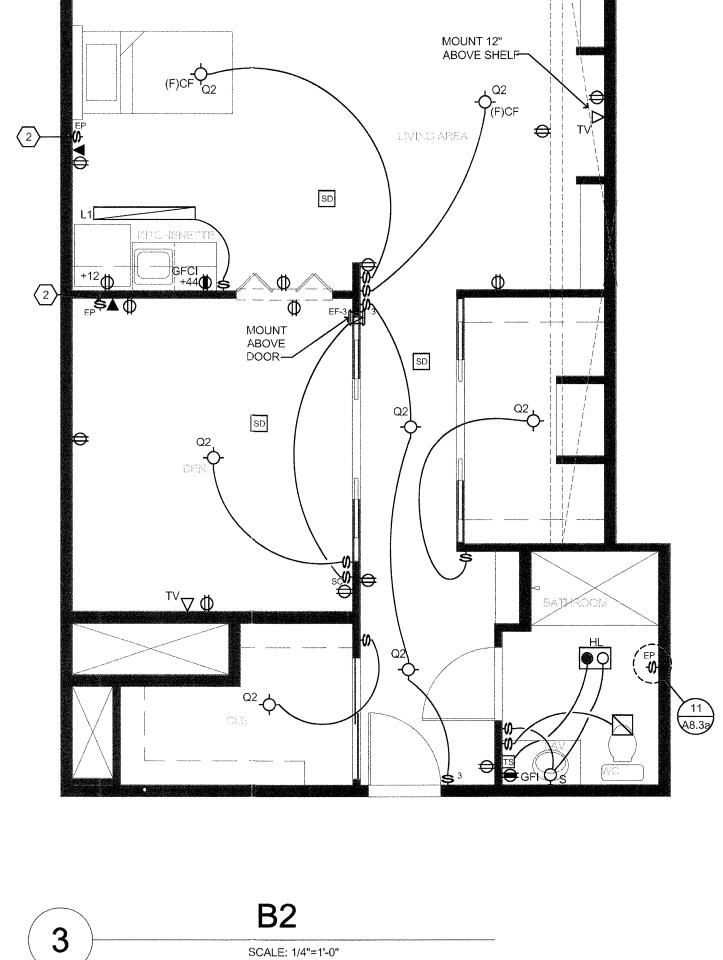

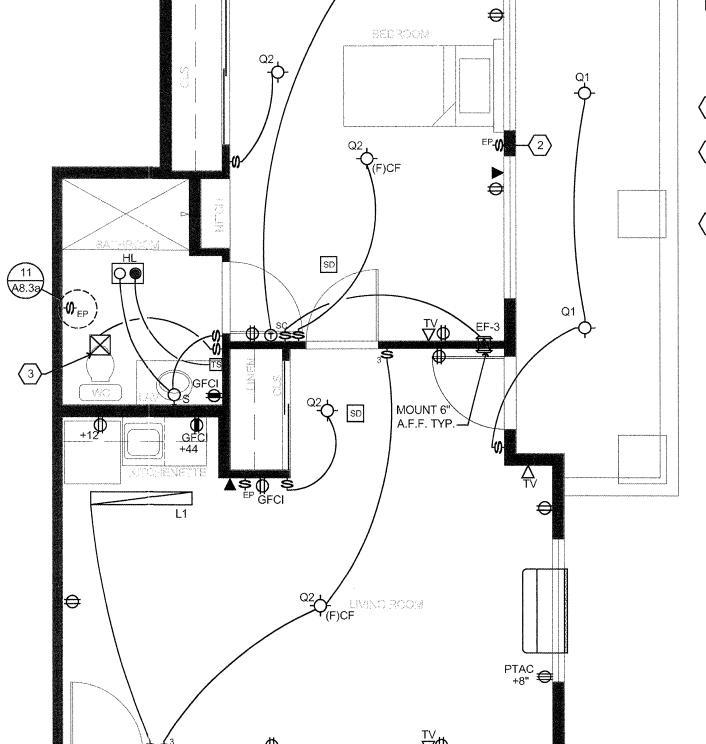

4. REFER TO ELECTRICAL DETAILS ON SHEET E2.2b. 5. INSTALL G.F.C.I. RECEPTACLE IN UNIT BATHROOMS AND AT BAR. RECEPTACLES WITHIN 6' OF SINK EDGE SHALL BE G.F.C.I PROTECTED.

GENERAL NOTES:

SPECIFICATIONS ON SHEET E2.1.

6. FOR SUITE CIRCUITING SEE POWER SHEETS AND E2.3

7. PHONE JACKS IN OFFICE/MARKETING, MANAGER, CO-MANAGER SHALL BE DUPLEX. SEE SECTION 1.4, DWG. E4.1. EACH JACK SHOULD HOME RUN TO PHONE

8. INSTALL PTAC RECEPTACLE ON RIGHT SIDE OF UNIT, WITH IN 12" OF SLEEVE. 9. INTERCONNECT SUITE SMOKE DETECTORS, CIRCUIT SUITE SMOKE DETECTORS TO SUITE LIGHTING

10. SEE ELECTRICAL POWER SHEETS FOR BASEBOARD

SIZING. 11. PROVIDE BLOCKING AND LISTED OUTLET BOX FOR THE INSTALLATION OF A FUTURE CEILING FAN AT THE LIGHTING LOCATIONS INDICATED WITH A "(F)CF" DESIGNATION.

ELECTRICAL LEGEND

\$3 THREE WAY SWITCH ♦ OC AUTOMATIC WALL SWITCH

\$ EP WIRELESS EMERGENCY PULL SWITCH. COORDINATE LOCATION WITH TEL-TRON DRAWINGS. SC FAN SPEED CONTROL SWITCH

RECEPTACLE 208 VOLT RECEPTACLE ARC-FAULT BREAKER CIRCUIT (AFCI). SPLIT RECEPTACLE C/W 2 CCTS. RECEPTACLE AT COUNTER

TV TELEPHONE THERMOSTAT

> SPECIAL CONNECTION CEILING FAN (CF-1) WITH LISTED BOX. SEE E2.1 LIGHTING SCHEDULE.

SD INTERCONNECTED 120V COMBINATION SMOKE DETECTOR AND CARBON MONOXIDE ALARM INTERCONNECTED 120V COMBINATION SMOKE DETECTOR AND CARBON MONOXIDE ALARM

WITH STROBE "E" INDICATES WIRING TO EMERGENCY POWER. SEE MECH. EF-3 ROOM TO ROOM FAN

PTAC UNIT

(H) HEAT/ (L) LIGHT UNIT (SEE DETAIL 6/E2.2b, 7/A8.8 FOR FIXTURE PROTECTION)

⊢O -Ò- LIGHT FIXTURES. SEE LIGHTING SCHEUDLE ON E2.1 LIGHT FIXTURE WITH LISTED BOX FOR FUTURE CEILING FAN. SEE GENERAL NOTE 11.

"EF-5" BY MECH (SEE M4.2) TIMER SWITCH (15 MIN. TURN-TYPE TIMER)

DATA PORT

HEATER GFCI / GFI GROUND FAULT CIRCUIT INTERRUPTER FLUORESCENT UNDER CABINET LIGHT.

KEYED NOTES

REPLACE TYPE "Q2" FIXTURE WITH TYPE "CF1" CEILING FA ON UPPER FLOOR VAULTED UNITS. SEE LIGHTING PLANS FOR LOCATION OF VAULTED UNITS. (SEE DETAIL 6,7/E5.1) PROVIDE JUNCTION BOX AT 48" A.F.F. FOR EMERGENCY PULL SWITCH AND (1) FPLR-SHEILDED 18-4 CABLE FROM BEDROOM SMOKE DETECTOR. RELAY TO J-BOX AT THIS LOCATION ONLY. ADDITIONAL LOCATIONS WILL BE SURFACE MOUNT.

COORDINATE WITH MECHANICAL IF SUITE BATHROOM EXHAUST FAN WILL BE PROVIDED. IF NO FAN IS PROVIDED ELIMINATE SWITCH AND ELECTRICAL CONNECTION TO FAI

SUITE PLANS