




SCALE: 1/4"=1'-0"

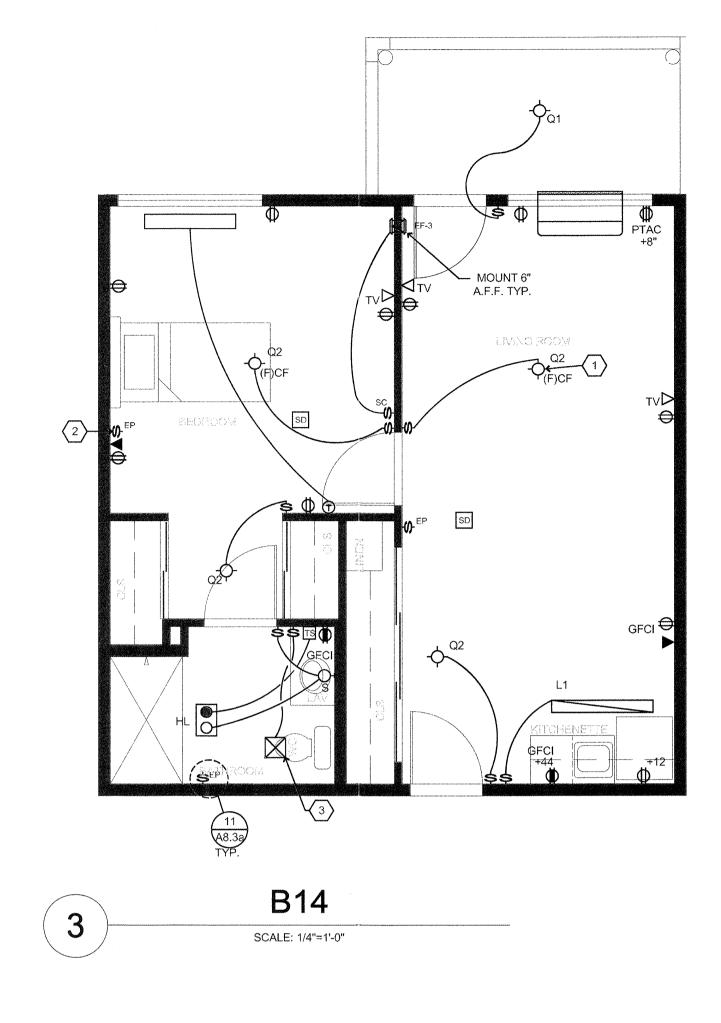

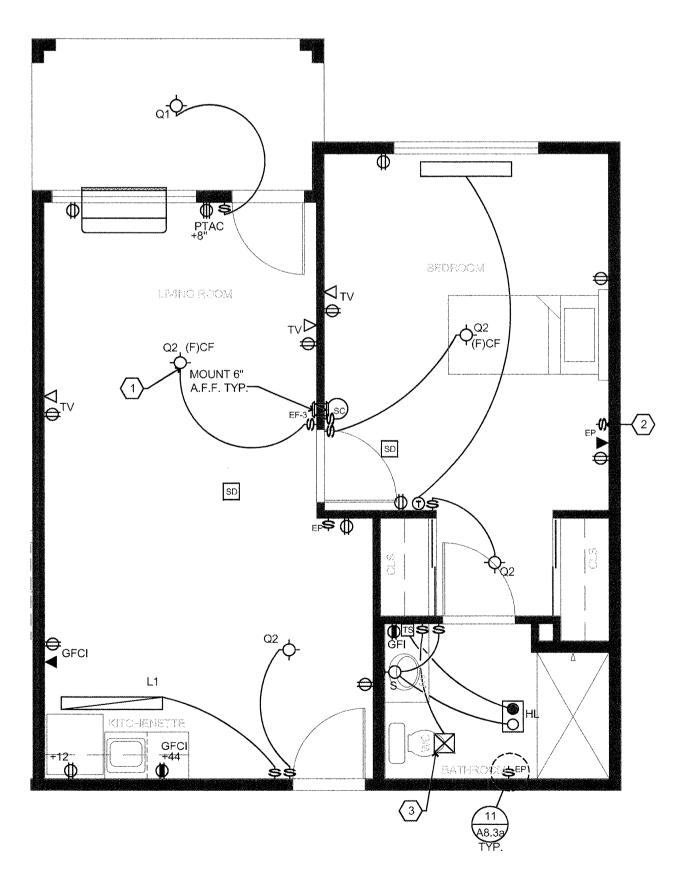


B15

SCALE: 1/4"=1'-0"

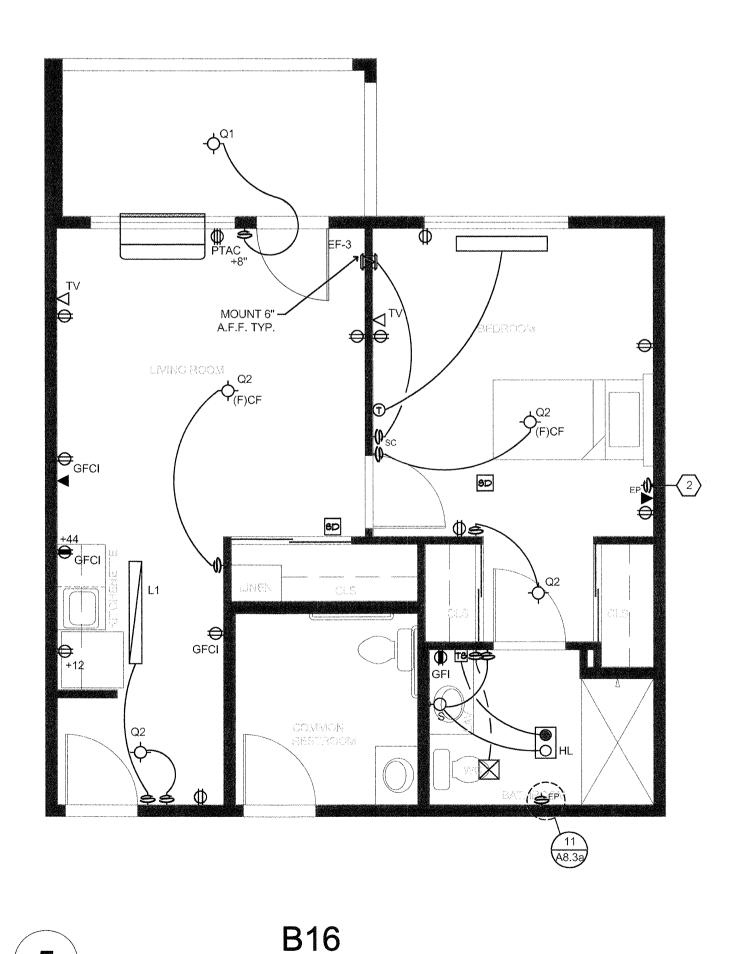

SCALE: 1/4"=1'-0"

5

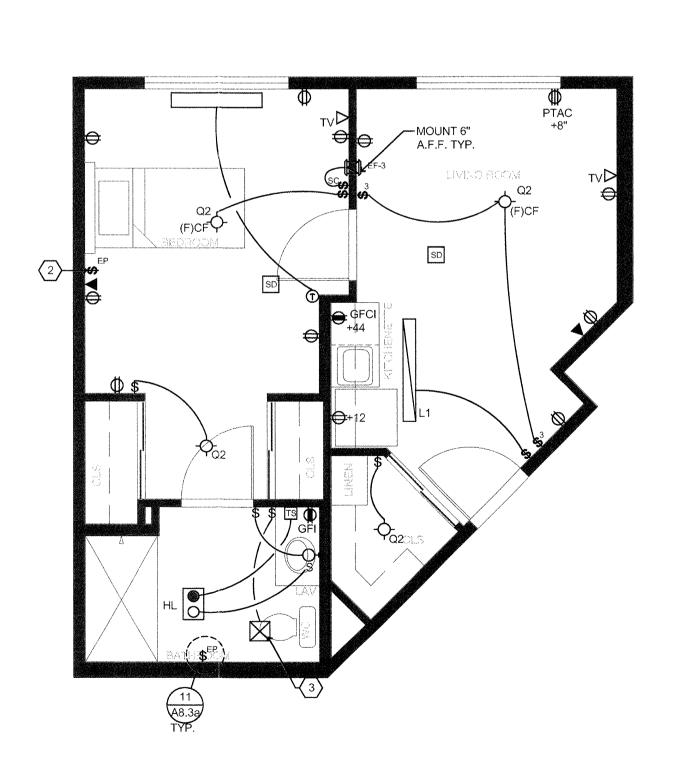

B17

SCALE: 1/4"=1'-0"

GENERAL NOTES:

- 1. REFER TO 2/A8.3a FOR TYPICAL SUITE BATH LAYOUT
- FRAME AND WIRE FOR FUTURE PTAC RECEPTACLE ON RIGHT SIDE OF BASEBOARD LOCATION. TO REPLACE BASEBOARD IN "C" UNIT SPARE BEDROOMS.
- 3. REFER TO ELECTRICAL SCHEDULE NOTES / SPECIFICATIONS ON SHEET E2.1.
- 4. REFER TO ELECTRICAL DETAILS ON SHEET E2.2b. 5. INSTALL G.F.C.I. RECEPTACLE IN UNIT BATHROOMS AND AT BAR. RECEPTACLES WITHIN 6' OF SINK EDGE SHALL BE G.F.C.I PROTECTED.
- 6. FOR SUITE CIRCUITING SEE POWER SHEETS AND E2.3 SHEETS.
- PHONE JACKS IN OFFICE/MARKETING, MANAGER, CO-MANAGER SHALL BE DUPLEX. SEE SECTION 1.4, DWG. E4.1. EACH JACK SHOULD HOME RUN TO PHONE
- 8. INSTALL PTAC RECEPTACLE ON RIGHT SIDE OF UNIT, WITH IN 12" OF SLEEVE.
- 9. INTERCONNECT SUITE SMOKE DETECTORS. CIRCUIT SUITE SMOKE DETECTORS TO SUITE LIGHTING
- CIRCUIT. 10. SEE ELECTRICAL POWER SHEETS FOR BASEBOARD
- 11. PROVIDE BLOCKING AND LISTED OUTLET BOX FOR THE INSTALLATION OF A FUTURE CEILING FAN AT THE LIGHTING LOCATIONS INDICATED WITH A "(F)CF" DESIGNATION.

ELECTRICAL LEGEND

- \$3 THREE WAY SWITCH
- **\$**OC AUTOMATIC WALL SWITCH \$ EP WIRELESS EMERGENCY PULL SWITCH.
- COORDINATE LOCATION WITH TEL-TRON DRAWINGS.
- SC FAN SPEED CONTROL SWITCH RECEPTACLE
- 208 VOLT RECEPTACLE
- ARC FAULT BREAKER CIRCUIT (AFCI). SPLIT RECEPTACLE C/W 2 CCTS.
- RECEPTACLE AT COUNTER
- TELEPHONE

TV

- THERMOSTAT
- SPECIAL CONNECTION
- CEILING FAN (CF-1) WITH LISTED BOX. SEE E2.1 LIGHTING SCHEDULE.
- INTERCONNECTED 120V COMBINATION SMOKE DETECTOR AND CARBON MONOXIDE ALARM
- INTERCONNECTED 120V COMBINATION SMOKE DETECTOR AND CARBON MONOXIDE ALARM WITH STROBE
- "E" INDICATES WIRING TO EMERGENCY POWER.
- SEE MECH. EF-3 ROOM TO ROOM FAN

PTAC UNIT

(H) HEAT/ (L) LIGHT UNIT (SEE DETAIL 6/E2.2b, 7/A8.8 FOR FIXTURE PROTECTION)

⊢O - LIGHT FIXTURES. SEE LIGHTING SCHEUDLE ON -O_{(F)CF} LIGHT FIXTURE WITH LISTED BOX FOR FUTURE CEILING FAN. SEE GENERAL NOTE 11.

"EF-5" BY MECH (SEE M4.2)

TS TIMER SWITCH (15 MIN. TURN-TYPE TIMER)

D

DATA PORT HEATER

GFCI / GFI GROUND FAULT CIRCUIT INTERRUPTER

FLUORESCENT UNDER CABINET LIGHT.

KEYED NOTES

- REPLACE TYPE "Q2" FIXTURE WITH TYPE "CF1" CEILING FA ON UPPER FLOOR VAULTED UNITS. SEE LIGHTING PLANS FOR LOCATION OF VAULTED UNITS. (SEE DETAIL 6,7/E5.1)
- PROVIDE JUNCTION BOX AT 48" A.F.F. FOR EMERGENCY
 PULL SWITCH AND (1) FPLR-SHEILDED 18-4 CABLE FROM
 BEDROOM SMOKE DETECTOR. RELAY TO J-BOX AT THIS
 LOCATION ONLY. ADDITIONAL LOCATIONS WILL BE
 SURFACE MOUNT.
- COORDINATE WITH MECHANICAL IF SUITE BATHROOM EXHAUST FAN WILL BE PROVIDED. IF NO FAN IS PROVIDED ELIMINATE SWITCH AND ELECTRICAL CONNECTION TO FAI

JD:SIDENCE

DATE

8/28/2015 **REVISED DATE**

SHEET E5.7

SUITE PLANS