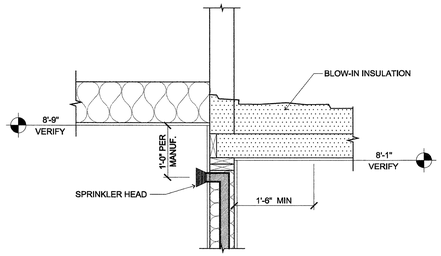

6 FIRE SPRINKLER FREEZE PROTECTION
(AT INTERIOR CEILING LOCATION)
SCALE: 3/4" = 1'-0"

T:/15MECH/280PINSL/15260006

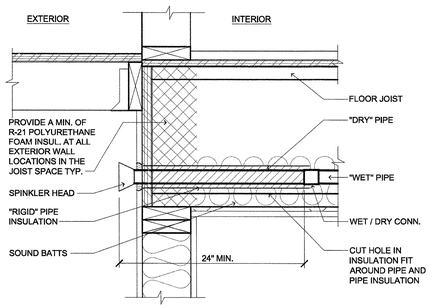

5 FIRE SPRINKLER FREEZE PROTECTION
(AT EXTERIOR WALL LOCATIONS)
SCALE: 1-1/2" = 1'-0"

T:/15MECH/280PINSL/15260005

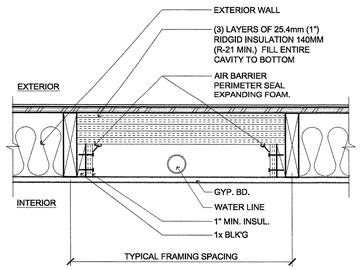

4 INSTALLATION DETAIL
(FREEZE PROTECTION)
SCALE: 1-1/2"=1'-0"

T:/15MECH/280PINSL/15260002

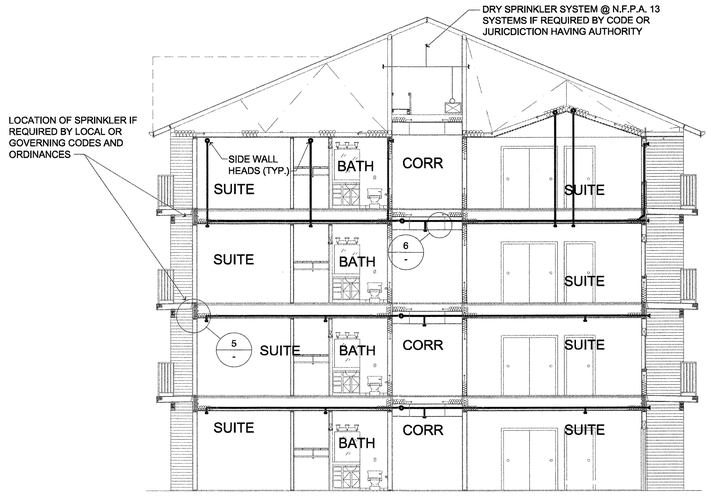

2 SECTION THRU WING
M5.2 SCALE: 1/8" = 1'-0"

NOTE: ALL PIPING SHOWN IN SECTIONS AND DETAILS ARE SCHEMATIC ONLY AND MUST MEET REQ. OF NFPA13 AND 13R OR AS REQ. BY AUTHORITY HAVING JURISDICTION.

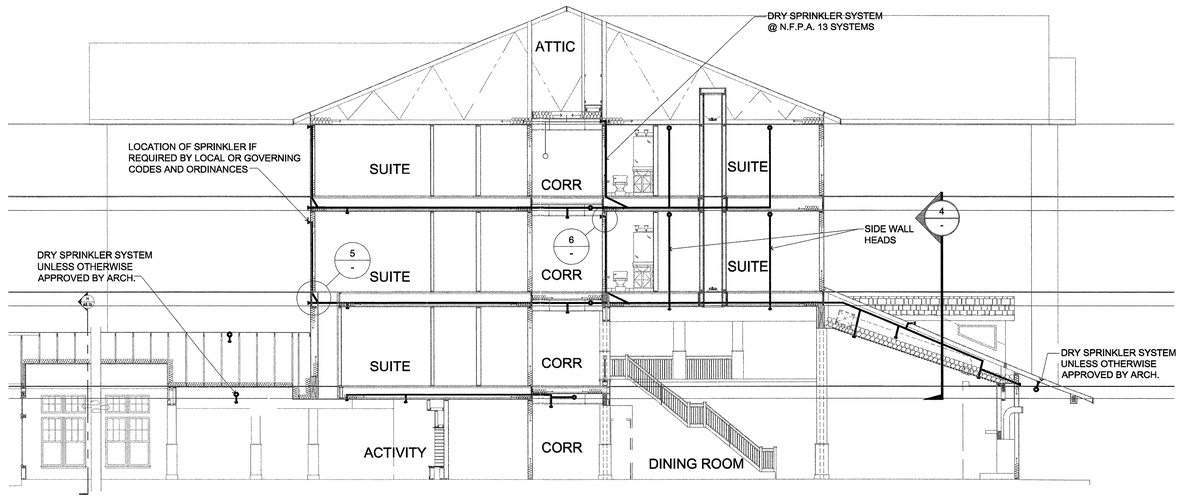

1 SECTION THRU DINING
M5.2 SCALE: 1/8" = 1'-0"

lenity architecture
2356 Mission Street SE, Salem, Oregon 97301
p 503 399 1090 m 503 399 0665 w lenityarchitecture.com

COLSON AND COLSON
GENERAL CONTRACTOR, INC.
2260 McGILCHRIST STREET SE. SUITE 200
SALEM, OREGON, 97302
PHONE (503) 586-7401

PORTLAND
RETIREMENT RESIDENCE
802 OCEAN AVE. PORTLAND, MAINE 04103

SPRINKLER PIPING SECTION/DETAIL

©2015 Lenity Architecture

DATE
8/28/2015

REVISED DATE
9/22/2015

SHEET
M5.2

save: 11/1/2015 8:47 PM by bobs plot: 11/5/2015 8:47 PM by bobs file: p:\acrx\new-docs\drawings_2 rev\sht rev's acr-$ sht.dwg M5.2