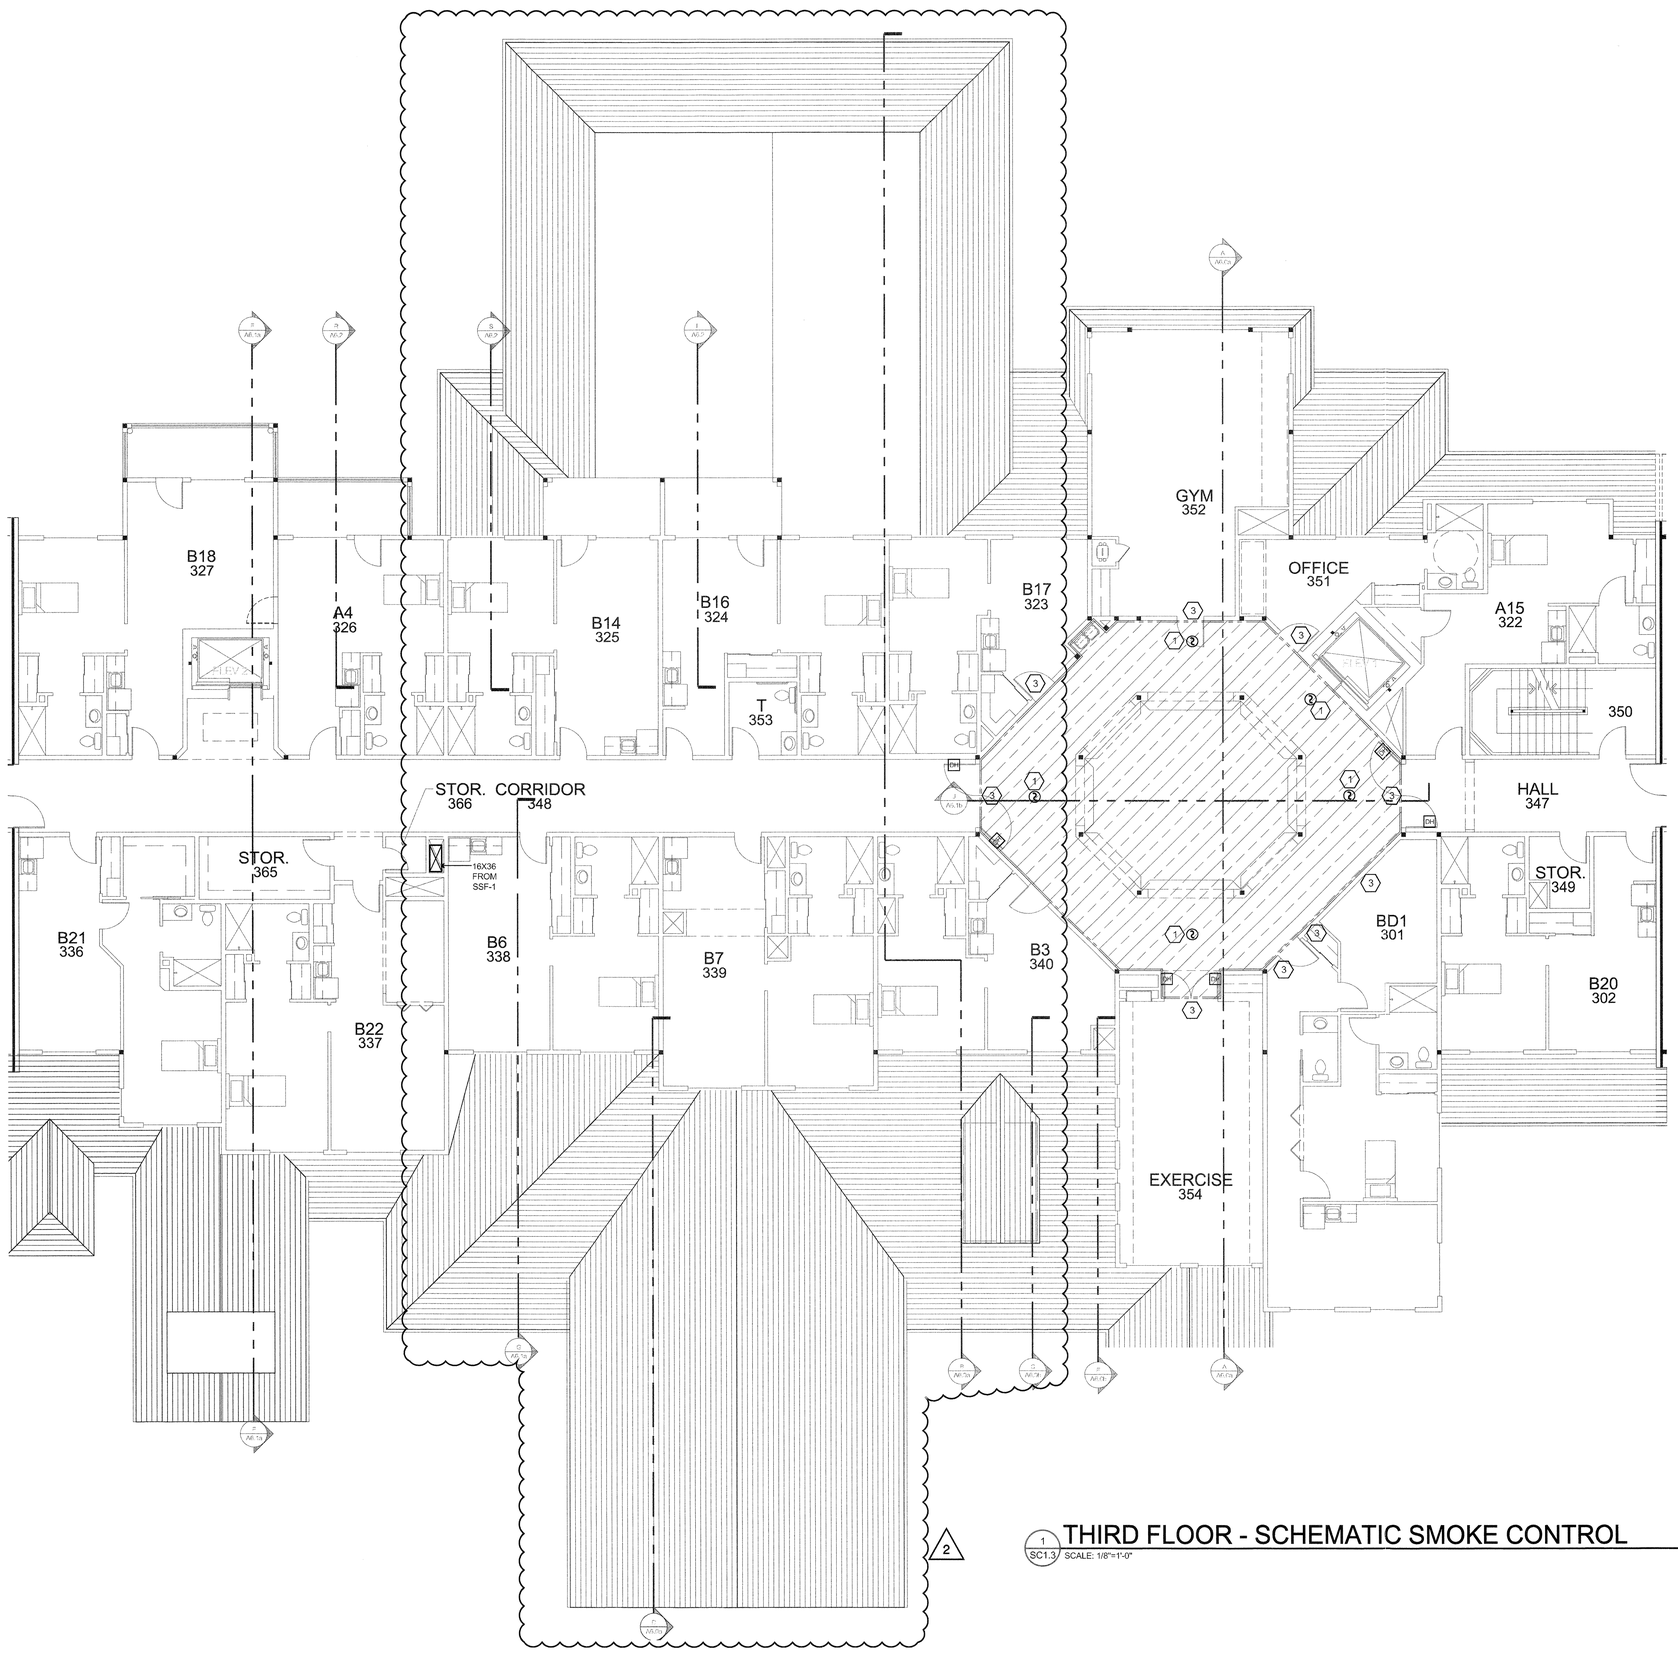

1 SC1.3 THIRD FLOOR - SCHEMATIC SMOKE CONTROL
SCALE: 1/8"=1'-0"

LEGEND

- R — ADDRESSABLE RELAY MODULE
- ASCP — ANALOG/ADDRESSABLE ATRIUM SMOKE CONTROL PANEL W/WHITE DOOR.
- 2 — ADDRESSABLE PHOTOELECTRIC SMOKE DETECTOR
- FAA — REMOTE ANNUNCIATOR
- DH — MAGNETIC DOOR HOLDER
- ATRIUM AREA

KEY NOTES:

1. SMOKE DETECTOR TO ANNUNCIATE FACP ALARM, AND ACTIVATE ATRIUM SMOKE CONTROL SYSTEM.
2. RELAY TO CONTROL POWER ASSISTED ATRIUM SMOKE DOORS. SEE DOOR SCHEDULE AND DETAIL #7/SC2.1.
3. DOOR EQUIPPED WITH CLOSER AND SMOKE SEAL.

NOTES:

SEE DETAIL 11/E2.2b AND 14/E2.2b FOR ALLOWABLE BORING/NOTCHING OF MEMBERS.

SHOWN ONLY AS SCHEMATIC.

STATE OF MAINE
Robert J Hazleton
10577
REGISTERED
PROFESSIONAL ENGINEER
2.3.16

lenity
architecture
3150 Liberty Street SE, Salem, Oregon 97301
p 503 399 1090 f 503 399 0663 w lenityarchitecture.com

COLSON AND COLSON
GENERAL CONTRACTOR, INC.
2260 McGILCHRIST STREET SE, SUITE 200
SALEM, OREGON, 97302
PHONE (503) 586-7401

PORTLAND
RETIREMENT RESIDENCE
802 OCEAN AVE. PORTLAND, MAINE 04103

3RD FLR CORE SCHEMATIC SMOKE CONTROL

©2015 Lenity Architecture

DATE
8/28/2015

REVISED DATE
1 9/22/2015

SHEET
SC1.3