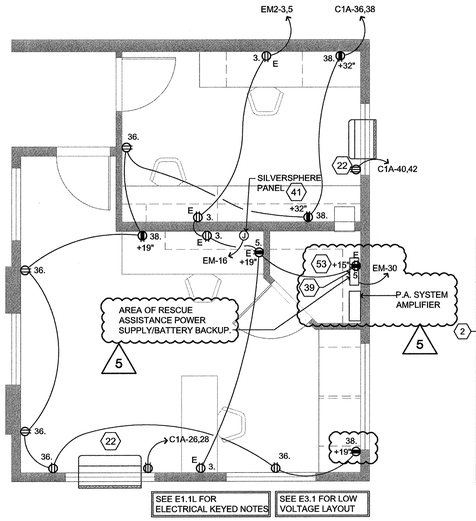

1 OFFICE / MARKETING

SCALE: 1/4"=1'-0"

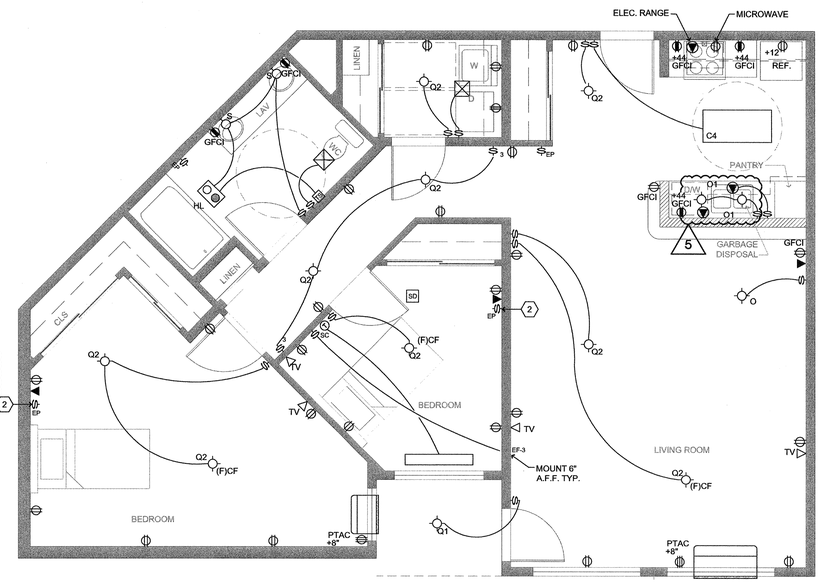

2 MANAGER

SCALE: 1/4"=1'-0"

PROVIDE COMBINATION TYPE ARC-FAULT CIRCUIT INTERRUPTER FOR EACH CIRCUIT FEEDING THE MANAGER AND CO-MANAGER UNITS. WITH THE EXCEPTION OF THE LAUNDRY, BATHROOM AND KITCHEN CIRCUITS.

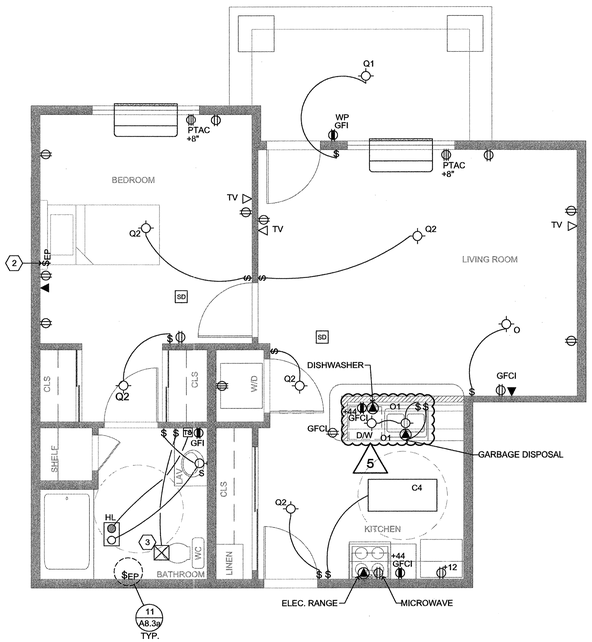

3 CO-MANAGER

SCALE: 1/4"=1'-0"

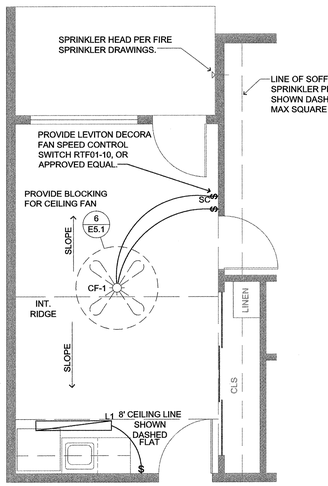

7 TYPICAL B-UNIT (WITH CEILING VAULT)

SCALE: 1/4"=1'-0"

T:/09FINISH/250GYPBD/09250637

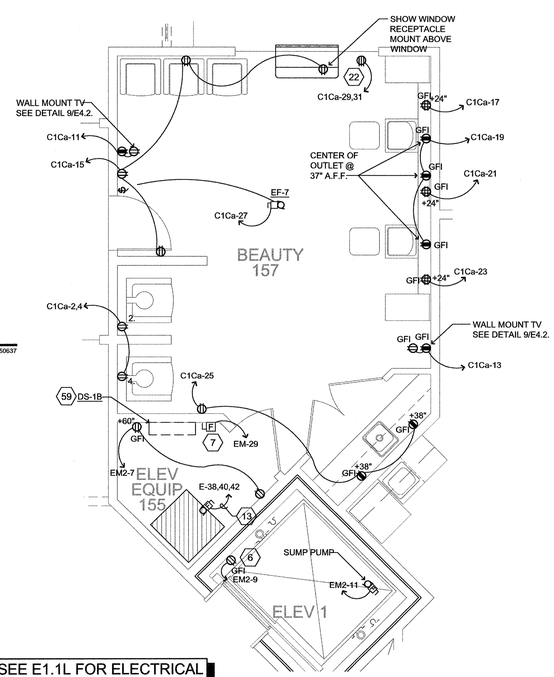

SEE E1.1L FOR ELECTRICAL KEYED NOTES.

5 ENLARGED BEAUTY/ELEVATOR POWER PLAN

SCALE: 1/4" = 1'-0"

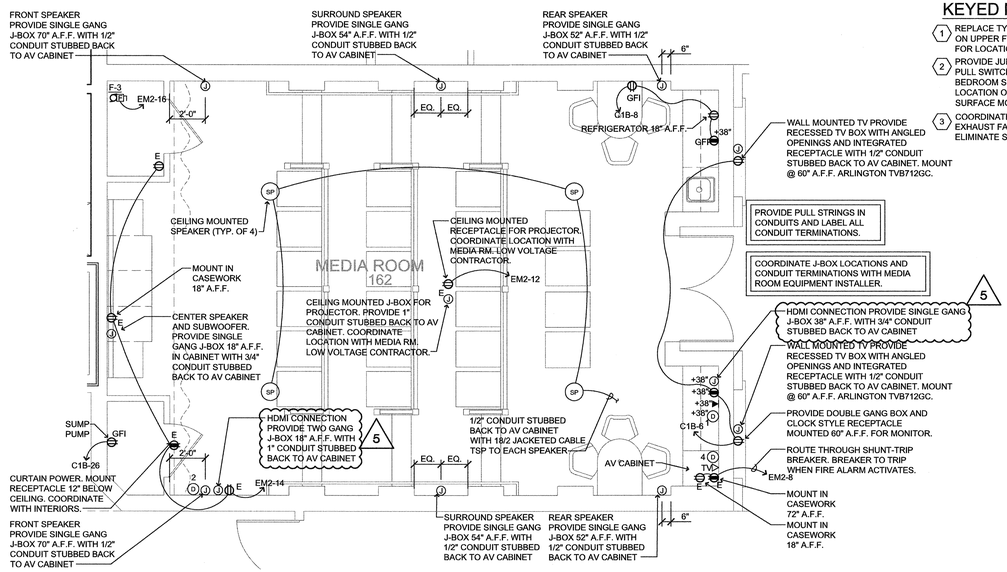

4 ENLARGED THEATER POWER AND LOW VOLTAGE PLAN

SCALE: 1/4" = 1'-0"

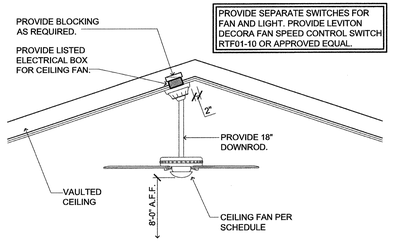

6 CEILING FAN INSTALLATION SLOPED CEILINGS

SCALE: 1/2" = 1'-0"

T:/16ELECT/510INTLT/16510019

GENERAL NOTES:

1. REFER TO 2/A8.3a FOR TYPICAL SUITE BATH LAYOUT.
2. FRAME AND WIRE FOR FUTURE PTAC RECEPTACLE ON RIGHT SIDE OF BASEBOARD LOCATION. TO REPLACE BASEBOARD IN "C" UNIT SPARE BEDROOMS.
3. REFER TO ELECTRICAL SCHEDULE NOTES / SPECIFICATIONS ON SHEET E2.1.
4. REFER TO ELECTRICAL DETAILS ON SHEET E2.2b.
5. INSTALL G.F.C.I. RECEPTACLE IN UNIT BATHROOMS AND AT BAR. RECEPTACLES WITHIN 6' OF SINK EDGE SHALL BE G.F.C.I PROTECTED.
6. FOR SUITE CIRCUITING SEE POWER SHEETS AND E2.3 SHEETS.
7. PHONE JACKS IN OFFICE/MARKETING, MANAGER, CO-MANAGER SHALL BE DUPLEX. SEE SECTION 1.4, DWG. E4.1. EACH JACK SHOULD HOME RUN TO PHONE BOARD.
8. INSTALL PTAC RECEPTACLE ON RIGHT SIDE OF UNIT, WITH IN 12" OF SLEEVE.
9. INTERCONNECT SUITE SMOKE DETECTORS. CIRCUIT SUITE SMOKE DETECTORS TO SUITE LIGHTING CIRCUIT.
10. SEE ELECTRICAL POWER SHEETS FOR BASEBOARD SIZING.
11. PROVIDE BLOCKING AND LISTED OUTLET BOX FOR THE INSTALLATION OF A FUTURE CEILING FAN AT THE LIGHTING LOCATIONS INDICATED WITH A "(F)CF" DESIGNATION.

ELECTRICAL LEGEND

S	SWITCH
S3	THREE WAY SWITCH
SOC	AUTOMATIC WALL SWITCH
SEP	WIRELESS EMERGENCY PULL SWITCH. COORDINATE LOCATION WITH TEL-TRON DRAWINGS.
SSC	FAN SPEED CONTROL SWITCH
	RECEPTACLE
	208 VOLT RECEPTACLE
ARC	ARC-FAULT BREAKER CIRCUIT (AFCI).
	SPLIT RECEPTACLE C/W 2 CCTS.
	RECEPTACLE AT COUNTER
	TV
	TELEPHONE
T	THERMOSTAT
	SPECIAL CONNECTION
	CEILING FAN (CF-1) WITH LISTED BOX. SEE E2.1 LIGHTING SCHEDULE.
SD	INTERCONNECTED 120V COMBINATION SMOKE DETECTOR AND CARBON MONOXIDE ALARM. GENTEX GN-503.
SDS	INTERCONNECTED 120V SMOKE DETECTOR WITH STROBE. GENTEX T139 CSC.
CO	INTERCONNECTED 120V CARBON MONOXIDE ALARM. GENTEX CO1209.
E E	"E" INDICATES WIRING TO EMERGENCY POWER.
	SEE MECH. EF-3 ROOM TO ROOM FAN
	PTAC UNIT
L H	(H) HEAT/ (L) LIGHT UNIT (SEE DETAIL 6/E2.2b, 7/A8.8 FOR FIXTURE PROTECTION)
(F)CF	LIGHT FIXTURES. SEE LIGHTING SCHEUDLE ON E2.1 LIGHT FIXTURE WITH LISTED BOX FOR FUTURE CEILING FAN. SEE GENERAL NOTE 11.
	"EF-5" BY MECH (SEE M4.2)
TS	TIMER SWITCH (15 MIN. TURN-TYPE TIMER)
D	DATA PORT
	HEATER
GFCI / GFI	GROUND FAULT CIRCUIT INTERRUPTER
	FLUORESCENT UNDER CABINET LIGHT.

KEYED NOTES

1. REPLACE TYPE "Q2" FIXTURE WITH TYPE "CF1" CEILING FAN ON UPPER FLOOR VAULTED UNITS. SEE LIGHTING PLANS FOR LOCATION OF VAULTED UNITS. (SEE DETAIL 6,7/E5.1)
2. PROVIDE JUNCTION BOX AT 48" A.F.F. FOR EMERGENCY PULL SWITCH AND (1) FPLR-SHIELDED 18-4 CABLE FROM BEDROOM SMOKE DETECTOR. RELAY TO J-BOX AT THIS LOCATION ONLY. ADDITIONAL LOCATIONS WILL BE SURFACE MOUNT.
3. COORDINATE WITH MECHANICAL IF SUITE BATHROOM EXHAUST FAN WILL BE PROVIDED. IF NO FAN IS PROVIDED, ELIMINATE SWITCH AND ELECTRICAL CONNECTION TO FAN.

STATE OF MAINE — REGISTERED PROFESSIONAL ENGINEER — Robert J Hazleton — 10527 — ELECTRICAL
9.2.16

lenity architecture
3150 Kettle Court SE, Salem, Oregon 97301
p 503 399 1090 f 503 399 0565 w lenityarchitecture.com

COLSON AND COLSON GENERAL CONTRACTOR, INC.
2260 McGILCHRIST STREET SE, SUITE 200
SALEM, OREGON, 97302
PHONE (503) 586-7401

PORTLAND RETIREMENT RESIDENCE
802 OCEAN AVE. PORTLAND, MAINE 04103

ELECTRICAL SUITE PLANS

©2015 Lenity Architecture

DATE 8/28/2015

REVISED DATE
1 9/22/2015
2 2/2/2016
5 7/18/2016

SHEET E5.1

save:9/28/2015 2:11 PM jasond plot:8/25/2016 2:11 PM jasond file:q:\townhomes-portland\arch\e5.1 suite plans.dwg E5.1