



BEDROOM

Q2 LIVING ROOM (F)CF

PTAC

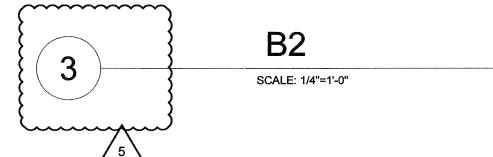

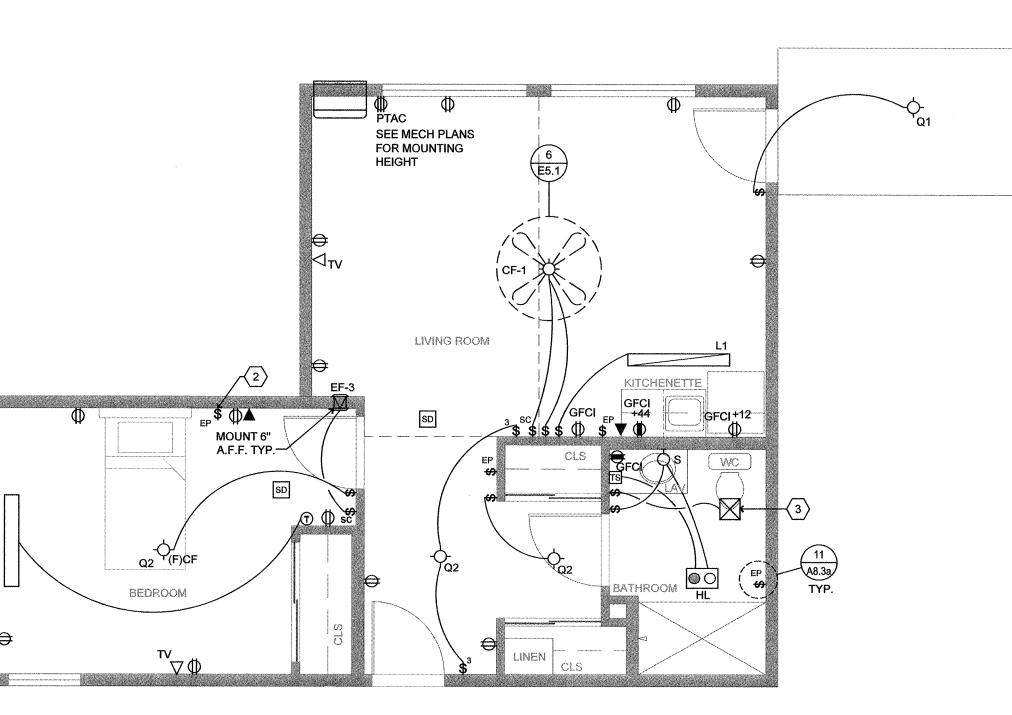

SCALE: 1/4"=1'-0"

GENERAL NOTES:

1. REFER TO 2/A8.3a FOR TYPICAL SUITE BATH LAYOUT.

2. FRAME AND WIRE FOR FUTURE PTAC RECEPTACLE ON RIGHT SIDE OF BASEBOARD LOCATION. TO REPLACE BASEBOARD IN "C" UNIT SPARE BEDROOMS.

3. REFER TO ELECTRICAL SCHEDULE NOTES /

BE G.F.C.I PROTECTED.

SPECIFICATIONS ON SHEET E2.1. 4. REFER TO ELECTRICAL DETAILS ON SHEET E2.2b.

5. INSTALL G.F.C.I. RECEPTACLE IN UNIT BATHROOMS AND AT BAR. RECEPTACLES WITHIN 6' OF SINK EDGE SHALL

6. FOR SUITE CIRCUITING SEE POWER SHEETS AND E2.3

7. PHONE JACKS IN OFFICE/MARKETING, MANAGER, CO-MANAGER SHALL BE DUPLEX. SEE SECTION 1.4, DWG. E4.1. EACH JACK SHOULD HOME RUN TO PHONE

8. INSTALL PTAC RECEPTACLE ON RIGHT SIDE OF UNIT, WITH IN 12" OF SLEEVE.

9. INTERCONNECT SUITE SMOKE DETECTORS. CIRCUIT SUITE SMOKE DETECTORS TO SUITE LIGHTING

CIRCUIT. 10. SEE ELECTRICAL POWER SHEETS FOR BASEBOARD

11. PROVIDE BLOCKING AND LISTED OUTLET BOX FOR THE INSTALLATION OF A FUTURE CEILING FAN AT THE LIGHTING LOCATIONS INDICATED WITH A "(F)CF"

ELECTRICAL LEGEND

\$3 THREE WAY SWITCH

\$OC AUTOMATIC WALL SWITCH \$EP WIRELESS EMERGENCY PULL SWITCH. COORDINATE LOCATION WITH TEL-TRON DRAWINGS

FAN SPEED CONTROL SWITCH RECEPTACLE

208 VOLT RECEPTACLE ARC-FAULT BREAKER CIRCUIT (AFCI). SPLIT RECEPTACLE C/W 2 CCTS. RECEPTACLE AT COUNTER

TV TELEPHONE THERMOSTAT

SPECIAL CONNECTION

CEILING FAN (CF-1) WITH LISTED BOX. SEE E2.1 LIGHTING SCHEDULE. INTERCONNECTED 120V COMBINATION SMOKE

GENTEX GN-503. INTERCONNECTED 120V SMOKE DETECTOR WITH STROBE. GENTEX T139 CSC.

DETECTOR AND CARBON MONOXIDE ALARM.

INTERCONNECTED 120V CARBON MONOXIDE

ALARM. GENTEX CO1209.

"E" INDICATES WIRING TO EMERGENCY POWER. SEE MECH. EF-3 ROOM TO ROOM FAN

(H) HEAT/ (L) LIGHT UNIT (SEE DETAIL 6/E2.2b,

ЮФ LIGHT FIXTURES. SEE LIGHTING SCHEUDLE ON

E2.1 LIGHT FIXTURE WITH LISTED BOX FOR FUTURE CEILING FAN. SEE GENERAL NOTE 11.

"EF-5" BY MECH (SEE M4.2) TIMER SWITCH (15 MIN. TURN-TYPE TIMER)

DATA PORT _____ HEATER

GFCI / GFI GROUND FAULT CIRCUIT INTERRUPTER FLUORESCENT UNDER CABINET LIGHT.

KEYED NOTES

REPLACE TYPE "Q2" FIXTURE WITH TYPE "CF1" CEILING FA ON UPPER FLOOR VAULTED UNITS. SEE LIGHTING PLANS FOR LOCATION OF VAULTED UNITS. (SEE DETAIL 6,7/E5.1) PROVIDE JUNCTION BOX AT 48" A.F.F. FOR EMERGENCY PULL SWITCH AND (1) FPLR-SHEILDED 18-4 CABLE FROM BEDROOM SMOKE DETECTOR. RELAY TO J-BOX AT THIS LOCATION ONLY. ADDITIONAL LOCATIONS WILL BE

SURFACE MOUNT. COORDINATE WITH MECHANICAL IF SUITE BATHROOM EXHAUST FAN WILL BE PROVIDED. IF NO FAN IS PROVIDED ELIMINATE SWITCH AND ELECTRICAL CONNECTION TO FAI

CAL BLE ANS


SIDENCE 3, MAINE 04103

8/28/2015

REVISED DATE 1 9/22/2015 2/2/2016 5 7/18/2016


SHEET E5.5

SUITE PLANS SCALE: 1/4"=1'-0"

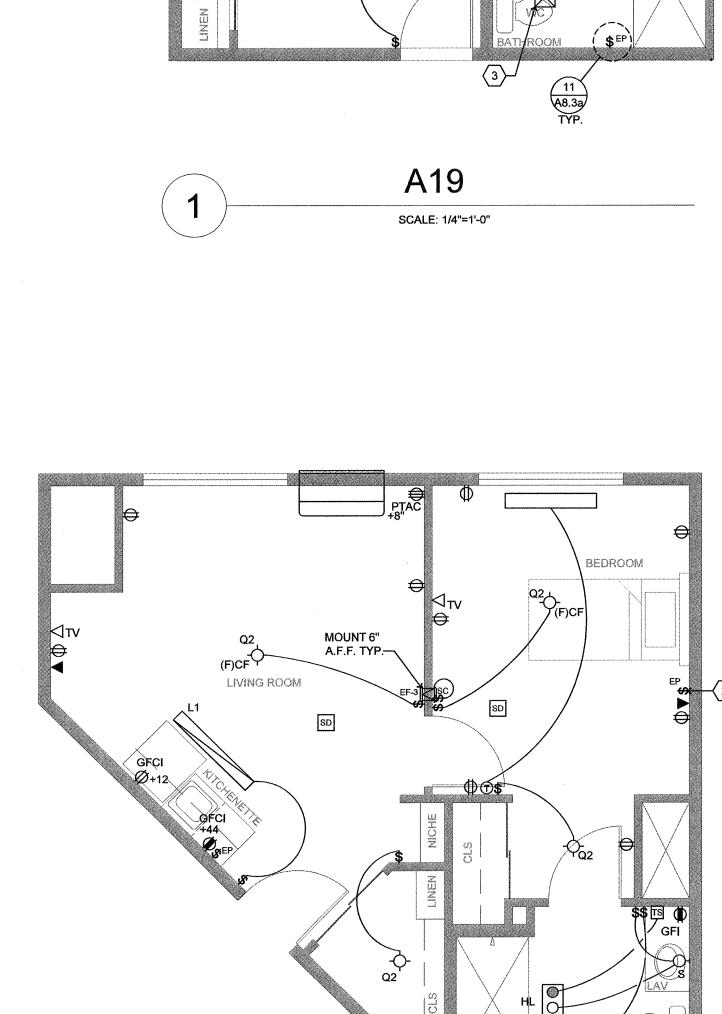

B3

SCALE: 1/4"=1'-0"

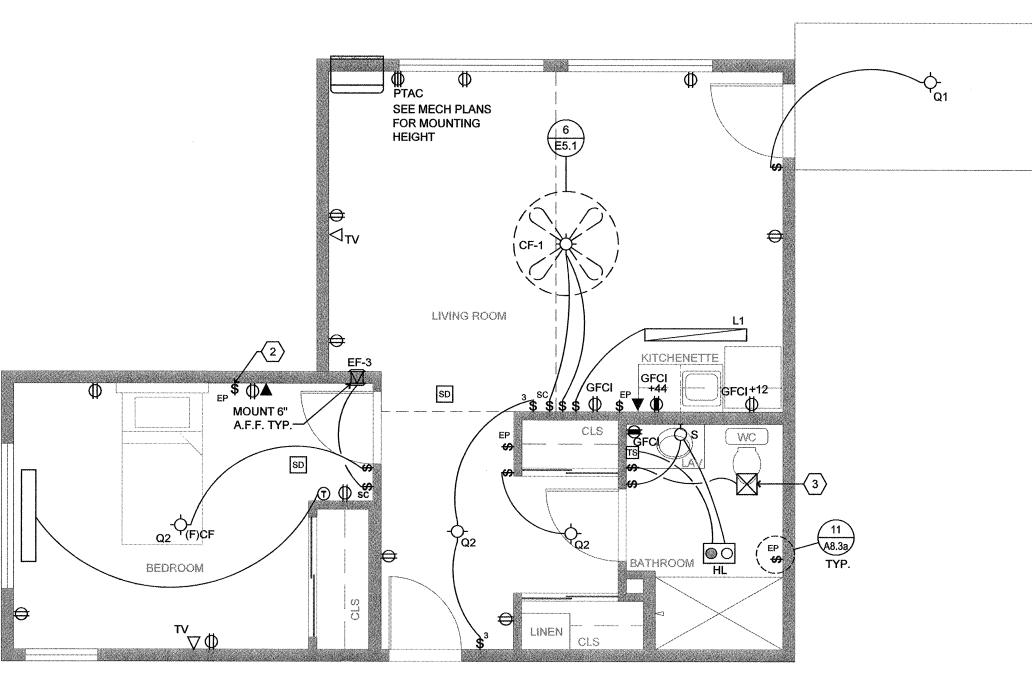

B4 SCALE: 1/4"=1'-0"