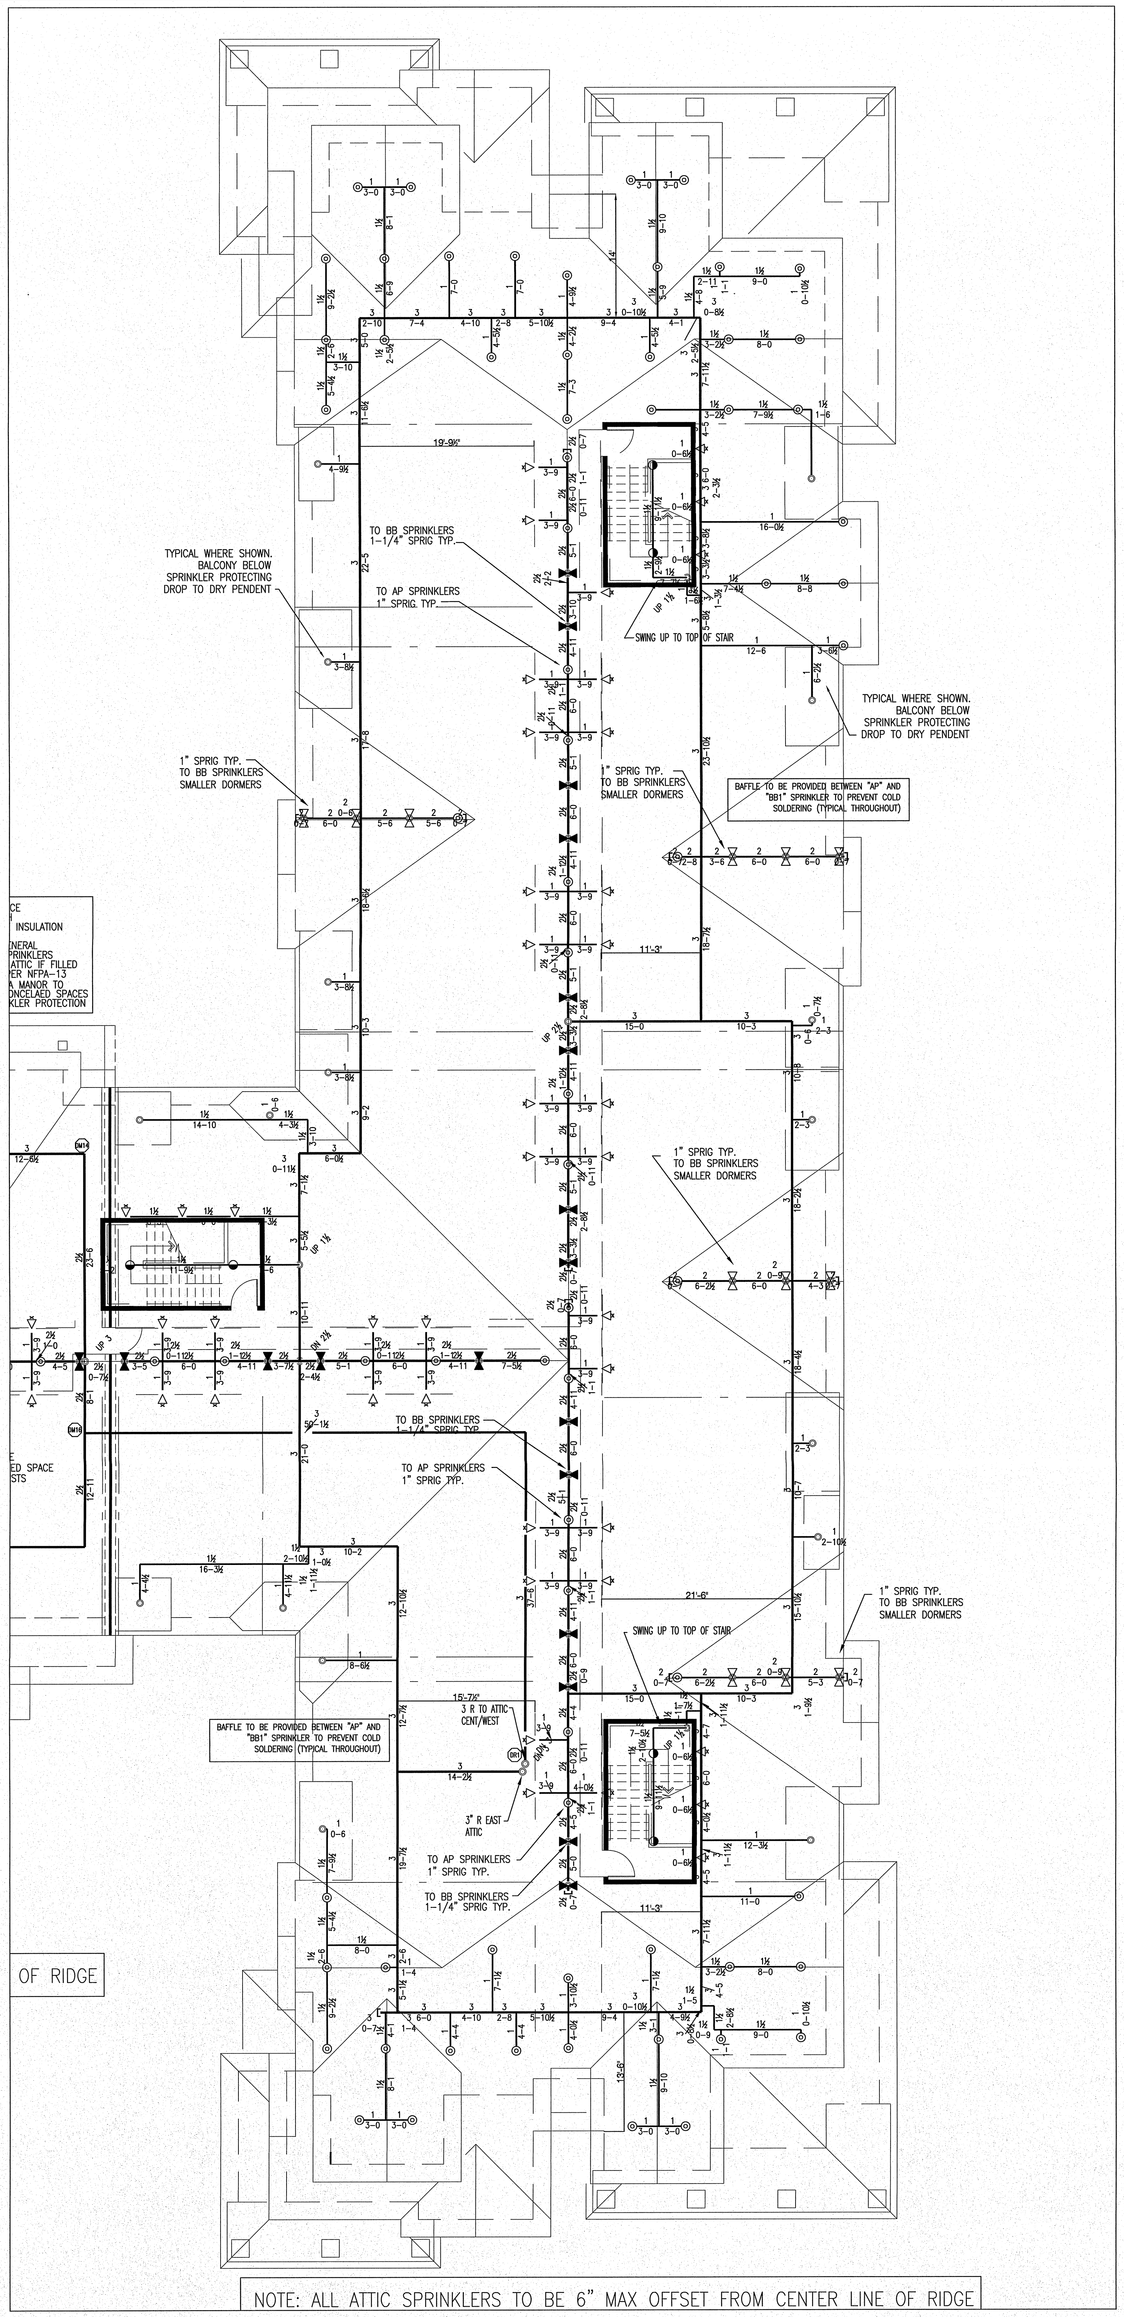

ATTIC EAST PLAN

SCALE: 1/8" =1'-0"

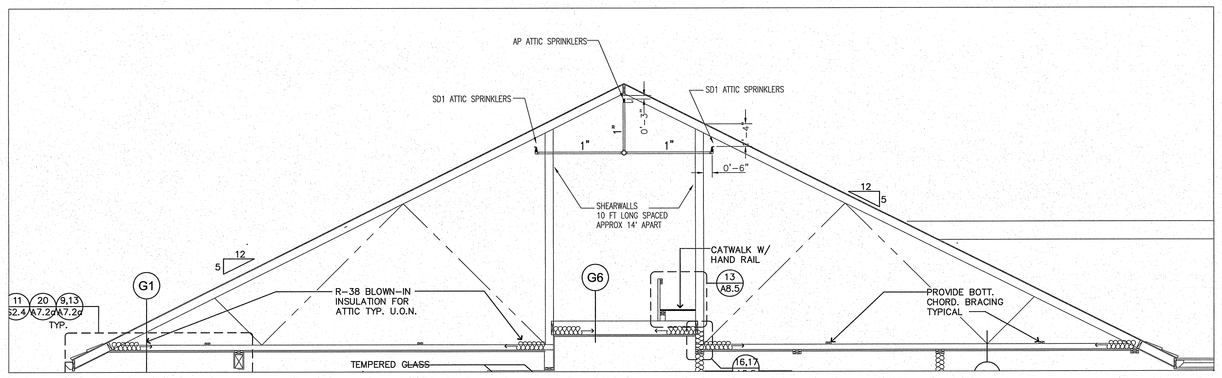

SECTION AT AP & SD ATTIC SPRINKLERS

SCALE: 1/4" =1'-0"

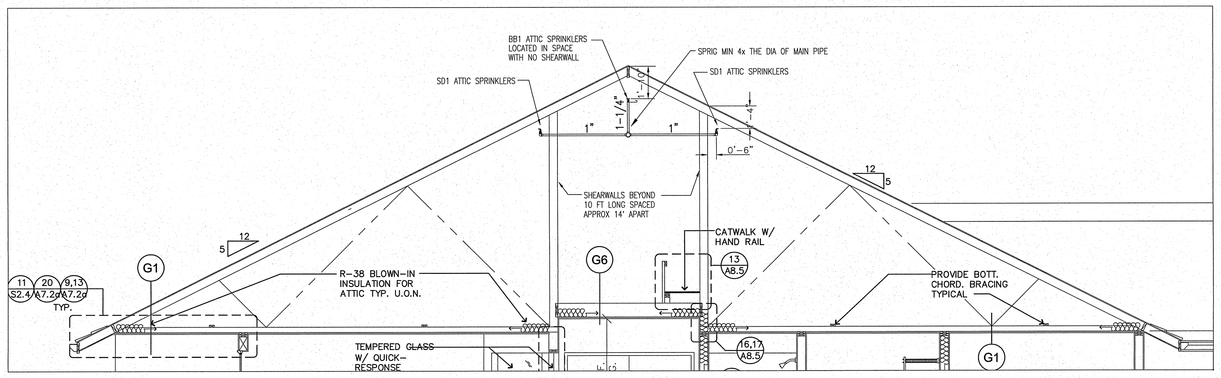

SECTION AT BB & SD ATTIC SPRINKLERS

SCALE: 3/16" =1'-0"

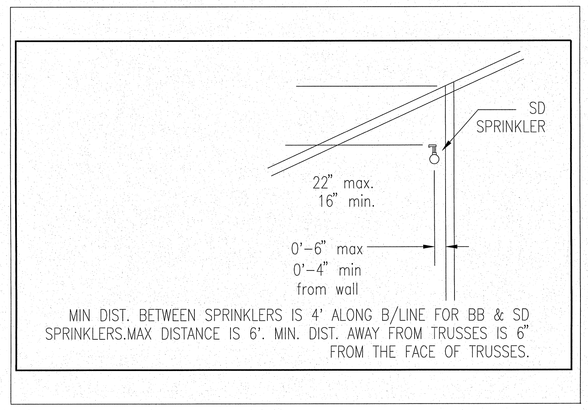

MIN DIST. BETWEEN SPRINKLERS IS 4' ALONG B/LINE FOR BB & SD SPRINKLERS.MAX DISTANCE IS 6'. MIN. DIST. AWAY FROM TRUSSES IS 6" FROM THE FACE OF TRUSSES.

SD ATTIC SPRINKLER DETAIL

SCALE: NTS

SPRINKLER SYMBOL DESCRIPTION

SYMBOL	SIZE	K-FAC	MAKE	PART#	RESPONSE	QTY
	STYLE	°F	MODEL	FINISH	COMMENTS	
	¾"	8.0	TYCO	TY4180	FAST RESP	18
	ATTIC	200	BB1	BRASS	------	
	½"	5.6	TYCO	TY3183	FAST RESP	41
	ATTIC	200	SD1	BRASS	------	
	½"	5.6	TYCO	TY3190	FAST RESP	76
	UPR/SPRG	200	AP	BRASS	------	
	½"	5.6	TYCO	TY3231	QUICK RESPONSE	6
	REC	155	TYFRB	WHITE	------	
	½"	5.6	TYCO	TY3180	FAST RESP	12
	ATTIC	200	BB1	BRASS	------	
TOTAL HEADS REQUIRED ON THIS SHEET:						153

DATE	REV	DESCRIPTION
DEC 15 2016	0	ISSUED FOR APPROVAL

REVISION HISTORY

ENGINEER'S STAMP

02/13/17

NICET CERTIFIED D. MANNERS 110933

EDGE FIRE PROTECTION FRONTLINE DEFENSE

7 MONROE DRIVE
PELHAM, ALABAMA
35124
PHONE: (205)620-2433 ext
(888)620-2433
FAX: (205)620-2434

PROJECT NAME:

PORTLAND RETIREMENT RESIDENCE
802 OCEAN AVE.
PORTLAND MAINE 04103

SHEET TITLE:

FIRE SPRINKLER PLAN
ATTIC EAST

DRAWN BY: D.S.

DATE: DEC 14 2016

SCALE: AS SHOWN

JOB NUMBER: MEC-16-001

SHEET NUMBER: FP 9 OF 9