


Job	Truss	Truss Type	Qty	Ply	
692942	001	GESI	1	1	A_MGE_e125990_1/19/2018 12:54:52 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:35 2018 Page 1  
ID:WqO2gqMuaYgvgQ979I42sBywEw1-o2a5Oo2jpg8NdbUG\_3C0RYjB50laPK7Fmvr8jltz0R2

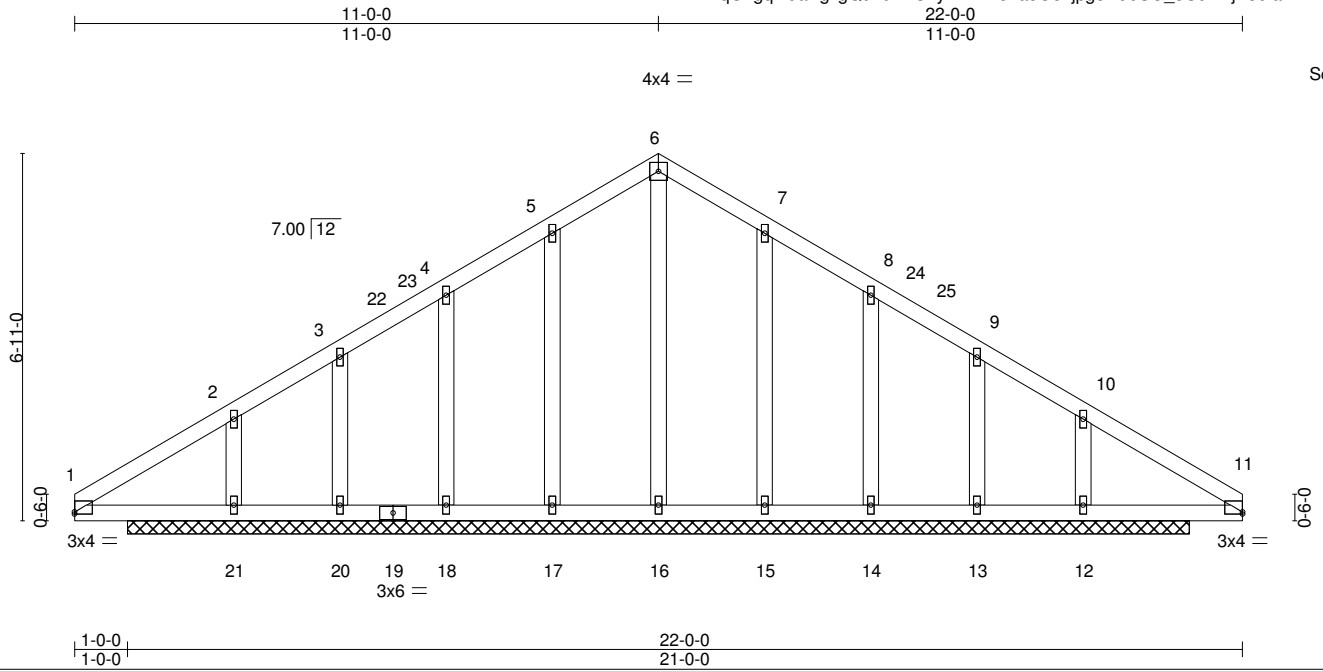

Scale = 1:43.4

Plate Offsets (X,Y)-- [1:0-0-0,0-0-8], [11:0-0-0,0-0-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 46.2	2-0-0	TC 0.25	in (loc) l/defl L/d	MT20	169/123
(Ground Snow=60.0)	Plate Grip DOL 1.15	BC 0.19	Vert(LL) n/a - n/a 999		
TCDL 10.0	Lumber DOL 1.15	WB 0.45	Vert(TL) n/a - n/a 999		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-SH	Horz(TL) -0.01 12 n/a n/a		
BCDL 10.0	Code IBC2009/TPI2007			Weight: 88 lb	FT = 0%

**LUMBER-**  
 TOP CHORD 2x4 SPF 1650F 1.5E  
 BOT CHORD 2x4 SPF 1650F 1.5E  
 OTHERS 2x4 SPF-S No.2

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 10-0-0 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size) 16=500/20-0-0 (min. 0-4-9), 17=285/20-0-0 (min. 0-4-9), 18=277/20-0-0 (min. 0-4-9), 20=186/20-0-0 (min. 0-4-9), 21=459/20-0-0 (min. 0-4-9), 15=285/20-0-0 (min. 0-4-9), 14=277/20-0-0 (min. 0-4-9), 13=186/20-0-0 (min. 0-4-9), 12=459/20-0-0 (min. 0-4-9)  
 Max Horz 21=-303(LC 6)  
 Max Uplift 17=-70(LC 7), 18=-76(LC 9), 20=-192(LC 7), 21=-167(LC 8), 15=-70(LC 6), 14=-75(LC 9), 13=-185(LC 6), 12=-169(LC 9)  
 Max Grav 16=500(LC 1), 17=375(LC 2), 18=357(LC 2), 20=186(LC 1), 21=561(LC 2), 15=375(LC 3), 14=357(LC 3), 13=186(LC 1), 12=561(LC 3)

**FORCES.** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-2=-138/376, 2-3=-93/307, 3-22=-12/268, 22-23=-4/271, 4-23=-1/328, 4-5=0/327, 5-6=0/316, 6-7=0/316, 7-8=0/327, 8-24=0/328, 24-25=0/271, 9-25=-6/268, 9-10=-86/307, 10-11=-133/376  
 BOT CHORD 1-21=-232/159, 20-21=-232/154, 19-20=-232/154, 18-19=-232/154, 17-18=-232/154, 16-17=-232/154, 15-16=-232/154, 14-15=-232/154, 13-14=-232/154, 12-13=-232/154, 11-12=-232/154  
 WEBS 6-16=-459/0, 5-17=-341/122, 4-18=-295/138, 3-20=-183/137, 2-21=-391/191, 7-15=-341/122, 8-14=-295/138, 9-13=-183/134, 10-12=-391/192

- NOTES-** (12-13)
- 1) Wind: ASCE 7-05; 105mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Corner(3) 0-0-0 to 3-0-0, Exterior(2) 3-0-0 to 8-0-0, Corner(3) 8-0-0 to 11-0-0, Exterior(2) 14-0-0 to 19-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.
  - 3) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
  - 4) Unbalanced snow loads have been considered for this design.
  - 5) All plates are 1.5x4 MT20 unless otherwise indicated.
  - 6) Gable studs spaced at 2-0-0 oc.
  - 7) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 8) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 9) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 70 lb uplift at joint 17, 76 lb uplift at joint 18, 192 lb uplift at joint 20, 167 lb uplift at joint 21, 70 lb uplift at joint 15, 75 lb uplift at joint 14, 185 lb uplift at joint 13 and 169 lb uplift at joint 12.
  - 10) Non Standard bearing condition. Review required.
  - 11) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
  - 12) Dimensions are in feet-inches-sixteenths
  - 13) Drawing prepared exclusively for manufacturing by Boise Cascade.

**LOAD CASE(S)**

Continued on page 2

Job	Truss	Truss Type	Qty	Ply	
692942	001	GESI	1	1	A_MGE_e125990_1/19/2018 12:54:52 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:35 2018 Page 2  
ID:WqO2gqMuaYgvgQ979I42sBywEw1-o2a5Oo2jpg8NdbUG\_3C0RYjB50IaPK7Fmvr8jIzt0R2


### LOAD CASE(S)

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-6=-112, 6-11=-112, 1-11=-20
- 2) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-23=-112, 6-23=-155, 6-11=-48, 1-11=-20
- 3) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-6=-48, 6-24=-155, 11-24=-112, 1-11=-20
- 4) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-6=-20, 6-11=-20, 1-11=-40
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-6=45, 6-11=45, 1-11=-12  
Horz: 1-6=-57, 6-11=57
- 6) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-6=-17, 6-11=29, 1-11=-12  
Horz: 1-6=5, 6-11=41
- 7) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-6=29, 6-11=-17, 1-11=-12  
Horz: 1-6=-41, 6-11=-5
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-22=49, 6-22=30, 6-11=30, 1-11=-12  
Horz: 1-22=-61, 6-22=-42, 6-11=42
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-6=30, 6-25=30, 11-25=49, 1-11=-12  
Horz: 1-6=-42, 6-25=42, 11-25=61
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-22=23, 6-22=15, 6-11=15, 1-11=-12  
Horz: 1-22=-35, 6-22=-27, 6-11=27
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-6=15, 6-25=15, 11-25=23, 1-11=-12  
Horz: 1-6=-27, 6-25=27, 11-25=35

Job	Truss	Truss Type	Qty	Ply	
692942	002	Common	2	1	A_PMT_e125990_1/19/2018 12:54:50 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:36 2018 Page 1  
ID:WqO2ggMuaYgvgQ979142sBywEw1-GE8Tb73LazGEEI3SYmjF\_JGHdQam8I2O?ZbhFlztoR1

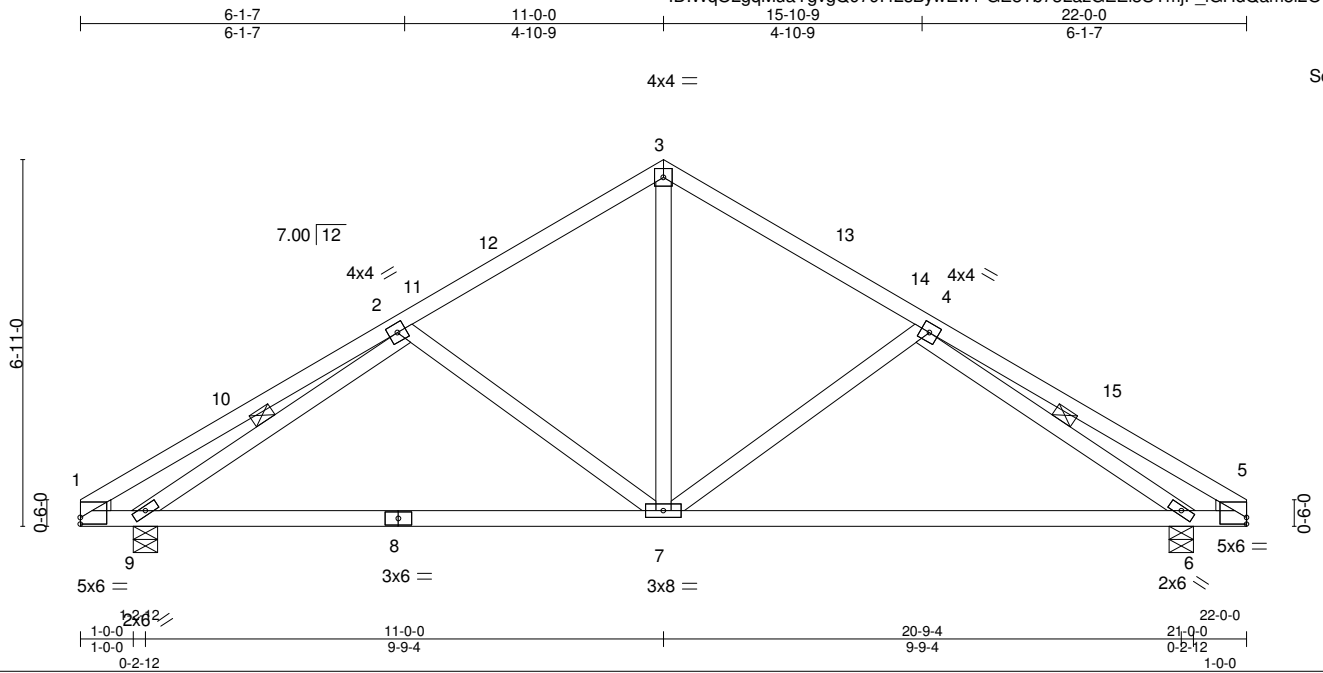

Scale = 1:43.5

Plate Offsets (X,Y)-- [1:0-0-0,0-1-8], [5:0-0-0,0-1-8]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 46.2	2-0-0	TC 0.52	Vert(LL) -0.12	7-9	>999	240	MT20	169/123
(Ground Snow=60.0)	Plate Grip DOL 1.15	BC 0.45	Vert(TL) -0.29	7-9	>825	180		
TCDL 10.0	Lumber DOL 1.15	WB 0.47	Horz(TL) 0.04	6	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-SH						
BCDL 10.0	Code IBC2009/TPI2007						Weight: 85 lb	FT = 0%

**LUMBER-**  
TOP CHORD 2x4 SPF 1650F 1.5E  
BOT CHORD 2x4 SPF 2100F 1.8E  
WEBS 2x4 SPF-S No.2  
WEDGE  
Left: 2x3 SPF No.2, Right: 2x3 SPF No.2

**BRACING-**  
TOP CHORD Structural wood sheathing directly applied or 5-8-14 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
WEBS 1 Row at midpt 2-9, 4-6

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size) 9=1456/0-5-8 (min. 0-1-14), 6=1456/0-5-8 (min. 0-1-14)  
Max Horz 9=303(LC 6)  
Max Uplift 9=330(LC 8), 6=330(LC 9)

**FORCES.** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-10=-585/0, 2-10=-498/18, 2-11=-1350/339, 11-12=-1316/340, 3-12=-1190/367, 3-13=-1190/367, 13-14=-1316/340,  
4-14=-1350/339, 4-15=-498/0, 5-15=-585/0  
BOT CHORD 1-9=0/424, 8-9=-234/1385, 7-8=-234/1385, 6-7=-230/1385, 5-6=0/424  
WEBS 3-7=-163/707, 4-7=-551/279, 2-7=-551/279, 2-9=-1294/466, 4-6=-1294/466

- NOTES-** (9-10)
- 1) Wind: ASCE 7-05; 105mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) 0-0-0 to 3-0-0, Interior(1) 3-0-0 to 8-0-0, Exterior(2) 8-0-0 to 11-0-0, Interior(1) 14-0-0 to 19-0-0 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
  - 3) Unbalanced snow loads have been considered for this design.
  - 4) Plate(s) at joint(s) 8 checked for a plus or minus 5 degree rotation about its center.
  - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 6) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.
  - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 330 lb uplift at joint 9 and 330 lb uplift at joint 6.
  - 8) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
  - 9) Dimensions are in feet-inches-sixteenths
  - 10) Drawing prepared exclusively for manufacturing by Boise Cascade.

**LOAD CASE(S)**

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-112, 3-5=-112, 1-5=-20
- 2) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-11=-112, 3-11=-155, 3-5=-48, 1-5=-20

Job	Truss	Truss Type	Qty	Ply	
692942	002	Common	2	1	A_PMT_e125990_1/19/2018 12:54:50 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:36 2018 Page 2  
ID:WqO2ggMuaYgvgQ979142sBywEw1-GE8Tb73LazGEEI3SYmjF\_IgHdQam8l2O?ZbhFlztoR1


### LOAD CASE(S)

- 3) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-3=-48, 3-14=-155, 5-14=-112, 1-5=-20
- 4) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-3=-20, 3-5=-20, 1-5=-40
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-10=45, 10-12=36, 3-12=45, 3-13=45, 13-15=36, 5-15=45, 1-9=59, 6-9=-12, 5-6=59  
Horz: 1-10=-57, 10-12=-48, 3-12=-57, 3-13=57, 13-15=48, 5-15=57
- 6) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-3=-17, 3-5=29, 1-9=27, 5-9=-12  
Horz: 1-3=5, 3-5=41
- 7) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-3=29, 3-5=-17, 1-6=-12, 5-6=27  
Horz: 1-3=-41, 3-5=-5
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=49, 2-3=30, 3-5=30, 1-9=21, 5-9=-12  
Horz: 1-2=-61, 2-3=-42, 3-5=42
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-3=30, 3-4=30, 4-5=49, 1-6=-12, 5-6=21  
Horz: 1-3=-42, 3-4=42, 4-5=61
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-2=23, 2-3=15, 3-5=15, 1-9=21, 5-9=-12  
Horz: 1-2=-35, 2-3=-27, 3-5=27
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-3=15, 3-4=15, 4-5=23, 1-6=-12, 5-6=21  
Horz: 1-3=-27, 3-4=27, 4-5=35

Job	Truss	Truss Type	Qty	Ply	
692942	003	GESTR	2	1	B_MGE_e125990_1/19/2018 12:54:57 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:36 2018 Page 1  
ID:WqO2gqMuaYgvqQ979I42sBywEw1-GE8Tb73LazGEEI3SYmjF\_IGANQUw8dHO?ZbhFztoR1



Scale = 1:69.7

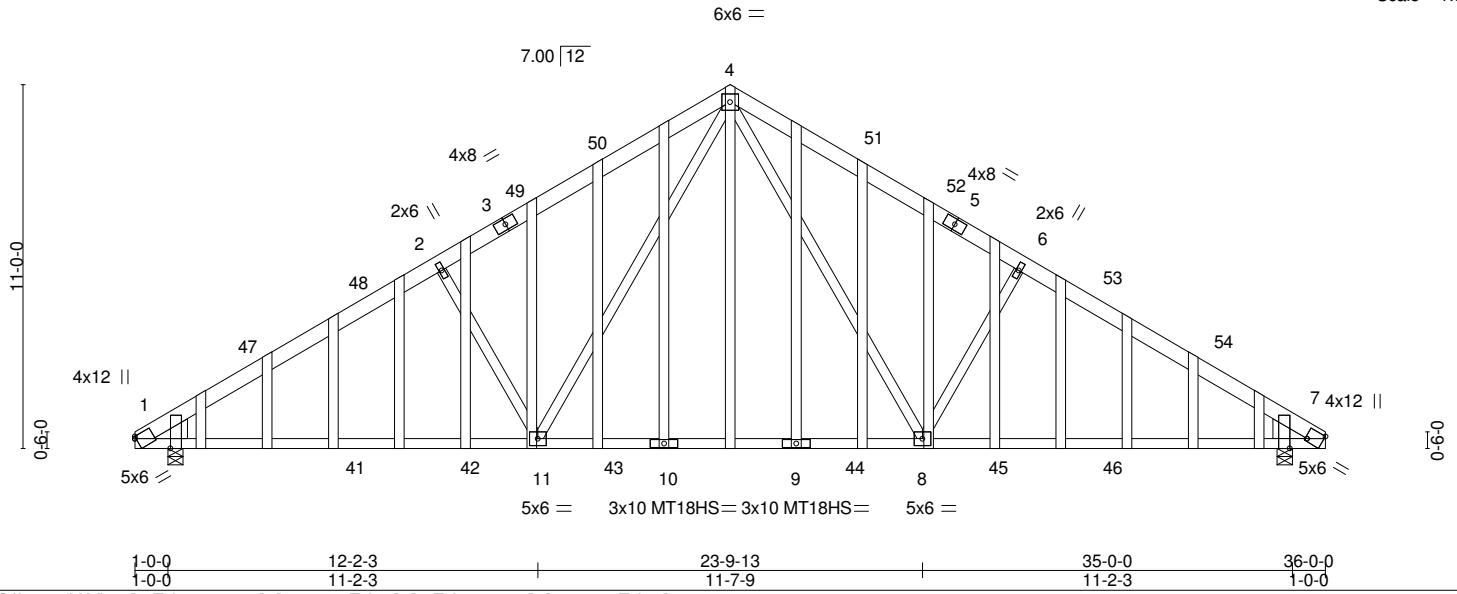


Plate Offsets (X,Y)-- [1:Edge,0-0-11], [1:0-3-8,Edge], [7:Edge,0-4-1], [7:0-3-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 46.2	2-0-0	TC 0.98	Vert(LL) -0.60	8-11	>711	240	MT20	169/123
(Ground Snow=60.0)	Plate Grip DOL 1.15	BC 0.82	Vert(TL) -0.90	8-11	>471	180	MT18HS	197/144
TCDL 10.0	Lumber DOL 1.15	WB 0.96	Horz(TL) 0.13	7	n/a	n/a		
BCLL 0.0 *	Rep Stress Incr YES	Matrix-SH						
BCDL 10.0	Code IBC2009/TPI2007						Weight: 284 lb	FT = 0%

**LUMBER-**

TOP CHORD 2x6 SPF 1650F 1.5E \*Except\*  
T1,T4: 2x6 SP M 23  
BOT CHORD 2x4 SP 2700F 2.2E \*Except\*  
B2: 2x4 SPF 1650F 1.5E  
WEBS 2x4 SPF-S No.2  
OTHERS 2x4 SPF-S No.2  
WEDGE  
Left: 2x8 SP M 23, Right: 2x8 SP M 23

**BRACING-**

TOP CHORD Structural wood sheathing directly applied or 3-6-10 oc purlins.  
BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.  
MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size) 1=2628/0-5-8 (min. 0-2-3), 7=2628/0-5-8 (min. 0-2-3)  
Max Horz 1=485(LC 7)  
Max Uplift 1=-435(LC 8), 7=-435(LC 9)

**FORCES.** (lb) - Maximum Compression/Maximum Tension

TOP CHORD 1-47=-4217/762, 47-48=-4058/763, 2-48=-3800/795, 2-3=-3778/815, 3-49=-3622/826, 49-50=-3494/840, 4-50=-3482/863, 4-51=-3482/863, 51-52=-3494/840, 5-52=-3622/826, 5-6=-3778/815, 6-53=-3800/795, 53-54=-4058/763, 7-54=-4217/762  
BOT CHORD 1-41=-520/3470, 41-42=-520/3470, 11-42=-520/3470, 11-43=-160/2286, 10-43=-160/2286, 9-10=-160/2286, 9-44=-160/2286, 8-44=-160/2286, 8-45=-520/3470, 45-46=-520/3470, 7-46=-520/3470  
WEBS 2-11=-1085/451, 4-11=-294/1671, 4-8=-294/1671, 6-8=-1085/451

**NOTES-** (10-11)

- 1) Wind: ASCE 7-05; 105mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) 0-3-10 to 3-10-13, Interior(1) 3-10-13 to 14-4-13, Exterior(2) 14-4-13 to 18-0-0, Interior(1) 21-7-3 to 32-1-3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
- 2) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
- 3) Unbalanced snow loads have been considered for this design.
- 4) All plates are MT20 plates unless otherwise indicated.
- 5) Plate(s) at joint(s) 10 and 9 checked for a plus or minus 5 degree rotation about its center.
- 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
- 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
- 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 435 lb uplift at joint 1 and 435 lb uplift at joint 7.
- 9) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- 10) Dimensions are in feet-inches-sixteenths
- 11) Drawing prepared exclusively for manufacturing by Boise Cascade.

**LOAD CASE(S)**

1) Dead + Snow (balanced) + Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15

Job	Truss	Truss Type	Qty	Ply	
692942	003	GESTR	2	1	B_MGE_e125990_1/19/2018 12:54:57 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:36 2018 Page 2  
ID:WqO2gqMuaYgvgQ979I42sBywEw1-GE8Tb73LazGEEI3SYmjF\_IGANQUw8dHO?ZbhFiztoR1

### LOAD CASE(S)

- Uniform Loads (plf)
  - Vert: 1-41=-20, 41-42=-60, 42-43=-20, 43-44=-60, 44-45=-20, 45-46=-60, 7-46=-20, 1-4=-112, 4-7=-112
- 2) Dead + Snow (Unbal. Left) + Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
  - Uniform Loads (plf)
    - Vert: 1-41=-20, 41-42=-60, 42-43=-20, 43-44=-60, 44-45=-20, 45-46=-60, 7-46=-20, 1-49=-112, 4-49=-170, 4-7=-48
- 3) Dead + Snow (Unbal. Right) + Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15
  - Uniform Loads (plf)
    - Vert: 1-41=-20, 41-42=-60, 42-43=-20, 43-44=-60, 44-45=-20, 45-46=-60, 7-46=-20, 1-4=-48, 4-52=-170, 7-52=-112
- 4) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25
  - Uniform Loads (plf)
    - Vert: 1-7=-40, 1-4=-20, 4-7=-20
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-7=-12, 1-47=45, 47-50=36, 4-50=45, 4-51=45, 51-54=36, 7-54=45
    - Horz: 1-47=-57, 47-50=-48, 4-50=-57, 4-51=57, 51-54=48, 7-54=57
- 6) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-7=-12, 1-4=-17, 4-7=29
    - Horz: 1-4=5, 4-7=41
- 7) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-7=-12, 1-4=29, 4-7=-17
    - Horz: 1-4=-41, 4-7=-5
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-7=-12, 1-48=49, 4-48=30, 4-7=30
    - Horz: 1-48=-61, 4-48=-42, 4-7=42
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-7=-12, 1-4=30, 4-53=30, 7-53=49
    - Horz: 1-4=-42, 4-53=42, 7-53=61
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-7=-12, 1-48=23, 4-48=15, 4-7=15
    - Horz: 1-48=-35, 4-48=-27, 4-7=27
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60
  - Uniform Loads (plf)
    - Vert: 1-7=-12, 1-4=15, 4-53=15, 7-53=23
    - Horz: 1-4=-27, 4-53=27, 7-53=35

Job	Truss	Truss Type	Qty	Ply	B_PMT_e125990_1/19/2018 12:54:55 PM
692942	004	FINK	9	1	Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:36 2018 Page 1  
ID:WqO2gqMuaYvgvQ979142sBywEw1-GE8Tb73LazGEEI3SYmjF\_IGCTQT18dGO?ZbhFlztoR1

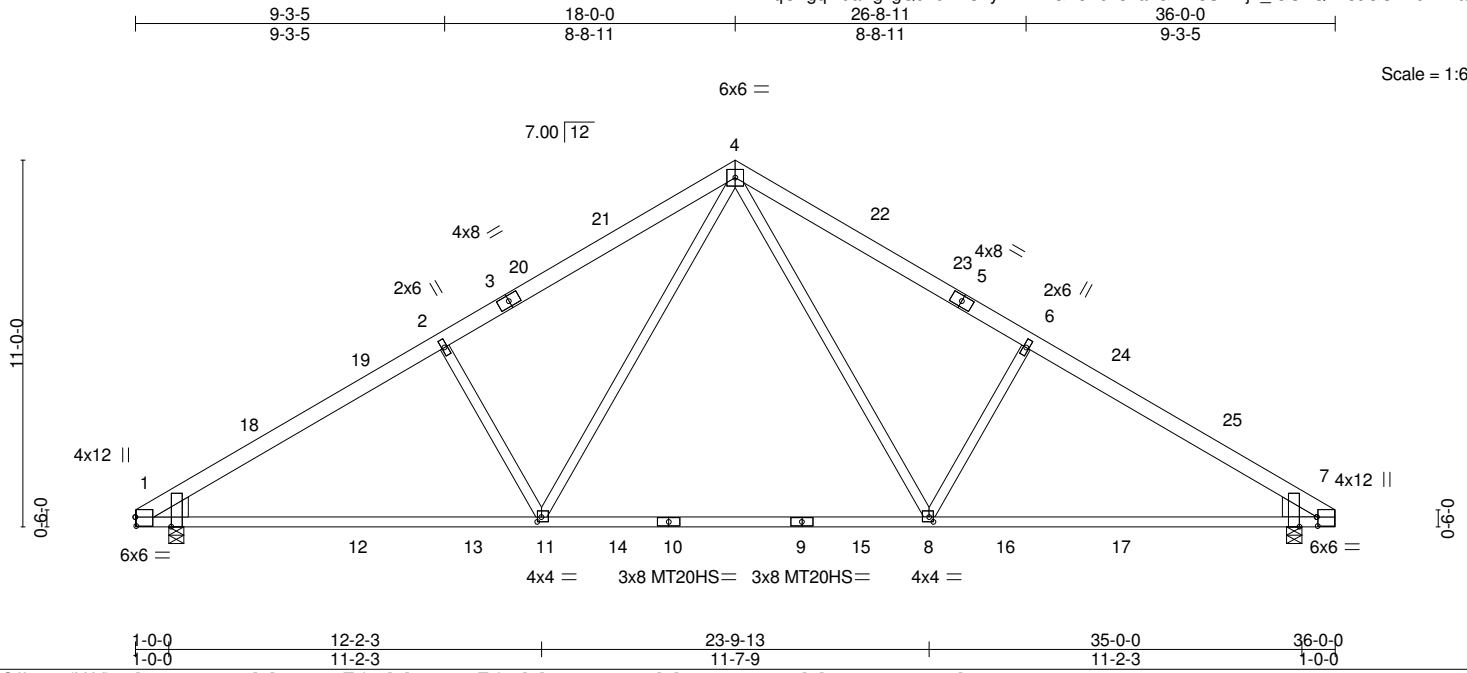


Plate Offsets (X,Y)-- [1:0-0-5,0-3-5], [1:0-3-8,Edge], [7:0-3-8,Edge], [7:0-0-5,0-3-5], [8:0-1-8,0-1-12], [11:0-1-8,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 46.2 (Ground Snow=60.0)	2-0-0 Plate Grip DOL 1.15 Lumber DOL 1.15	TC 0.85 BC 0.88	in (loc) l/defl L/d Vert(LL) -0.54 8-11 >792 240 Vert(TL) -0.87 8-11 >489 180 Horz(TL) 0.14 7 n/a n/a	MT20 MT20HS	169/123 148/108
TCDL 10.0	Rep Stress Incr YES	WB 0.96			
BCLL 0.0 *	Code IBC2009/TPI2007	Matrix-SH			
BCDL 10.0				Weight: 171 lb	FT = 0%

**LUMBER-**  
**TOP CHORD** 2x6 SPF 1650F 1.5E \*Except\*  
 T1,T4: 2x6 SP M 23  
**BOT CHORD** 2x4 SPF 2100F 1.8E \*Except\*  
 B2: 2x4 SPF 1650F 1.5E  
**WEBS** 2x4 SPF-S No.2  
**WEDGE**  
 Left: 2x8 SP M 23, Right: 2x8 SP M 23

**BRACING-**  
**TOP CHORD** Structural wood sheathing directly applied or 3-11-15 oc purlins.  
**BOT CHORD** Rigid ceiling directly applied or 10-0-0 oc bracing.  
 MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size) 1=2343/0-5-8 (min. 0-3-0), 7=2343/0-5-8 (min. 0-3-0)  
 Max Horz 1=-485(LC 7)  
 Max Uplift1=-435(LC 9), 7=-435(LC 10)

**FORCES.** (lb) - Maximum Compression/Maximum Tension  
**TOP CHORD** 1-18=-3704/762, 18-19=-3544/763, 2-19=-3287/795, 2-3=-3265/815, 3-20=-3109/826, 20-21=-2980/841, 4-21=-2969/863, 4-22=-2969/863, 22-23=-2980/841, 5-23=-3109/826, 5-6=-3265/815, 6-24=-3287/795, 24-25=-3544/763, 7-25=-3704/762  
**BOT CHORD** 1-12=-521/3032, 12-13=-521/3032, 11-13=-521/3032, 11-14=-160/1984, 10-14=-160/1984, 9-10=-160/1984, 9-15=-160/1984, 8-15=-160/1984, 8-16=-521/3032, 16-17=-521/3032, 7-17=-521/3032  
**WEBS** 2-11=-1095/451, 4-11=-294/1377, 4-8=-294/1377, 6-8=-1095/451

- NOTES-** (10-11)
- 1) Wind: ASCE 7-05; 105mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) 0-3-10 to 3-10-13, Interior(1) 3-10-13 to 14-4-13, Exterior(2) 14-4-13 to 18-0-0, Interior(1) 21-7-3 to 32-1-3 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - 2) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
  - 3) Unbalanced snow loads have been considered for this design.
  - 4) This truss has been designed for basic load combinations, which include cases with reductions for multiple concurrent live loads.
  - 5) All plates are MT20 plates unless otherwise indicated.
  - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - 7) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - 8) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 435 lb uplift at joint 1 and 435 lb uplift at joint 7.
  - 9) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
  - 10) Dimensions are in feet-inches-sixteenths
  - 11) Drawing prepared exclusively for manufacturing by Boise Cascade.

**LOAD CASE(S)**  
 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-7=-20, 1-4=-112, 4-7=-112

Job	Truss	Truss Type	Qty	Ply	
692942	004	FINK	9	1	B_PMT_e125990_1/19/2018 12:54:55 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:36 2018 Page 2  
ID:WqO2gqMuaYgvgQ979I42sBywEw1-GE8Tb73LazGEEI3SYmjF\_IGCTQT18dGO?ZbhFlztoR1

### LOAD CASE(S)

- 2) Dead + 0.75 Snow (balanced) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-12=-20, 12-13=-50, 13-14=-20, 14-15=-50, 15-16=-20, 16-17=-50, 7-17=-20, 1-4=-89, 4-7=-89
- 3) Dead + 0.75 Snow (Unbal. Left) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-12=-20, 12-13=-50, 13-14=-20, 14-15=-50, 15-16=-20, 16-17=-50, 7-17=-20, 1-20=-89, 4-20=-133, 4-7=-41
- 4) Dead + 0.75 Snow (Unbal. Right) + 0.75 Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-12=-20, 12-13=-50, 13-14=-20, 14-15=-50, 15-16=-20, 16-17=-50, 7-17=-20, 1-4=-41, 4-23=-133, 7-23=-89
- 5) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-7=-40, 1-4=-20, 4-7=-20
- 6) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-7=-12, 1-18=45, 18-21=36, 4-21=45, 4-22=45, 22-25=36, 7-25=45  
Horz: 1-18=-57, 18-21=-48, 4-21=-57, 4-22=57, 22-25=48, 7-25=57
- 7) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-7=-12, 1-4=-17, 4-7=29  
Horz: 1-4=5, 4-7=41
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-7=-12, 1-4=29, 4-7=-17  
Horz: 1-4=-41, 4-7=-5
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-7=-12, 1-19=49, 4-19=30, 4-7=30  
Horz: 1-19=-61, 4-19=-42, 4-7=42
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-7=-12, 1-4=30, 4-24=30, 7-24=49  
Horz: 1-4=-42, 4-24=42, 7-24=61
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-7=-12, 1-19=23, 4-19=15, 4-7=15  
Horz: 1-19=-35, 4-19=-27, 4-7=27
- 12) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-7=-12, 1-4=15, 4-24=15, 7-24=23  
Horz: 1-4=-27, 4-24=27, 7-24=35
- 13) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-7=-20, 1-20=-112, 4-20=-170, 4-7=-48
- 14) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-7=-20, 1-4=-48, 4-23=-170, 7-23=-112
- 15) Dead + Uninhabitable Attic Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-12=-20, 12-13=-60, 13-14=-20, 14-15=-60, 15-16=-20, 16-17=-60, 7-17=-20, 1-4=-20, 4-7=-20



Job	Truss	Truss Type	Qty	Ply	
692942	006	GESI	1	1	C_MGE_e125990_1/19/2018 12:55:02 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:37 2018 Page 1  
ID:WqO2gqMuaYgvgQ979142sBywEw1-kQiroT4\_LHO5svf6UEUWzpalq?OtDAYEDKFnBztoR0

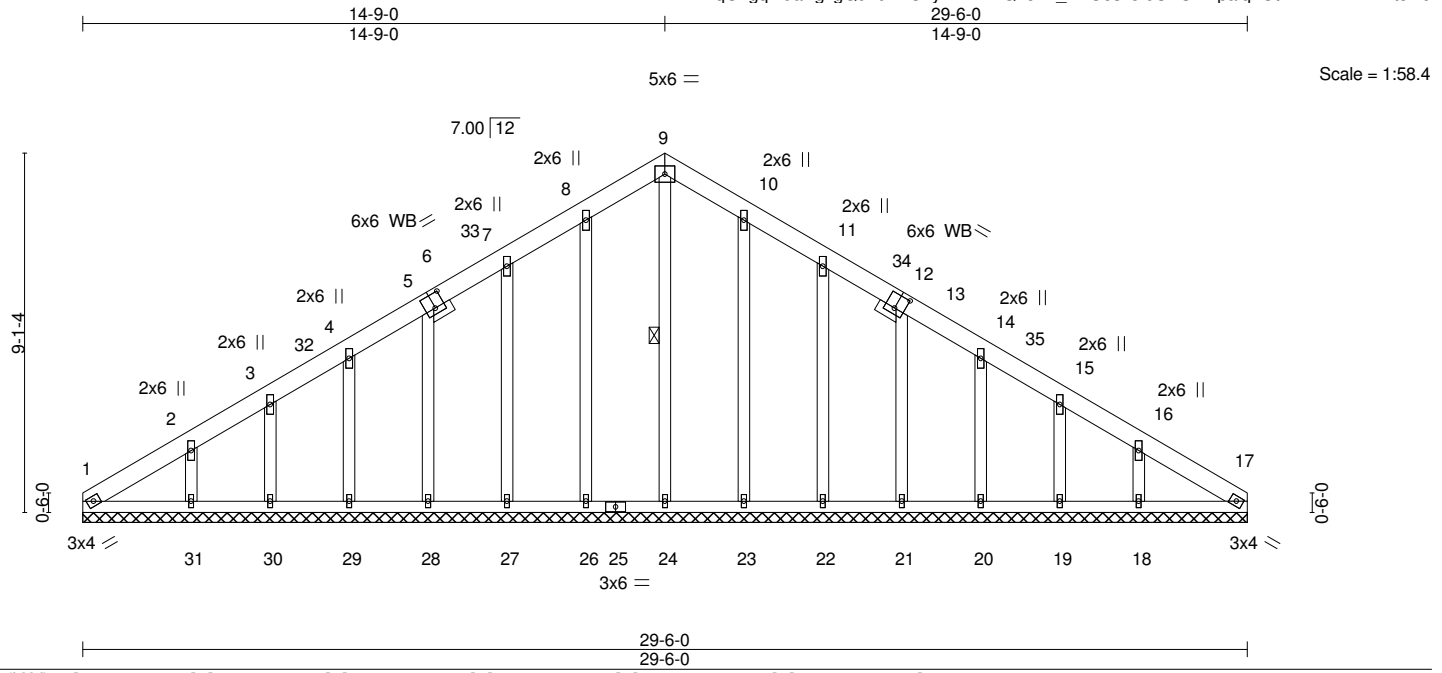


Plate Offsets (X,Y)-- [5:0-2-0,0-0-0], [6:0-3-0,0-4-4], [6:0-0-0,0-2-12], [12:0-3-0,0-4-4], [12:0-0-0,0-2-12], [13:0-2-0,0-0-0]					
<b>LOADING</b> (psf)	<b>SPACING-</b>	<b>CSI.</b>	<b>DEFL.</b>	<b>PLATES</b>	<b>GRIP</b>
TCLL 46.2 (Ground Snow=60.0) TCDL 10.0 BCLL 0.0 * BCDL 10.0	2-0-0 Plate Grip DOL 1.15 Lumber DOL 1.15 Rep Stress Incr YES Code IBC2009/TPI2007	TC 0.04 BC 0.04 WB 0.41 Matrix-SH	in (loc) l/defl L/d Vert(LL) n/a - n/a 999 Vert(TL) n/a - n/a 999 Horz(TL) 0.01 17 n/a n/a	MT20 Weight: 155 lb	169/123 FT = 0%

<b>LUMBER-</b>	<b>BRACING-</b>
TOP CHORD 2x6 SPF 1650F 1.5E BOT CHORD 2x4 SPF 1650F 1.5E OTHERS 2x4 SPF-S No.2	TOP CHORD Structural wood sheathing directly applied or 6-0-0 oc purlins. BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing. WEBS 1 Row at midpt 9-24
MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.	

**REACTIONS.** (lb/size) 1=168/29-6-0 (min. 0-6-1), 17=168/29-6-0 (min. 0-6-1), 24=208/29-6-0 (min. 0-6-1), 26=266/29-6-0 (min. 0-6-1), 27=272/29-6-0 (min. 0-6-1), 28=269/29-6-0 (min. 0-6-1), 29=268/29-6-0 (min. 0-6-1), 30=239/29-6-0 (min. 0-6-1), 31=355/29-6-0 (min. 0-6-1), 23=266/29-6-0 (min. 0-6-1), 22=272/29-6-0 (min. 0-6-1), 21=269/29-6-0 (min. 0-6-1), 20=268/29-6-0 (min. 0-6-1), 19=239/29-6-0 (min. 0-6-1), 18=355/29-6-0 (min. 0-6-1)  
Max Horz 1=400(LC 6)  
Max Uplift 1=113(LC 6), 17=-7(LC 7), 26=-59(LC 7), 27=-81(LC 9), 28=-68(LC 9), 29=-76(LC 8), 30=-100(LC 8), 31=-170(LC 8), 23=-33(LC 6), 22=-81(LC 9), 21=-68(LC 8), 20=-76(LC 9), 19=-100(LC 9), 18=-169(LC 9)  
Max Grav 1=183(LC 7), 17=168(LC 1), 24=208(LC 1), 26=372(LC 2), 27=375(LC 2), 28=295(LC 2), 29=268(LC 1), 30=239(LC 1), 31=356(LC 2), 23=372(LC 3), 22=375(LC 3), 21=295(LC 3), 20=268(LC 1), 19=239(LC 1), 18=356(LC 3)

**FORCES.** (lb) - Maximum Compression/Maximum Tension  
TOP CHORD 1-2=-372/276, 2-3=-287/253, 3-32=-235/241, 4-32=-227/248, 4-5=-180/240, 5-6=-124/221, 6-33=-123/225, 7-33=-118/234, 7-8=-130/281, 8-9=-132/335, 9-10=-132/335, 10-11=-130/281, 11-34=-48/195, 12-34=-106/187, 12-13=-114/183, 13-14=-104/121, 14-35=-38/59, 15-35=-104/52, 15-16=-113/64, 16-17=-177/81  
BOT CHORD 1-31=-63/174, 30-31=-63/174, 29-30=-63/174, 28-29=-63/174, 27-28=-63/174, 26-27=-63/174, 25-26=-63/174, 24-25=-63/174, 23-24=-63/174, 22-23=-63/174, 21-22=-63/174, 20-21=-63/174, 19-20=-63/174, 18-19=-63/174, 17-18=-63/174  
WEBS 9-24=-191/5, 8-26=-332/83, 7-27=-335/149, 5-28=-256/133, 4-29=-226/130, 3-30=-206/126, 2-31=-294/190, 10-23=-332/80, 11-22=-335/149, 13-21=-256/133, 14-20=-226/130, 15-19=-206/126, 16-18=-294/189

- NOTES-** (12-13)  
1) Wind: ASCE 7-05; 105mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Corner(3) 0-1-12 to 3-1-12, Exterior(2) 3-1-12 to 11-9-0, Corner(3) 11-9-0 to 14-9-0, Exterior(2) 17-9-0 to 26-4-4 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60  
2) Truss designed for wind loads in the plane of the truss only. For studs exposed to wind (normal to the face), see Standard Industry Gable End Details as applicable, or consult qualified building designer as per ANSI/TPI 1.  
3) TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp C; Partially Exp.; Ct=1.1  
4) Unbalanced snow loads have been considered for this design.  
5) All plates are 1.5x4 MT20 unless otherwise indicated.  
6) Gable requires continuous bottom chord bearing.  
7) Gable studs spaced at 2-0-0 oc.  
8) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.  
9) \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members.

Job	Truss	Truss Type	Qty	Ply	
692942	006	GESI	1	1	C_MGE_e125990_1/19/2018 12:55:02 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 13 02:37 2018 Page 2  
ID:WqO2gqMuaYgvgQ979142sBywEw1-kQiroT4\_LHO5svef6UEUWzpalq?OtDAYEDKFnBztoR0

**NOTES-** (12-13)

- 10) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 113 lb uplift at joint 1, 7 lb uplift at joint 17, 59 lb uplift at joint 26, 81 lb uplift at joint 27, 68 lb uplift at joint 28, 76 lb uplift at joint 29, 100 lb uplift at joint 30, 170 lb uplift at joint 31, 33 lb uplift at joint 23, 81 lb uplift at joint 22, 68 lb uplift at joint 21, 76 lb uplift at joint 20, 100 lb uplift at joint 19 and 169 lb uplift at joint 18.
- 11) This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
- 12) Dimensions are in feet-inches-sixteenths
- 13) Drawing prepared exclusively for manufacturing by Boise Cascade.


**LOAD CASE(S)**

- 1) Dead + Snow (balanced): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-9=-112, 9-17=-112, 1-17=-20
- 2) Dead + Snow (Unbal. Left): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-33=-112, 9-33=-164, 9-17=-48, 1-17=-20
- 3) Dead + Snow (Unbal. Right): Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-9=-48, 9-34=-164, 17-34=-112, 1-17=-20
- 4) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-9=-20, 9-17=-20, 1-17=-40
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-9=45, 9-17=45, 1-17=-12  
Horz: 1-9=-57, 9-17=57
- 6) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-9=-17, 9-17=29, 1-17=-12  
Horz: 1-9=5, 9-17=41
- 7) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-9=29, 9-17=-17, 1-17=-12  
Horz: 1-9=-41, 9-17=-5
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-32=49, 9-32=30, 9-17=30, 1-17=-12  
Horz: 1-32=-61, 9-32=-42, 9-17=42
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-9=30, 9-35=30, 17-35=49, 1-17=-12  
Horz: 1-9=-42, 9-35=42, 17-35=61
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-32=23, 9-32=15, 9-17=15, 1-17=-12  
Horz: 1-32=-35, 9-32=-27, 9-17=27
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-9=15, 9-35=15, 17-35=23, 1-17=-12  
Horz: 1-9=-27, 9-35=27, 17-35=35

Job	Truss	Truss Type	Qty	Ply	C_PMT_e125990_1/19/2018 12:54:59 PM
692942	007	Common	9	1	Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:37 2018 Page 1  
ID:WqO2gqMuaYgvgQ979142sBywEw1-kQiroT4\_LHO5svef6UEUWzplLqppLbXYEDKFnBztoR0

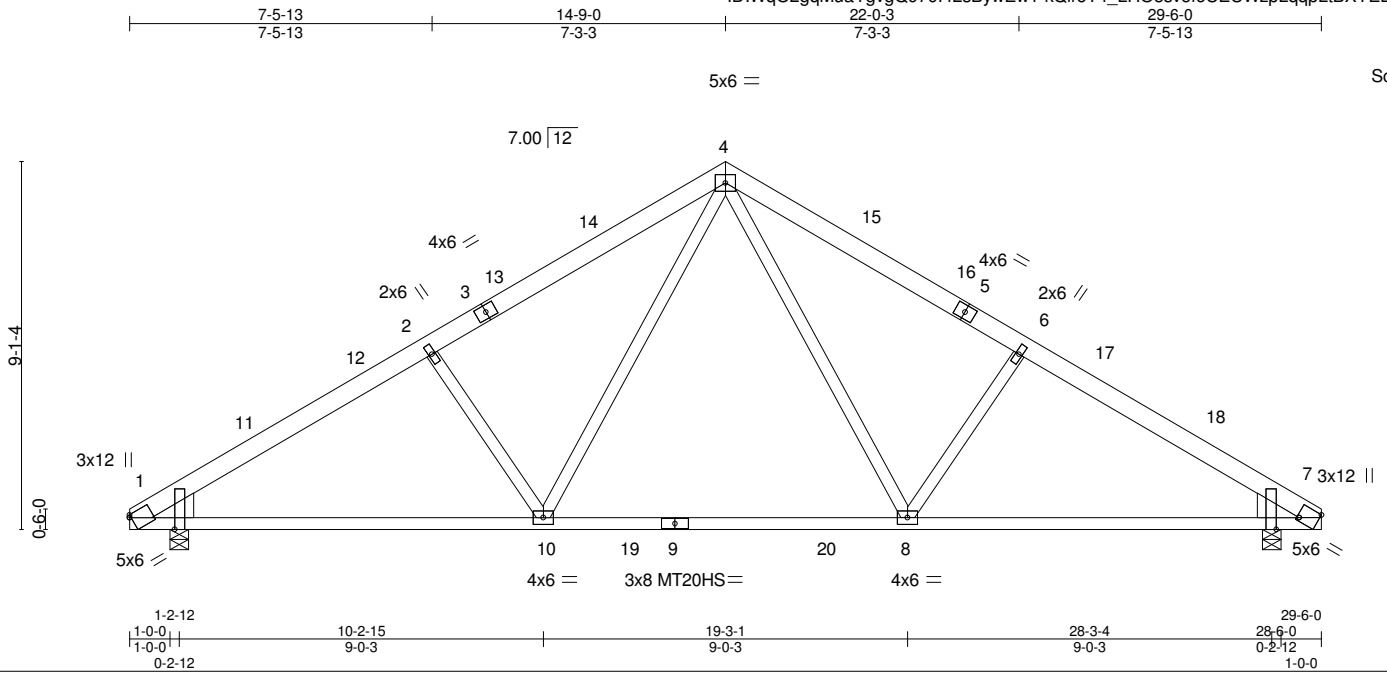

Scale = 1:57.0

Plate Offsets (X,Y)-- [1:Edge,0-0-11], [1:0-3-8,Edge], [7:Edge,0-4-1], [7:0-3-8,Edge]

LOADING (psf)	SPACING-	CSI.	DEFL.	in (loc)	l/defl	L/d	PLATES	GRIP
TCLL 46.2 (Ground Snow=60.0)	2-0-0 Plate Grip DOL 1.15	TC 1.00	Vert(LL) -0.41	8-10	>855	240	MT20	169/123
TCDL 10.0	Lumber DOL 1.15	BC 0.81	Vert(TL) -0.54	8-10	>640	180	MT20HS	148/108
BCLL 0.0 *	Rep Stress Incr YES	WB 0.51	Horz(TL) 0.12	7	n/a	n/a		
BCDL 10.0	Code IBC2009/TPI2007	Matrix-SH						Weight: 130 lb FT = 0%

**LUMBER-**  
 TOP CHORD 2x6 SPF 1650F 1.5E  
 BOT CHORD 2x4 SPF 1650F 1.5E  
 WEBS 2x4 SPF-S No.2  
 WEDGE  
 Left: 2x8 SP M 23, Right: 2x8 SP M 23

**BRACING-**  
 TOP CHORD Structural wood sheathing directly applied or 4-6-12 oc purlins.  
 BOT CHORD Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

**REACTIONS.** (lb/size) 1=2010/0-5-8 (min. 0-3-2), 7=2010/0-5-8 (min. 0-3-2)  
 Max Horz 1=-398(LC 6)  
 Max Uplift 1=-356(LC 8), 7=-356(LC 9)

**FORCES.** (lb) - Maximum Compression/Maximum Tension  
 TOP CHORD 1-11=-3206/626, 11-12=-3070/627, 2-12=-2872/652, 2-3=-2801/642, 3-13=-2684/650, 13-14=-2570/663, 4-14=-2552/682, 4-15=-2552/682, 15-16=-2570/663, 5-16=-2684/650, 5-6=-2801/642, 6-17=-2872/652, 17-18=-3070/627, 7-18=-3206/626  
 BOT CHORD 1-10=-427/2620, 10-19=-129/1742, 9-19=-129/1742, 9-20=-129/1742, 8-20=-129/1742, 7-8=-427/2620  
 WEBS 4-8=-217/1153, 6-8=-851/360, 4-10=-217/1153, 2-10=-851/360

- NOTES-** (9-10)
- Wind: ASCE 7-05; 105mph; TCDL=6.0psf; BCDL=6.0psf; h=35ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone and C-C Exterior(2) 0-3-10 to 3-3-10, Interior(1) 3-3-10 to 11-9-0, Exterior(2) 11-9-0 to 14-9-0, Interior(1) 17-9-0 to 26-2-6 zone; cantilever left and right exposed ;C-C for members and forces & MWFRS for reactions shown; Lumber DOL=1.60 plate grip DOL=1.60
  - TCLL: ASCE 7-05; Pg= 60.0 psf (ground snow); Pf=46.2 psf (flat roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
  - Unbalanced snow loads have been considered for this design.
  - All plates are MT20 plates unless otherwise indicated.
  - This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
  - \* This truss has been designed for a live load of 20.0psf on the bottom chord in all areas where a rectangle 3-6-0 tall by 2-0-0 wide will fit between the bottom chord and any other members, with BCDL = 10.0psf.
  - Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 356 lb uplift at joint 1 and 356 lb uplift at joint 7.
  - This truss is designed in accordance with the 2009 International Building Code section 2306.1 and referenced standard ANSI/TPI 1.
  - Dimensions are in feet-inches-sixteenths
  - Drawing prepared exclusively for manufacturing by Boise Cascade.

**LOAD CASE(S)**

- Dead + Snow (balanced) + Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-4=-112, 4-7=-112, 1-19=-20, 19-20=-60, 7-20=-20
- Dead + Snow (Unbal. Left) + Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15  
 Uniform Loads (plf)  
 Vert: 1-13=-112, 4-13=-163, 4-7=-48, 1-19=-20, 19-20=-60, 7-20=-20

Job	Truss	Truss Type	Qty	Ply	
692942	007	Common	9	1	C_PMT_e125990_1/19/2018 12:54:59 PM Job Reference (optional)

Boise Structural Solutions, Saco, ME 04072, Samantha Turbide

Run: 8.110 s Jun 13 2017 Print: 8.110 s Jun 13 2017 MiTek Industries, Inc. Fri Jan 19 13:02:37 2018 Page 2  
ID:WqO2gqMuaYgvgQ979I42sBywEw1-kQiroT4\_LHO5svef6UEUWzplQqpLtBXyEDKFnBztoR0

### LOAD CASE(S)

- 3) Dead + Snow (Unbal. Right) + Uninhab. Attic Storage: Lumber Increase=1.15, Plate Increase=1.15  
Uniform Loads (plf)  
Vert: 1-4=-48, 4-16=-163, 7-16=-112, 1-19=-20, 19-20=-60, 7-20=-20
- 4) Dead + Uninhabitable Attic Without Storage: Lumber Increase=1.25, Plate Increase=1.25  
Uniform Loads (plf)  
Vert: 1-4=-20, 4-7=-20, 1-7=-40
- 5) Dead + 0.6 C-C Wind (Pos. Internal) Case 1: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-11=45, 11-14=36, 4-14=45, 4-15=45, 15-18=36, 7-18=45, 1-7=-12  
Horz: 1-11=-57, 11-14=-48, 4-14=-57, 4-15=57, 15-18=48, 7-18=57
- 6) Dead + 0.6 MWFRS Wind (Pos. Internal) Left: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=-17, 4-7=29, 1-7=-12  
Horz: 1-4=5, 4-7=41
- 7) Dead + 0.6 MWFRS Wind (Pos. Internal) Right: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=29, 4-7=-17, 1-7=-12  
Horz: 1-4=-41, 4-7=-5
- 8) Dead + 0.6 MWFRS Wind (Pos. Internal) 1st Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-12=49, 4-12=30, 4-7=30, 1-7=-12  
Horz: 1-12=-61, 4-12=-42, 4-7=42
- 9) Dead + 0.6 MWFRS Wind (Pos. Internal) 2nd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=30, 4-17=30, 7-17=49, 1-7=-12  
Horz: 1-4=-42, 4-17=42, 7-17=61
- 10) Dead + 0.6 MWFRS Wind (Pos. Internal) 3rd Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-12=23, 4-12=15, 4-7=15, 1-7=-12  
Horz: 1-12=-35, 4-12=-27, 4-7=27
- 11) Dead + 0.6 MWFRS Wind (Pos. Internal) 4th Parallel: Lumber Increase=1.60, Plate Increase=1.60  
Uniform Loads (plf)  
Vert: 1-4=15, 4-17=15, 7-17=23, 1-7=-12  
Horz: 1-4=-27, 4-17=27, 7-17=35