

DIVISION 01000 - GENERAL REQUIREMENTS

PART 1 GENERAL

REFER TO SPRINT STANDARD CONSTRUCTION SPECIFICATIONS. IN CASE OF A CONFLICT, SPRINT STANDARD CONSTRUCTION SPECIFICATIONS (LATEST EDITION) SHALL BE FOLLOWED.

PART 2 GENERAL NOTES

- 1. THE CONTRACTOR SHALL GIVE ALL NOTICES AND COMPLY WITH ALL LAWS, ORDINANCES, RULES, REGULATIONS AND LAWFUL ORDERS OF ANY PUBLIC AUTHORITY, MUNICIPAL AND UTILITY COMPANY SPECIFICATIONS, AND LOCAL AND STATE JURISDICTIONAL CODES BEARING ON THE PERFORMANCE OF THE WORK. THE WORK PERFORMED ON THE PROJECT AND THE MATERIALS INSTALLED SHALL BE IN STRICT ACCORDANCE WITH ALL APPLICABLE CODES, REGULATIONS, AND ORDINANCES.
2. THE ARCHITECT/ENGINEER HAVE MADE EVERY EFFORT TO SET FORTH IN THE CONSTRUCTION AND CONTRACT DOCUMENTS THE COMPLETE SCOPE OF WORK. THE CONTRACTOR BIDDING THE JOB IS NEVERTHELESS CAUTIONED THAT MINOR OMISSIONS OR ERRORS IN THE DRAWINGS AND OR SPECIFICATIONS SHALL NOT EXCUSE SAID CONTRACTOR FROM COMPLETING THE PROJECT AND IMPROVEMENTS IN ACCORDANCE WITH THE INTENT OF THESE DOCUMENTS.
3. THE CONTRACTOR OR BIDDER SHALL BEAR THE RESPONSIBILITY OF NOTIFYING (IN WRITING) SPRINT'S REPRESENTATIVE OF ANY CONFLICTS, ERRORS OR OMISSIONS PRIOR TO THE SUBMISSION OF CONTRACTOR'S PROPOSAL OR PERFORMANCE OF WORK.
4. THE SCOPE OF WORK SHALL INCLUDE FURNISHING ALL MATERIALS, EQUIPMENT, LABOR AND ALL OTHER MATERIALS AND LABOR DEEMED NECESSARY TO COMPLETE THE WORK/PROJECT AS DESCRIBED HEREIN.
5. THE CONTRACTOR SHALL VISIT THE JOB SITE PRIOR TO THE SUBMISSION OF BIDS OR PERFORMING WORK TO FAMILIARIZE THEMSELVES WITH THE FIELD CONDITIONS AND TO VERIFY THAT THE PROJECT CAN BE CONSTRUCTED IN ACCORDANCE WITH THE CONSTRUCTION DRAWINGS.
6. THE CONTRACTOR SHALL OBTAIN AUTHORIZATION TO PROCEED WITH CONSTRUCTION PRIOR TO STARTING WORK ON ANY ITEM NOT CLEARLY DEFINED BY THE CONSTRUCTION DRAWINGS / CONTRACT DOCUMENTS.
7. THE CONTRACTOR SHALL INSTALL ALL EQUIPMENT AND MATERIALS ACCORDING TO THE MANUFACTURER'S / VENDOR'S SPECIFICATIONS UNLESS NOTED OTHERWISE OR WHERE LOCAL CODES OR ORDINANCES TAKE PRECEDENCE.
8. THE CONTRACTOR SHALL MAINTAIN A FULL SET OF CONSTRUCTION DOCUMENTS AT THE SITE UPDATED WITH THE LATEST REVISIONS AND ADDENDUMS OR CLARIFICATIONS AVAILABLE FOR THE USE OF ALL PERSONNEL INVOLVED WITH THE PROJECT.
9. THE CONTRACTOR SHALL SUPERVISE AND DIRECT THE PROJECT DESCRIBED HEREIN. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES AND PROCEDURES AND FOR COORDINATING ALL PORTIONS OF THE WORK UNDER THE CONTRACT.
10. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING ALL PERMITS AND INSPECTIONS WHICH MAY BE REQUIRED FOR THE WORK BY THE ARCHITECT/ENGINEER, THE STATE, COUNTY OR LOCAL GOVERNMENT AUTHORITY.
11. THE CONTRACTOR SHALL MAKE NECESSARY PROVISIONS TO PROTECT EXISTING SITE CONDITIONS DURING CONSTRUCTION. UPON COMPLETION OF WORK, THE CONTRACTOR SHALL REPAIR ANY DAMAGE THAT MAY HAVE OCCURRED DUE TO CONSTRUCTION ON OR ABOUT THE PROPERTY.
12. THE CONTRACTOR SHALL KEEP THE GENERAL WORK AREA CLEAN AND HAZARD FREE DURING CONSTRUCTION AND DISPOSE OF ALL DIRT, DEBRIS, RUBBISH AND REMOVE ALL UNNECESSARY MATERIAL.
13. THE CONTRACTOR SHALL COMPLY WITH ALL PERTINENT SECTIONS OF THE STATE BASIC BUILDING CODE, LATEST EDITION, AND ALL OSHA REQUIREMENTS AS THEY APPLY TO THIS PROJECT. ALL EXISTING ACTIVE SEWER, WATER, GAS, ELECTRIC, AND OTHER UTILITIES WHERE ENCOUNTERED IN THE WORK, SHALL BE PROTECTED AT ALL TIMES, AND WHERE REQUIRED FOR THE PROPER EXECUTION OF THE WORK, SHALL BE RELOCATED AS DIRECTED BY THE ARCHITECT/ENGINEER.
14. THE CONTRACTOR SHALL NOTIFY SPRINT'S REPRESENTATIVE WHERE A CONFLICT OCCURS ON ANY OF THE CONTRACT DOCUMENTS. THE CONTRACTOR IS NOT TO ORDER MATERIAL OR CONSTRUCT ANY PORTION OF THE WORK THAT IS IN CONFLICT UNTIL THE CONFLICT IS RESOLVED BY SPRINT'S REPRESENTATIVE.
15. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS, ELEVATIONS, PROPERTY LINES, ETC. ON THE JOB.
16. THE CONTRACTOR SHALL NOTIFY THE RF ENGINEER FOR ANTENNA AZIMUTH VERIFICATION (DURING ANTENNA INSTALLATION) PRIOR TO CONDUCTING SITE SWEEPING.
17. THE GENERAL CONTRACTOR SHALL IN ALL INSTANCES CONFORM TO THE SPECIFICATIONS ISSUED BY SPRINT.
18. PROVIDE CORE DRILLING AS NECESSARY FOR PENETRATIONS OR RISERS THROUGH THE BUILDING. DO NOT PENETRATE STRUCTURAL MEMBERS WITHOUT STRUCTURAL ENGINEER'S APPROVAL. SLEEVES AND/OR PENETRATIONS IN FIRE RATED CONSTRUCTION SHALL BE PACKED WITH FIRE RATED MATERIAL WHICH SHALL MAINTAIN THE FIRE RATING OF THE STRUCTURE. FILL FOR FLOOR PENETRATIONS SHALL PREVENT PASSAGE OF WATER, SMOKE FIRE AND FUMES. ALL MATERIAL SHALL BE UL APPROVED FOR THIS PURPOSE.

CONCRETE

CAST-IN-PLACE CONCRETE

PART 1 - GENERAL

1.01 DESCRIPTION

WORK INCLUDES CONSTRUCTION OF CAST-IN-PLACED CONCRETE FOUNDATIONS, INCLUDING FURNISHING AND INSTALLING READY-MIX CONCRETE, REINFORCING, FORMWORK, AND ACCESSORY MATERIALS AS SHOWN ON THE DRAWINGS. CAST-IN-PLACE CONCRETE INCLUDES ALL SITE CONCRETE, INCLUDING FOUNDATIONS, SLABS ON GRADE, EQUIPMENT PADS, AND GUARD POST FOUNDATIONS.

1.02 RELATED WORK

- A. COORDINATE UNDER SLAB CONDUITS
B. COORDINATE WITH GROUNDING

1.03 APPLICABLE STANDARDS

- A. ACI-301 - SPECIFICATIONS FOR STRUCTURAL CONCRETE BUILDINGS.
B. ACI 347 - GUIDE TO FORMWORK FOR CONCRETE.
C. ASTM C33 - CONCRETE AGGREGATES
D. ASTM C94 - READY-MIXED CONCRETE
E. ASTM C150 - PORTLAND CEMENT
F. ASTM C260 - AIR-ENTRAINING ADMIXTURES FOR CONCRETE.
G. ASTM C309 - LIQUID MEMBRANE FORMING COMPOUNDS FOR CURING CONCRETE.
H. ASTM C494 - CHEMICAL ADMIXTURES FOR CONCRETE.
I. ASTM A615 - DEFORMED STEEL BARS FOR CONCRETE REINFORCEMENT.
J. ASTM A185 - STEEL WELDED WIRE FABRIC FOR CONCRETE REINFORCEMENT

1.04 QUALITY ASSURANCE

CONCRETE MATERIALS AND OPERATIONS SHALL BE TESTED AND INSPECTED BY THE ENGINEER AS DIRECTED BY SPRINT.

1.05 TESTS

CONCRETE TESTS SHALL BE AS DETAILED BELOW OR AS DIRECTED BY SPRINT. CONCRETE MATERIALS AND OPERATIONS SHALL BE TESTED AND INSPECTED BY THE ENGINEER AS THE WORK PROGRESSES. FAILURE TO DETECT ANY DEFECTIVE WORK OR MATERIAL SHALL NOT IN ANY WAY PREVENT LATER REJECTION WHEN SUCH DEFECT IS DISCOVERED NOR SHALL IT OBLIGATE THE ENGINEER FOR FINAL ACCEPTANCE.

A. THREE CONCRETE TEST CYLINDERS SHALL BE TAKEN OF THE TOWER PIER FOUNDATION. ONE SHALL BE TESTED @ THREE DAYS, ONE @ TWENTY-EIGHT DAYS. THE THIRD CYLINDER SHALL BE KEPT SEPARATELY. (IF REQUIRED TO BE USED IN THE FUTURE.)

B. ONE SLUMP TEST SHALL BE TAKEN FOR EACH SET OF TEST CYLINDERS TAKEN. SLUMP SHALL NOT EXCEED 4" UNLESS OTHERWISE NOTED.

PART 2 - PRODUCT

2.01 CONCRETE MATERIALS

CONCRETE SHALL BE COMPOSED OF PORTLAND CEMENT, WATER, FINE AND COARSE AGGREGATES, AND ADMIXTURES AS SPECIFIED BELOW. ALL WELL MIXED AND BROUGHT TO PROPER CONSISTENCY, CLASS I, II, III, OR V.

A. CEMENT: CEMENT SHALL BE TYPE II, GRAY COLOR, LOW-ALKALI PORTLAND CEMENT CONFORMING TO ASTM C150.

B. FINE AND COARSE AGGREGATES: AGGREGATES FOR USE IN CONCRETE SHALL COMPLY WITH ASTM C33.

C. WATER: WATER FOR MIXING AND CURING CONCRETE SHALL BE FREE FROM SEWAGE, OIL, ACID, ALKALI, AND SALTS AND SHALL BE FREE FROM OBJECTIONABLE QUANTITIES OF SILT, ORGANIC MATTER, AND OTHER DELETERIOUS SUBSTANCES.

2.02 ADMIXTURES

A. CHEMICAL ADMIXTURE: ASTM C494, TYPE A - WATER REDUCING OR TYPE D - WATER REDUCING AND RETARDING.

2.03 CURING COMPOUND: ASTM C309, TYPE I, CLASS B; TRANSLUCENT.

2.04 ACCESSORIES

A. NONSHRINK GROUT: PREMIXED COMPOUND CONSISTING OF NONMETALLIC AGGREGATE, CEMENT, WATER REDUCING AND PLASTICIZING AGENTS; CAPABLE OF DEVELOPING MINIMUM COMPRESSIVE STRENGTH OF 7,000 PSI IN 28 DAYS.

B. JOINT FILLER: BITUMINOUS TYPE, ASTM D1751 OR NON-BITUMINOUS TYPE ASTM D1752.

C. ANCHOR BOLTS: ASTM A307. UNPRIMED.

2.05 CONCRETE MIX

A. CONCRETE SHALL BE PROPORTIONED PER REQUIREMENTS OF ACI 301 & SPRINT CONSTRUCTION SPECIFICATIONS FOR DESIGN STRENGTH & WORKABILITY. CONCRETE SHALL BE DELIVERED WITHIN 45 MINUTES OF ADDITION OF WATER TO MIX.

- B. THE FOLLOWING STRENGTHS SHALL BE USED:
1. FENCE POST FOUNDATIONS - DESIGN COMPRESSIVE STRENGTH AT 28 DAYS OF 3,000 PSI.
2. EQUIPMENT FOUNDATION - DESIGN COMPRESSIVE STRENGTH OF 3,000 PSI AT 28 DAYS UNLESS OTHERWISE NOTED. (CONTRACTOR FURNISH 4,000 PSI CONCRETE).
3. CONCRETE STRENGTH FOR MONOPILE OR TOWER FOUNDATION SHALL BE 1,000 PSI MORE THAN THE MANUFACTURER'S RECOMMENDATIONS, 4,000 PSI MINIMUM.

C. USE ACCELERATING ADMIXTURES IN COLD WEATHER AND RETARDING ADMIXTURES IN HOT WEATHER ONLY WHEN APPROVED BY THE ENGINEER.

D. TOTAL AIR CONTENT SHALL BE 5 PERCENT PLUS OR MINUS 1 PERCENT.

PART 3 - EXECUTION

3.01 INSPECTION

THE CONTRACTOR SHALL VERIFY ANCHORS, SEATS, PENETRATIONS, PLATES, REINFORCEMENT, AND OTHER ITEMS TO CAST INTO CONCRETE ARE ACCURATELY PLACED, HELD SECURELY, AND SHALL NOT CAUSE HARSHNESS IN PLACING CONCRETE.

3.02 PREPARATION

A. THE CONTRACTOR SHALL PREPARE PREVIOUSLY PLACED CONCRETE BY CLEANING WITH STEEL BRUSH AND APPLYING BONDING AGENT. APPLY BONDING AGENT IN ACCORDANCE WITH MANUFACTURER'S INSTRUCTIONS.

3.03 PLACING CONCRETE

A. THE ENGINEER SHALL BE NOTIFIED NOT LESS THAN 24 HOURS IN ADVANCE OF CONCRETE PLACEMENT. UNLESS INSPECTION IS WAIVED IN EACH CASE, PLACING OF CONCRETE SHALL BE PERFORMED ONLY IN THE PRESENCE OF THE ENGINEER.

CONCRETE SHALL NOT BE PLACED UNTIL ALL FORM WORK, EMBEDDED PARTS, STEEL REINFORCEMENT, FOUNDATION SURFACES, AND JOINTS INVOLVED IN THE PLACING HAVE BEEN APPROVED, AND UNTIL FACILITIES ACCEPTABLE TO THE SPRINT REPRESENTATIVE HAVE BEEN PROVIDED AND MADE READY FOR ACCOMPLISHMENT OF THE WORK AS SPECIFIED. CONCRETE MAY NOT BE ORDERED FOR PLACEMENT UNTIL ALL ITEMS HAVE BEEN APPROVED AND SPRINT HAS PERFORMED A FINAL INSPECTION AND GIVEN APPROVAL TO START PLACEMENT IN WRITING.

B. UNLESS SPECIFIED TO BE BEVELED, EXPOSED EDGES OF FLOATED OR TROWELED SURFACES SHALL BE EDGED WITH A TOOL HAVING A 1/4" CORNER RADIUS.

C. PLACEMENT OF CONCRETE SHALL BE IN ACCORDANCE WITH ACI 301.

D. THE CONTRACTOR SHALL ENSURE THAT REINFORCEMENT, INSERTS, EMBEDDED PARTS, FORMED JOINTS AND VAPOR BARRIERS ARE NOT DISTURBED DURING CONCRETE PLACEMENT.

E. THE FOLLOWING MINIMUM CONCRETE COVER SHALL BE PROVIDED FOR REINFORCING STEEL UNLESS SHOWN OTHERWISE ON DRAWINGS:

- CONCRETE CAST AGAINST EARTH.....3 IN.
CONCRETE EXPOSED TO EARTH OR WEATHER:
#6 AND LARGER.....2 IN.
#5 AND SMALLER & W/F.....1 1/2 IN.
CONCRETE NOT EXPOSED TO EARTH OR WEATHER OR NOT CAST AGAINST THE GROUND.
SLAB AND WALL.....3/4 IN.
BEAMS AND COLUMNS.....1 1/2 IN.

3.04 SURFACE FINISHES

A. SURFACES AGAINST WHICH BACK FILL OR CONCRETE SHALL BE PLACED REQUIRE NO TREATMENT EXCEPT REPAIR OF DEFECTIVE AREAS.

B. SURFACES THAT WILL BE PERMANENTLY EXPOSED SHALL PRESENT A UNIFORM FINISH PROVIDED BY THE REMOVAL OF FINES AND THE FILLING OF HOLES AND OTHER IRREGULARITIES WITH DRY PACK GROUT, OR BY SACKING WITH UTILITY OR ORDINARY GROUT.

C. SURFACES THAT WOULD NORMALLY BE LEVEL AND WHICH WILL BE PERMANENTLY EXPOSED TO THE WEATHER SHALL BE SLOPED FOR DRAINAGE. UNLESS ENGINEER'S DESIGN DRAWING SPECIFIES A HORIZONTAL SURFACE OR SHOWS THE SLOPE REQUIRED, THE TOPS OF NARROW SURFACES, SUCH AS STAIR TREADS, WALLS, CURBS, AND PARAPETS SHALL BE SLOPED APPROXIMATELY 3/8" /FT OF WIDTH. BROADER SURFACES SUCH AS WALKS, ROADS, PARKING AREAS AND PLATFORMS SHALL BE SLOPED APPROXIMATELY 1/4" /FT.

D. SURFACES THAT WILL BE COVERED BY BACKFILL OR CONCRETE SHALL BE SMOOTH SCREEDED.

E. EXPOSED SLAB SURFACES SHALL BE CONSOLIDATED, SCREEDED, FLOATED, AND "STEEL TROWELED." HAND OR POWER-DRIVEN EQUIPMENT MAY BE USED FOR FLOATINGS WHICH SHALL BE STARTED AS SOON AS THE SCREEDED SURFACE HAS ATTAINED A STIFFNESS TO PERMIT FINISHING OPERATIONS. ALL EDGES MUST HAVE A 3/4" CHAMFER. CONCRETE EXPANSION ANCHORS AND EPOXY ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S REQUIREMENTS, SPECIAL INSPECTIONS, REQUIRED BY GOVERNING CODES, SHALL BE PERFORMED IN ORDER TO MAINTAIN MANUFACTURER'S MAXIMUM ALLOWABLE LOADS. MANUFACTURER'S MINIMUM CONCRETE EDGE DISTANCE SHALL BE MAINTAINED DURING INSTALLATION.

3.05 PATCHING

THE CONTRACTOR SHALL NOTIFY THE ENGINEER IMMEDIATELY UPON REMOVAL OF THE FORMS TO OBSERVE CONCRETE SURFACE CONDITIONS. IMPERFECTIONS SHALL BE PATCHED ACCORDING TO THE ENGINEER'S DIRECTION.

3.06 DEFECTIVE CONCRETE

THE CONTRACTOR SHALL MODIFY OR REPLACE CONCRETE NOT CONFORMING TO REQUIRED LEVELS AND LINES, DETAILS, AND ELEVATIONS AS SPECIFIED IN ACI 301.

3.07 PROTECTION

A. IMMEDIATELY AFTER PLACEMENT, THE CONTRACTOR SHALL PROTECT THE CONCRETE FROM PREMATURE DRYING, EXCESSIVELY HOT OR COLD TEMPERATURES, AND MECHANICAL INJURY. FINISHED WORK SHALL BE PROTECTED.

B. CONCRETE SHALL BE MAINTAINED WITH MINIMAL MOISTURE LOSS AT RELATIVELY CONSTANT TEMPERATURE FOR PERIOD NECESSARY FOR HYDRATION OF CEMENT AND HARDENING OF CONCRETE.

C. ALL CONCRETE SHALL BE WATER CURED PER ACCEPTABLE PRACTICES SPECIFIED BY ACI CODE.

METALS

PART 1 - GENERAL

1.01 WORK INCLUDED

A. THE WORK CONSISTS OF THE FABRICATION AND INSTALLATION OF ALL MATERIALS TO BE FURNISHED, AND WITHOUT LIMITING THE GENERALITY THEREOF, INCLUDES ALL EQUIPMENT, LABOR AND SERVICES REQUIRED FOR ALL STRUCTURAL STEEL WORK, INCLUDING ALL ITEMS INCIDENTAL THERETO AS SPECIFIED HEREIN AND AS SHOWN ON THE DRAWINGS. INCLUDING:

- 1. STEEL FRAMING INCLUDING BEAMS, ANGLES, CHANNELS AND PLATES.
2. WELDING AND BOLTING OF ATTACHMENTS.

1.02 REFERENCE STANDARDS

A. THE WORK SHALL CONFORM TO THE CODES AND STANDARDS OF THE FOLLOWING AGENCIES AS FURTHER CITED HEREIN:

1. ASTM: AMERICAN SOCIETY FOR TESTING AND MATERIALS, AS PUBLISHED IN "COMPILATION OF ASTM STANDARDS IN BUILDING CODES"

2. AWS: AMERICAN WELDING SOCIETY INC., AS PUBLISHED IN "STANDARD D1.1-2006, STRUCTURAL WELDING CODE".

3. AISC: AMERICAN INSTITUTE FOR STEEL CONSTRUCTION, AS PUBLISHED IN "CODE FOR STANDARD PRACTICE FOR STEEL BUILDINGS AND BRIDGES"; "SPECIFICATIONS FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS".

4. EIA/TIA-222-G STRUCTURAL STANDARDS FOR STEEL ANTENNA SUPPORTING STRUCTURES.

PART 2 - STRUCTURAL NOTES
ALL STEEL WORK SHALL BE PAINTED OR GALVANIZED IN ACCORDANCE WITH THE DRAWINGS AND SPRINT SPECIFICATIONS UNLESS OTHERWISE NOTED. STRUCTURAL STEEL SHALL BE ASTM-992-50 UNLESS OTHERWISE NOTED ON THE SITE SPECIFIC DRAWINGS. STEEL DESIGN, INSTALLATION AND BOLTING SHALL BE IN ACCORDANCE WITH THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION (AISC) "MANUAL OF STEEL CONSTRUCTION", MISC. STEEL TO BE A36.

1. DESIGN REQUIREMENTS ARE PER STATE BUILDING CODE AND APPLICABLE SUPPLEMENTS, ANSI/TIA-222-G STRUCTURAL STANDARDS FOR STEEL ANTENNA SUPPORTING STRUCTURES.

2. CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS IN THE FIELD PRIOR TO FABRICATION AND ERECTION OF ANY MATERIAL. ANY UNUSUAL CONDITIONS SHALL BE REPORTED TO THE ATTENTION OF THE CONSTRUCTION MANAGER AND ENGINEER OF RECORD.

3. DESIGN AND CONSTRUCTION OF STRUCTURAL STEEL SHALL CONFORM TO THE AMERICAN INSTITUTE OF STEEL CONSTRUCTION "SPECIFICATION FOR THE DESIGN, FABRICATION AND ERECTION OF STRUCTURAL STEEL FOR BUILDINGS".

4. STEEL PIPE SHALL CONFORM TO ASTM A500 "COLD-FORMED WELDED & SEAMLESS CARBON STEEL STRUCTURAL TUBING", GRADE A, OR ASTM A53 PIPE STEEL BLACK AND HOT-DIPPED ZINC-COATED WELDED AND SEAMLESS TYPE E OR S, GRADE B. PIPE SIZES INDICATED ARE NOMINAL. ACTUAL OUTSIDE DIAMETER IS LARGER.

5. STRUCTURAL CONNECTION BOLTS SHALL BE HIGH STRENGTH BOLTS (BEARING TYPE) AND CONFORM TO ASTM A325 "HIGH STRENGTH BOLTS FOR STRUCTURAL JOINTS, INCLUDING SUITABLE NUTS AND PLAIN HARDENED WASHERS". UNLESS OTHERWISE NOTED, ALL BOLTS SHALL BE 5/8" DIA TYPE X.

6. ALL STEEL MATERIALS SHALL BE GALVANIZED AFTER FABRICATION - IN ACCORDANCE WITH ASTM A123 "ZINC (HOT-DIP GALVANIZED) COATINGS ON IRON AND STEEL PRODUCTS", UNLESS OTHERWISE NOTED.

7. ALL BOLTS, ANCHORS AND MISCELLANEOUS HARDWARE SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM A153 "ZINC-COATING (HOT-DIP) ON IRON AND STEEL HARDWARE", UNLESS OTHERWISE NOTED.

8. FIELD WELDS, DRILL HOLES, SAW CUTS AND ALL DAMAGED GALVANIZED SURFACES SHALL BE REPAIRED WITH AN ORGANIC ZINC REPAIR PAINT COMPLYING WITH REQUIREMENTS OF ASTM A780. GALVANIZING REPAIR PAINT SHALL HAVE 65 PERCENT ZINC BY WEIGHT, ZIRP BY DUNCAN GALVANIZING, GALVA BRIGHT PREMIUM BY CROWN OR EQUAL THICKNESS OF APPLIED GALVANIZING REPAIR PAINT SHALL BE NOT LESS THAN 4 COATS (ALLOW TIME TO DRY BETWEEN COATS) WITH A RESULTING COATING THICKNESS REQUIRED BY ASTM A123 OR A153 AS APPLICABLE.

9. CONTRACTOR SHALL COMPLY WITH AWS CODE FOR PROCEDURES, APPEARANCE AND QUALITY OF WELDS, AND FOR METHODS USED IN CORRECTING WELDING. ALL WELDERS AND WELDING PROCESSES SHALL BE QUALIFIED IN ACCORDANCE WITH AWS "STANDARD QUALIFICATION PROCEDURES". ALL WELDING SHALL BE DONE USING E70XX ELECTRODES AND WELDING SHALL CONFORM TO AISC AND D11 WHERE FILLET WELD SIZES ARE NOT SHOWN, PROVIDE THE MINIMUM SIZE PER TABLE J2.4 IN THE AISC "MANUAL OF STEEL CONSTRUCTION", 13TH EDITION.

10. INCORRECTLY FABRICATED, DAMAGED OR OTHERWISE MISFITTING OR NONCONFORMING MATERIALS OR CONDITIONS SHALL BE REPORTED TO THE CONSTRUCTION MANAGER PRIOR TO REMEDIAL OR CORRECTIVE ACTION. ANY SUCH ACTION SHALL REQUIRE CONSTRUCTION MANAGER APPROVAL.

11. UNISTRUTS SHALL BE FORMED STEEL CHANNEL STRUT FRAMING AS MANUFACTURED BY UNISTRUT CORP, WAYNE, MI OR EQUAL. STRUT MEMBERS SHALL BE 1 5/8"x1 5/8"x12GA. UNLESS OTHERWISE NOTED, AND SHALL BE HOT-DIP GALVANIZED AFTER FABRICATION FOR EXTERNAL USE APPLICATIONS.

12. UNLESS OTHERWISE NOTED, EPOXY ANCHOR ASSEMBLY SHALL CONSIST OF 1/2" DIAMETER STAINLESS STEEL ANCHOR ROD WITH NUTS & WASHERS, AN INTERNALLY THREADED INSERT, A SCREEN TUBE AND A EPOXY ADHESIVE. THE ANCHORING SYSTEM SHALL BE THE HILTI-HIT HY-20 AND OR HY-150 SYSTEMS (AS SPECIFIED ON DWG.) OR ENGINEERS APPROVED EQUAL WITH 4-1/4" MIN. EMBEDMENT DEPTH.

13. UNLESS OTHERWISE NOTED, EXPANSION BOLTS SHALL CONFORM TO FEDERAL SPECIFICATION FF-S-325, GROUP II, TYPE 4, CLASS I, HILTI KWIK BOLT II OR APPROVED EQUAL. INSTALLATION SHALL BE IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. MINIMUM EMBEDMENT SHALL BE THREE AND ONE HALF (3 1/2) INCHES.

14. WHERE ROOF PENETRATIONS ARE REQUIRED, THE CONTRACTOR SHALL CONTACT AND COORDINATE RELATED WORK WITH THE BUILDING OWNER AND THE EXISTING ROOF INSTALLER. WORK SHALL BE PERFORMED IN SUCH A MANNER AS TO NOT VOID THE EXISTING ROOF WARRANTY.

WOOD

- 1. PLYWOOD SHALL MEET THE RECOMMENDATIONS OF THE A.P.A.
2. ALL LUMBER SHALL BE SPRUCE-PINE-FIR (SPF) #1 GRADE.
3. ALL LUMBER SHALL BE PRESSURE TREATED WITH PRESERVATIVES. ALLOWABLE BENDING STRESS: fb min = 1,000 PSI; MODULUS OF ELASTICITY: 1.6x10^6 PSI

- 4. ALL JOIST HANGERS, CLIP ANGLES AND PLATES TO BE HEAVY GALVANIZED AS MANUFACTURED BY SIMPSON CO, OR APPROVED EQUAL.
5. ALL LVL'S TO BE MANUFACTURED BY BOSIE CASCADE OR APPROVED EQUAL.

SPECIAL CONSTRUCTION ANTENNA INSTALLATION

PART 1 - GENERAL

1.01 WORK INCLUDED

A. ANTENNAS AND COAXIAL CABLES SHALL BE AS SPECIFIED ON THESE DRAWINGS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF PERSONNEL AND PROPERTY. STRICT ADHERENCE TO OSHA STANDARDS IS MANDATED.

B. INSTALL ANTENNAS AS INDICATED ON DRAWINGS AND SPRINT SPECIFICATIONS.

C. INSTALL GALVANIZED STEEL ANTENNA MOUNTS AS INDICATED ON DRAWINGS.

D. INSTALL COAXIAL CABLES AND TERMINATIONS BETWEEN ANTENNAS AND EQUIPMENT PER MANUFACTURER'S RECOMMENDATIONS. WEATHERPROOF ALL CONNECTORS BETWEEN THE ANTENNA AND EQUIPMENT PER MANUFACTURER'S REQUIREMENTS. TERMINATE ALL COAXIAL CABLE THREE (3) FEET IN EXCESS OF ENTRY PORT LOCATION UNLESS OTHERWISE STATED.

E. ANTENNA MOUNTS AND HARDWARE SHALL BE PAINTED TO MATCH EXISTING CONDITIONS.

F. ANTENNA AND COAXIAL CABLE GROUNDING:
1. ALL EXTERIOR #6 GREEN GROUND WIRE "DAISY CHAIN" CONNECTIONS ARE TO BE WEATHER SEALED.
2. ALL COAXIAL CABLE GROUNDING KITS ARE TO BE INSTALLED ON STRAIGHT RUNS OF COAXIAL CABLE (NOT WITHIN BENDS).

ROOF WORK

1. IF ROOF WORK IS REQUIRED, CAUTION SHALL BE EXERCISED WHILE WORKING ON THE ROOF. EVERY EFFORT MUST BE MADE TO PRESERVE THE ROOF WARRANTY.

2. WHEN ROOF PENETRATIONS ARE REQUIRED, THE CONTRACTOR SHALL CONTACT AND COORDINATE THE WORK WITH THE BUILDING OWNER AND THE EXISTING ROOFING INSTALLER.

RELATED WORK (ROOF TOP SITES)

FURNISHED THE FOLLOWING WORK AS SPECIFIED UNDER CONSTRUCTION DOCUMENTS, BUT COORDINATE WITH OTHER TRADES PRIOR TO BID:

- 1. FLASHING OF OPENING INTO OUTSIDE WALLS
2. SEALING AND CAULKING ALL OPENINGS
3. PAINTING
4. CUTTING AND PATCHING



1.03 REQUIREMENTS OR REGULATOR AGENCIES

A. FURNISH U.L. LISTED EQUIPMENT WHERE SUCH LABEL IS AVAILABLE. INSTALL IN CONFORMANCE WITH U.L. STANDARDS WHERE APPLICABLE.

B. INSTALL ANTENNA, ANTENNA CABLES, GROUNDING SYSTEM IN ACCORDANCE WITH DRAWINGS AND SPECIFICATION IN EFFECT AT PROJECT LOCATION AND RECOMMENDATIONS OF STATE AND LOCAL BUILDING CODES, AND SPECIAL CODES HAVING JURISDICTION OVER SPECIFIC PORTIONS OF WORK. THIS WORK INCLUDES BUT IS NOT LIMITED TO THE FOLLOWING:

- 1. EIA/TIA - ELECTRONIC INDUSTRIES ASSOCIATION RS - 222. STRUCTURAL STANDARDS FOR STEEL ANTENNA TOWERS AND ANTENNA SUPPORTING STRUCTURES.
2. FAA - FEDERAL AVIATION ADMINISTRATION ADVISORY CIRCULAR AC 70/7460-H, OBSTRUCTION MARKING AND LIGHTING.
3. FCC - FEDERAL COMMUNICATIONS COMMISSION RULES AND REGULATIONS FORM 715, OBSTRUCTION MARKING AND LIGHTING SPECIFICATION FOR ANTENNA STRUCTURES AND FORM 715A, HIGH INTENSITY OBSTRUCTION LIGHTING SPECIFICATIONS FOR ANTENNA STRUCTURES.
4. NEC - NATIONAL ELECTRICAL CODE
5. UL - UNDERWRITER'S LABORATORIES APPROVED ELECTRICAL PRODUCTS.
6. IN ALL CASES, PART 77 OF THE FAA RULES AND PARTS 17 AND 22 OF THE FCC RULES ARE APPLICABLE AND IN THE EVENT OF CONFLICT, SUPERSEDE ANY OTHER STANDARDS OR SPECIFICATIONS.

IF ASSUMED EXISTING CONDITION DIFFERS, ENGINEER MUST BE INFORMED OF ACTUAL FIELD CONDITION. SUBCONTRACTOR TO VERIFY EXISTING DIMENSIONS PRIOR TO STEEL FABRICATION.

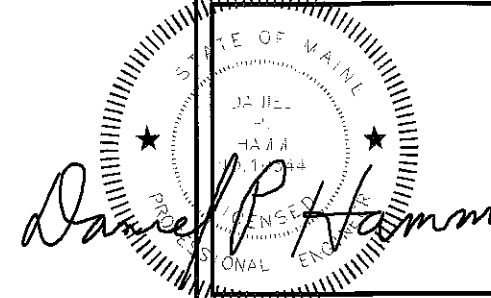

CHECKED BY: JX

APPROVED BY: DPH

Table with 4 columns: REV, DATE, DESCRIPTION, BY. Row 1: 2, 07/31/13, FOR CONSTRUCTION, SF. Row 2: 1, 03/04/13, ISSUED FOR REVIEW, SF.

SITE NUMBER: NM03XC068
SITE NAME: PORTLAND NORTH
SITE ADDRESS: 527 PRESUMPSCOT STREET, PORTLAND, ME 04103

SHEET TITLE: GENERAL NOTES

SHEET NUMBER: GN-1