





TYP CONTROL JOINT IN WALL

N.T.S.

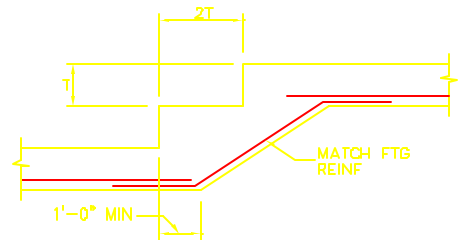


TYP STEP FOOTING DETAIL

N.T.S.  
NOTE: T = FOOTING THICKNESS

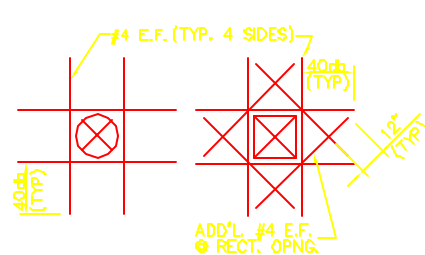


TYP. OPENING IN WALL OR SLAB

N.T.S.  
NOTE: OPENING IN SLAB APPLIES @ ALL OPENINGS

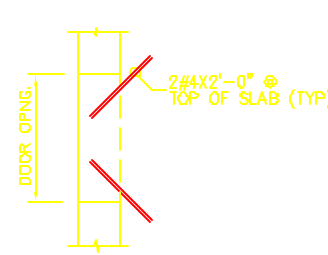


TYP. SLAB CORNER DETAIL @ DOOR

N.T.S.  
NOTE: PROVIDE 2#4x4'-0" (TOP) IN SLAB AT INSIDE CORNERS. SEE PLAN. INCLUDING STAIRS, & HVAC OPENINGS. PLACE REINF IN MIDDLE OF SLAB @ SLAB OPENINGS.

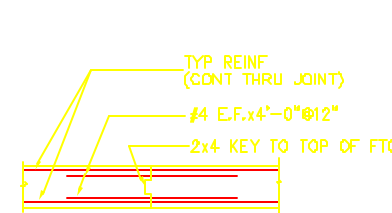


TYP. CONSTRUCTION JOINT IN WALL

N.T.S.  
NOTES:  
1. CONST JOINT DOES NOT EXTEND THRU FTG  
2. DISTANCE BETWEEN CONST JOINTS IN STRAIGHT LENGTHS OF WALL NOT TO EXCEED 60'-0"

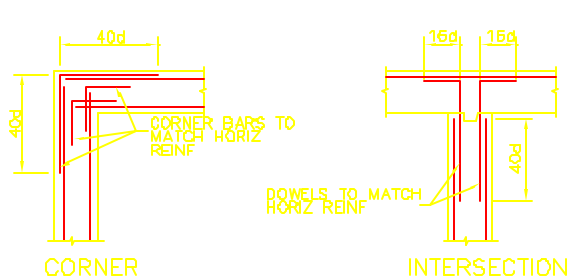

TYP WALL REINF DETAILS

N.T.S.

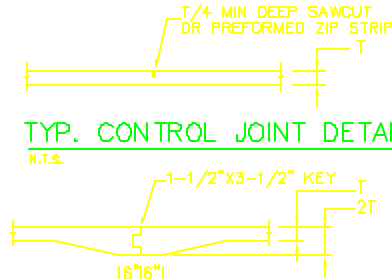


TYP. CONTROL JOINT DETAIL

N.T.S.


TYP. CONSTRUCTION JOINT DETAIL

N.T.S.

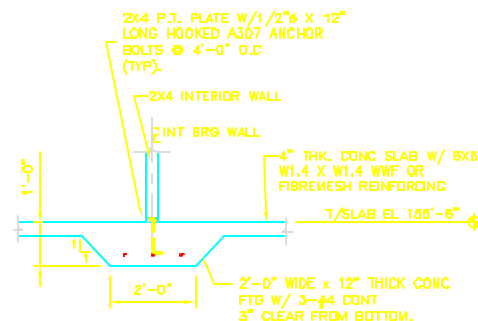


SECTION TYPICAL THICKENED SLAB

1/2" = 1'-0" 1/32

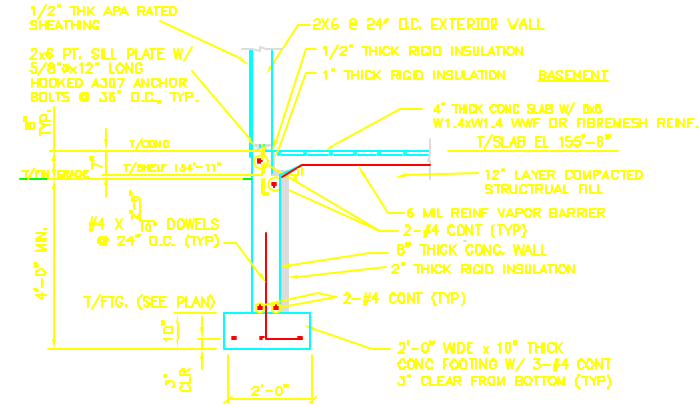


SECTION TYPICAL EXTERIOR FROST WALL

1/2" = 1'-0" 1/32

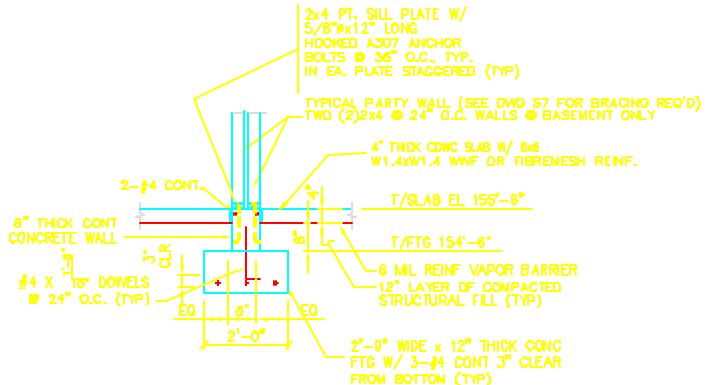


SECTION TYPICAL PARTY WALL

1/2" = 1'-0" 1/32

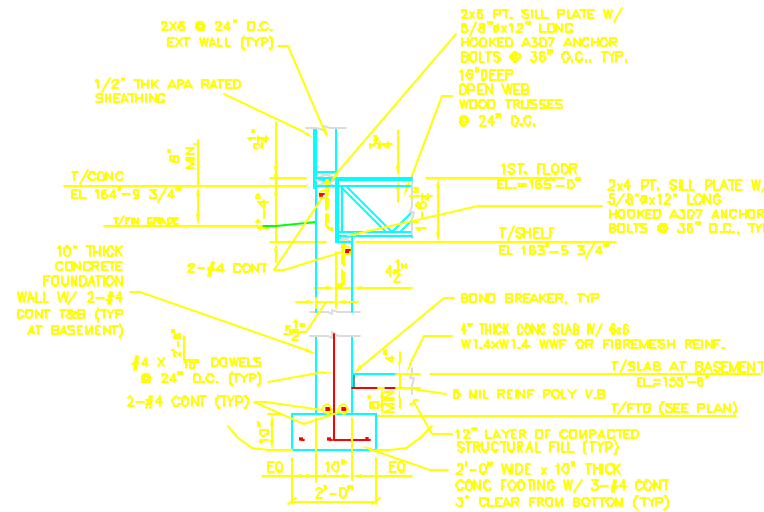

SECTION TYPICAL BASEMENT WALL AT FLOOR TRUSS BEARING

1/2" = 1'-0" 1/32

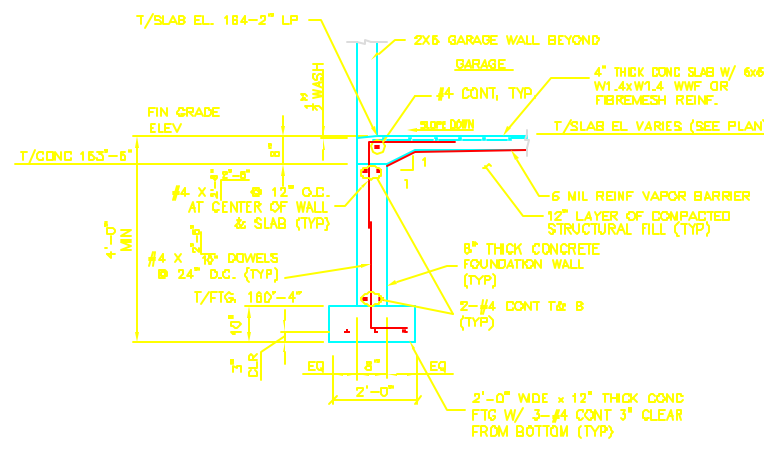

SECTION TYPICAL GARAGE ENTRY SLAB

1/2" = 1'-0" 1/32

CONSTRUCTION OF CONCRETE WALLS AND FOOTINGS SHALL BE IN ACCORDANCE WITH THE 2015 INTERNATIONAL BUILDING CODE (IBC) AND THE 2015 INTERNATIONAL RESIDENTIAL CODE (IRC). ALL REINFORCEMENT SHALL BE INSTALLED AND TIED AS SHOWN. ALL REINFORCEMENT SHALL BE PROTECTED WITH A MINIMUM OF 2" OF CONCRETE COVER.

**L & L STRUCTURAL ENGINEERING SERVICES, INC.**  
SIX Q STREET  
SOUTH PORTLAND, MAINE 04106  
PHONE: (207) 767-4830  
FAX: (207) 761-5432  
EMAIL: llengineering@verizon.net

**OCEAN RIDGE CONDOMINIUMS**  
852 OCEAN AVENUE  
PORTLAND, MAINE  
FOUNDATION DETAILS  
UNITS 44, 45 & 46

**S3**