

GENERAL STRUCTURAL NOTES

16-0062.1  
Grime Studios  
Portland, ME.

DESIGN LIVE LOADS: 2009 IBC, MUEBC  
Floor 50 psf

LIGHT GAUGE STRUCTURAL STEEL FRAMING:

- Member forming shall conform to AISI Cold-Formed Steel Specifications.
- All structural framing (studs, joists, track, runners, bracing, and bridging) shall be galvanized sheet steel conforming to ASTM A525, G-60.
- Studs and joists 54 mils (16 gauge) and heavier shall be 50 ksi yield.
- 43 mils (18 gauge) and lighter shall be, 33 ksi yield.
- Subcontractor shall provide bridging and blocking at a maximum of 6 foot spacing or as required for stability and stiffness of the final assembly wherever sheathing does not provide adequate bracing.
- Supplier shall design required lintels and headers at openings where not specifically detailed.
- Member sizes noted on drawings are in the new SSMA standard nomenclature:  
(##d)(sd)(##w)-(##t)  
(##d) Member Depth (inches.hundredths)  
(sd) Style Designation (see Style Designation in table below)  
(##w) Flange Width (inches.hundredths)  
(##t) Material Thickness (mils) (see Mils vs equivalent Gauge in table below)

(sd) Style Designation	Member Type	(##t) Thickness	Mils	Equivalent Gauge
S	Punched C-Section	18	25	
T	Unpunched C-Section	27	22	
T	Track	30	20	Drywall
U	Channel	33	20	Structural
F	Furring Channel	43	18	
		54	16	
		68	14	
		97	12	

CONCRETE AND REINFORCEMENT:

- Concrete shall conform to applicable provisions of ACI-301 and 318.
- Minimum 28 day compressive strength (F'c) as follows:
  - Interior Slabs: 4,000 psi w/ W.W.F. per plans
- Cement Type: 1/II
- Deformed reinforcement: ASTM A615 grade 60, except bars specified to be field\_bent, stirrups, and ties which shall be grade 40.
- Fibermesh: 100% virgin polypropylene, fibrillated fibers as manufactured by Fibermesh Co. per ASTM C-1116 type 111 4.1.3 and ASTM C-1116 performance level one, 1.5 lb. per cubic yard.
- Welded Wire Fabric (WWF): ASTM A185. See also plan.
- Typical minimum foundation reinforcing: 2 #5 top and bottom, (except as noted) continuous at corners and steps.
- Reinforcement shall be fabricated and placed per ACI Manual of Standard Practice (ACI-315). At splices, lap bars 50 diameters unless noted otherwise.
- Minimum 2 #5 around all four sides of all openings, extend min. 2'\_0 beyond openings.
- Concrete cover over reinforcing: 11/2" for concrete placed against forms; 3" for concrete placed against earth. See also drawings.
- In continuous members, splice top bars at mid span and bottom bars over supports.
- Keep reinforcement clean and free of dirt, oil, and scale. Oil forms prior to placing reinforcement.

STRUCTURAL STEEL:

- Angles, misc.: ASTM A36
- Anchor Bolts: ASTM A307 or A36.
- Expansion Anchors shall be NER approved, installed in accordance with manufacturers specifications.
- In concrete: Wedge Type
- In solid masonry: Sleeve Type
- Non-shrink grout beneath column base and beam bearing plates shall be non-metallic with minimum compressive strength 5000psi.
- All structural steel shall be fabricated and erected per the current edition of AISC Steel Construction Manual.
- Welding by qualified welders. E70XX electrodes.
- Except as noted, framed beam connections shall be detailed to develop 0.6 x Allowable Uniform Load values tabulated in the 9th Edition AISC Manual, Pp. 2-27 and following.
- All beams shall have fitted web stiffeners welded to each side of webs above and below columns. (3/4" plate or as noted)
- Attach wood nailer plates to beams with 1/2" diameter machine or carriage bolts at maximum 32" o.c., or 3/8" diameter bolts at 32" with glued contact face, or 5/32" diameter powder actuated drive pins at 24" o.c., U.O.N.

STRUCTURAL ERECTION AND BRACING REQUIREMENTS

- The structural drawings illustrate the completed structure with all elements in their final positions, properly supported and braced. The contractor, in the proper sequence, shall provide proper shoring and bracing as may be required to achieve the final completed structure.
- These plans have been engineered for construction at one specific building site. Builder assumes ALL responsibility for use of these plans at Any Other building site. Plans shall not be used for construction at any other building site without specific review by the engineer.
- Observations of foundation reinforcing or framing required by the owner, lender, insurer, building department or any other party will be accomplished by the engineer at the owner's expense. At least 24 hours advance notice is requested.
- All slabs on grade shall be separated from adjacent structural and finish elements to allow free movement of the slab, unless specifically shown and noted otherwise.

SHOP DRAWINGS:

- Construction Documents are copyrighted and shall not be copied for use as erection plans or shop details.
- Use of SI Inc.'s electronic files as base for shop drawings requires prior approval by SI Inc,
- signed release of liability by subcontractor,
- payment of an administration fee of \$100 per drawing sheet to SI Inc, and
- deletion of SI Inc's name and Logo from all sheets so used.
- The General Contractor and his subcontractors shall submit in writing any requests to modify the plans or specifications.
- All shop and erection drawings shall be checked and stamped by the General Contractor prior to submission for Engineer's review.
- Unchecked submittals will be returned without review.
- Furnish one (1) reproducible and two (2) prints of shop and erection drawings to the Structural Engineer for review prior to fabrication for
- Submit in a timely manner to permit ten (10) working days for review.
- Shop drawings submitted for review do not constitute "in writing"
- unless specific suggested changes are clearly marked.
- In any event, such changes by means of the shop drawing submittal process become the responsibility of the one initiating such change.

FIELD VERIFICATION OF EXISTING CONDITIONS:


- Contractor shall thoroughly inspect and survey existing structure to verify conditions that affect the work shown on the drawings.
- Contractor shall report any variations or discrepancies to the Architect for review.

ABBREVIATIONS KEY

AB	Anchor Rod (Bolt)	EF	Each Face	MACH	Machine	SC	Slip Critical
ADDL	Additional	EJ	Expansion Joint	MASY	Masonry	SCH	Schedule
ADJ	Adjustable	ELEV	Elevation	MATL	Material	SDST	Self Drilling Self Tapping
APF	Above Finished Floor	ELEC	Electric (Electrical)	MAX	Maximum	SECT	Section
ALT	Alternate	ENGR	Engineer	MB	Machine bolt	SF	Square Feet
AMT	Amount	EQ	Equal	MECH	Mechanical	SHT	Sheet
ANCH	Anchor, Anchorage	EQUIP	Equipment	MEZZ	Mezzanine	SHTG	Sheathing
APPROX	Approximate	EQUIV	Equivalent	MFR	Manufacture, -er, -ed	SIM	Similar
ARCH	Architect, -ural	ES	Each Side	MIN	Minimum	SLH	Short Leg Horizontal
ATR	All Thread Rod	EST	Estimate	ML	Microllam (Trus-joist brand LVL)	SLV	Short Leg Vertical
AVG	Average	E-W	East to West	MO	Masonry Opening	SOG	Slab on Grade
BC	Bottom of Concrete	EXC	Excavate	MTL	Metal	SP	Spaces
BL	Brick Ledge	EXP	Expansion	NF	Near Face	SPEC	Specifications
BLK	Block	EXT	Exterior	NIC	Not In Contract	SQ	Square
BLKG	Blocking	FND	Foundation	NS	Near Side	ST	Snug Tight
BM	Beam	FF	Far Face, Finished Floor	N-S	North to South	STD	Standard
BOT	Bottom	F-F	Face to Face	NTS	Not to Scale	STIFF	Stiffener
BRG	Bearing	FIG	Figure	OCJ	OSHA Column Joist	STL	Steel
BW	Bottom of Wall	FL	Flush	OD	Outside Diameter	STRUCT	Structure, -al
CB	Counterbore	FLG	Flange	OF	Outside Face	SUPT	Support
CF	Cubic Foot	FLR	Floor	OH	Opposite Hand	SY	Square Yard
CG	Center of Gravity	FO	Face of	OPP	Opposite	SYM	Symmetrical
CIP	Cast in Place	FP	Full Penetration	OSB	Oriented Strand Board	T&B	Top and Bottom
CJ	Construction Joint (Control Joint)	FS	Far Side	PAF	Powder Actuated Fast'n	T&G	Tongue and Groove
CLG	Ceiling	FTG	Footing	PC	Precast	TB	Top of Beam
CLR	Clear	GA	Gage (Gauge)	PCF	Pounds Per Cubic Foot	TC	Top of Concrete
CM	Construction Manager (Management)	GALV	Galvanized	PEN	Penetration	TD	Top of Deck
CMU	Concrete Masonry Unit	GC	General Contractor	PERP	Perpendicular	THD	Thread
COL	Column	GEN	General	PL	Property Line	THK	Thick, -ness
COM	Common	GL	Glue laminated (Glulam)	PLF	Pounds per Linear Foot	TJ	Top of Joist
COMB	Combination	GND	Ground	PNL	Panel	TL	Total Load
CONC	Concrete	GR	Grade	PP	Panel Point	TPG	Topping
CONN	Connection	GT	Girder Truss	PS	Prestressed	TRANS	Transverse
CONT	Continue (Continuous)	GYP BD	Gypsum Board	PSF	Pounds per Square Foot	TW	Top of Wall
COORD	Coordinate, -tion	HAS	Headed Anchor Stud	PSI	Pounds per Square Inch	TYP	Typical
CS	Countersink	HORIZ	Horizontal	PT	Post Tensioned	ULT	Ultimate
CTR	Center	HT	Height	PT (1)	Post Tensioned (generic term)	UNO	Unless Noted Otherwise
CY	Cubic Yard	ID	Inside Diameter	PT (2)	Pressure Treated	VERT	Vertical
DAB	Deformed Anchor Bar	IF	Inside Face	PTN	Partition	VIF	Verify in Field
DET	Detail	INT	Interior (Intermediate)	PWD	Plywood	WA	Wedge Anchor
DEV	Develop	JB	Joist Bearing	QTY	Quantity	WP	Work Point
DIAG	Diagonal	JST	Joist	R	Radius	WT	Weight
DIM	Dimension	JT	Joint	RE	Reference (refer to)	WWF	Welded Wire Fabric
DL	Dead Load	K	Kip (1,000 lbs.)	RECT	Rectangle	XS	Extra Strong
DN	Down	LD	Load	REFCT	Reinforce, -ed, -ing	XSECT	Cross-section
DP	Drilled Pier	LL	Live Load	REQ	Required	XXXS	Double Extra Strong
DT	Double Tee	LLH	Long Leg Horizontal	REQMT	Requirement		
DWG	Drawing	LLV	Long Leg Vertical	RET	Retaining	(E)	Existing
DWL	Dowel	LOC	Location			(N)	New
EA	Each	LSL	Laminated Strand Lumber (generic term)			(R)	Remove
ECC	Eccentric	LT	Light				
E-E	End to End	LVL	Laminated Veneer Lumber (generic term)				
				RM	Room		
				RMO	Rough Masonry Opening		
				RO	Rough Opening		

Structural Drawing Index

S1.0	General Notes, Etc.
S1.1	Framing Plan
S2.1	Sections

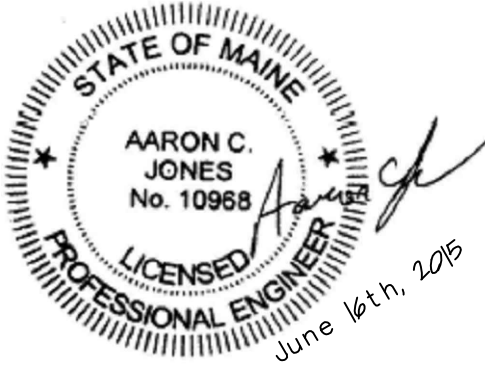

**Structural Integrity**  
Consulting Engineers, Inc.  
77 Oak Street  
Portland, ME, 04101  
p. 207-774-4614  
f. 866-793-7835  
www.structuralinteg.com  
BUILD WITH CONFIDENCE  
© 2012 Structural Integrity Consulting Engineers, Inc.

SI # 15-0062.1

© 2015 RYAN SENATORE  
ARCHITECTURE

GRIME STUDIOS  
PORTLAND, MAINE

**RSA**  
RYAN SENATORE  
ARCHITECTURE  
505 CONGRESS STREET  
PORTLAND, MAINE 04101  
207-650-6414  
senatorearchitecture.com

CONSULTANTS:  
**STRUCTURAL:**  
Structural Integrity  
77 Oak Street  
Portland, ME 04101  
207-774-4614

REVISIONS:

DATE: 04-21-15

PROJECT No.

DRAWN BY: WMc

CHECKED BY: ACJ

SCALE: AS NOTED

SHEET TITLE:  
STRUCTURAL  
GENERAL NOTES  
/ ETC.

S1.0