


DATE: 06/14/2016
 TIME: 14:50
 TESTED BY: JK
 SERV REQ #: 160102
 A-SPAS WO #: 906877
 HY-TEST WO#: 906926

Contact Name: Alan Small
 Company: Sprinkler Systems, Inc.
 Tel: (207) 689-9928
 Email: alan@sprinklersystemsinc.com

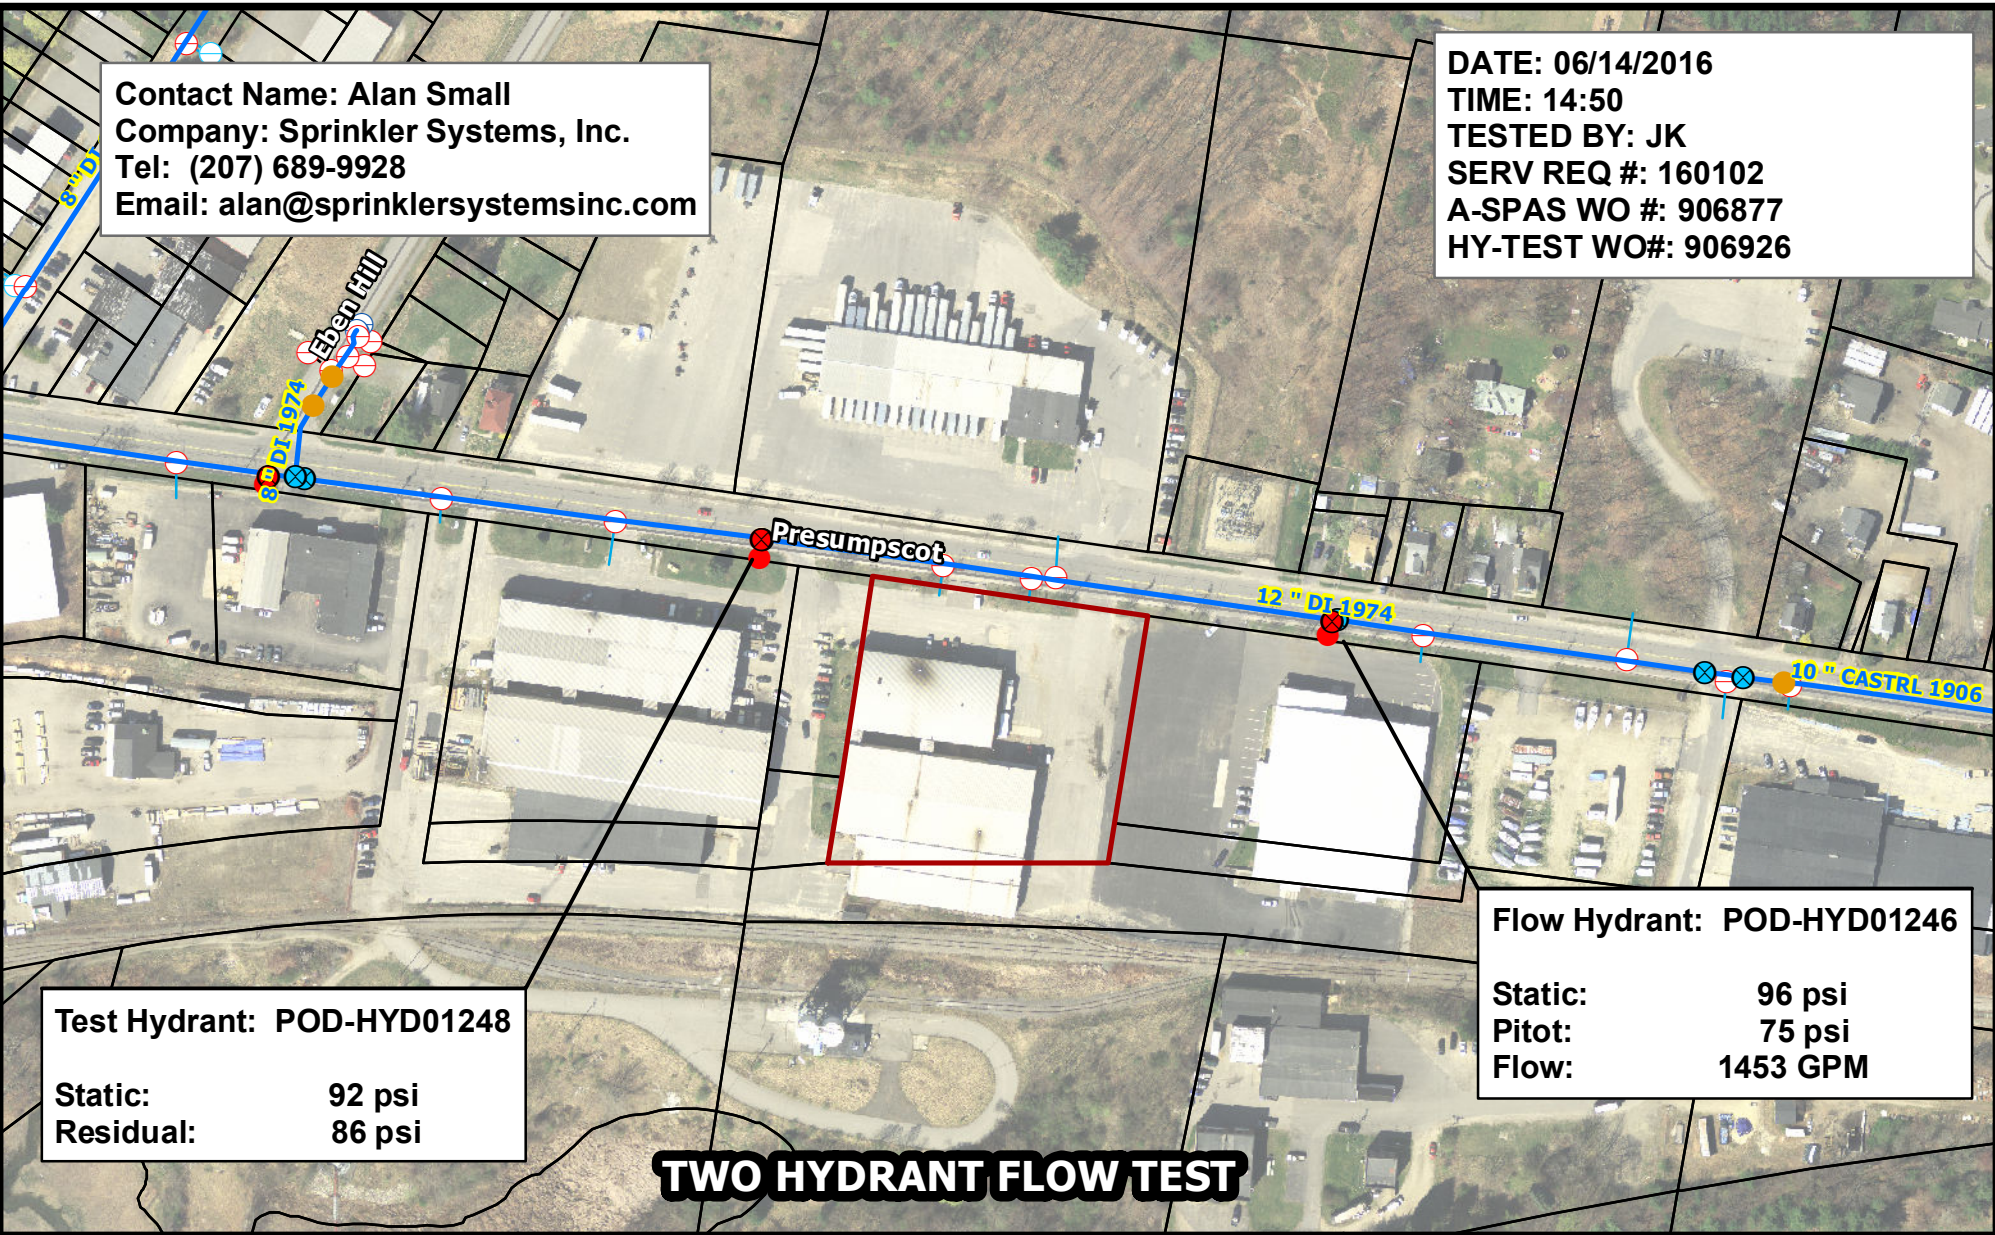


Test Hydrant: POD-HYD01248
 Static: 92 psi
 Residual: 86 psi

Flow Hydrant: POD-HYD01246
 Static: 96 psi
 Pitot: 75 psi
 Flow: 1453 GPM

TWO HYDRANT FLOW TEST

235 Presumpscot Street
 Portland



Disclaimer: This map is suitable for preliminary study and analysis and is based on PWD record information. PWD is not liable for any damages whatsoever resulting from inaccurate data or from errors made in the location and marking of its infrastructure.



PORTLAND WATER DISTRICT
 225 Douglass Street
 PO Box 3553
 Portland, ME 04104
 Telephone: (207) 774-5961
 Fax: (207) 761-8307

Legend			
● Air Valve	● Connection	⊕ Combined Service	● Manhole
⊕ Blow Off	● Attribute Change	⊕ Domestic Service	● CSO
⊕ By Pass	▲ Reducer	⊕ Fire Service	→ Gravity
⊕ Distribution	● Hydrant	● Private Hydrants	→ Force
⊕ Transmission	● Hydrant Control	⊕ Meter Pits	

Drawn By: HAS

Prepared for: Alan Small
 Sprinkler Systems, Inc.

Date: June 14, 2016