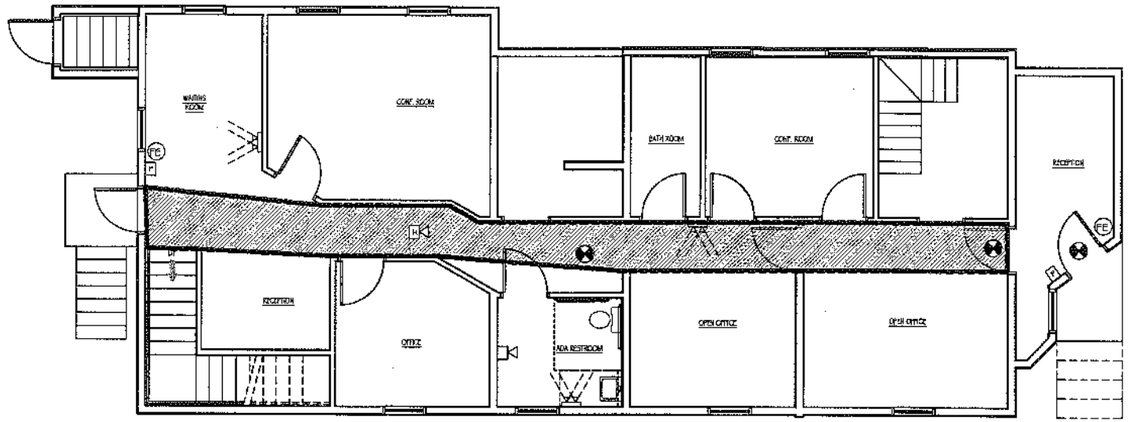

FIRST FLOOR PLAN
SCALE: 1/4"= 1'-0"

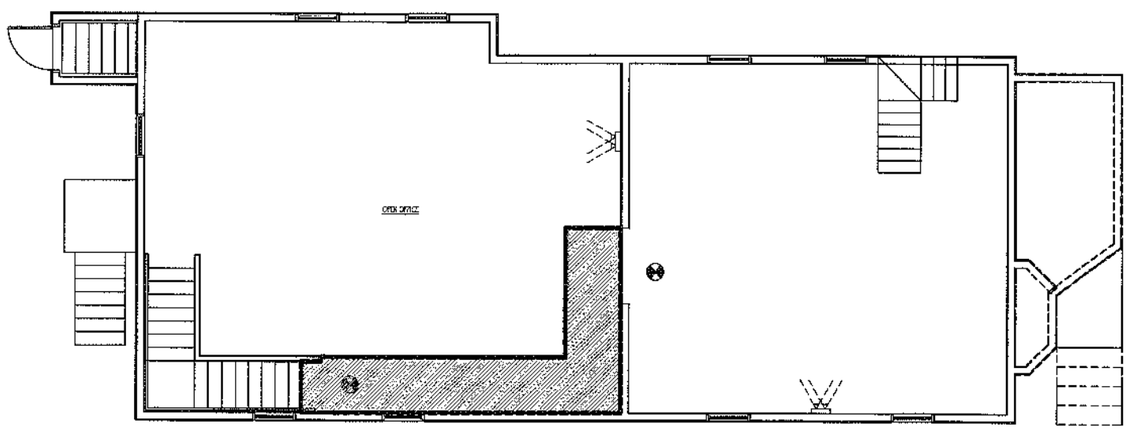

SECOND FLOOR PLAN
SCALE: 1/4"= 1'-0"

EGRESS PATH TO BE KEPT CLEAR

FIRE EXTINGUISHER (CLASS "ABC")

EXIT SIGN

EMERGENCY LIGHT PACK

PULL STATION

HORN STROBE

STROBE

EXIT DOOR TAG

W1 2 Hour rated, 2x6 studs @ 16" O.C. w/ (2) layers Type 'X' GWB each side. Minimum STC rating 55. Rated walls must extend to underside of structure. Rated stair wall and shaft walls must be continuous.

W2 Non rated, 2x6 studs @ 16" O.C. w/ (1) layer GWB each side.

W3 2 Hour rated, 2x4 studs @ 16" O.C. w/ (2) layers Type 'X' GWB each side. Minimum STC rating 55. Rated walls must extend to underside of structure. Rated stair wall and shaft walls must be continuous.

W4 1 Hour rated, 2x6 studs @ 16" O.C. w/ (1) layers Type 'X' GWB each side. Minimum STC rating 55. Rated walls must extend to underside of structure. Rated stair wall and shaft walls must be continuous.

(A) 3'-0" x 7'-0" 1-1/2 HOUR RATED METAL DOOR

(B) 3'-0" x 7'-0" 1 HOUR RATED SOLID WOOD DOOR

(C) 2'-8" x 7'-0" NON-RATED METAL DOOR

(D) 3'-0" x 7'-0" NON-RATED HOLLOW WOOD DOOR

(E) 3'-0" x 7'-0" NON-RATED FULL LITE WOOD DOOR

NOTE:

[illegible]

1. Contractor/owner responsible for securing all necessary permits.
2. Contractor/owner will comply with all applicable codes and ordinances.
3. Contractor/owner to verify all site, grades and dimensions.

PROPERTY OF

CodeTech
235 Riverside Industrial Parkway
Portland, ME 04102

SCHNEIDER Property Management

Building Addition
522 Washington Ave
Schneider Property Management, LLC

NO	REMARKS	BY
A	ISSUED FOR PERMIT	JJC

DATE: 09-24-15

CODE: IRC 2009
TOWN: PORTLAND
DATE: 09-24-15
SCALE: As Noted
DRAWN: JJC
TITLE: FIRST & SECOND FLOOR ADDITION
FILE:
SHEET: A1-03