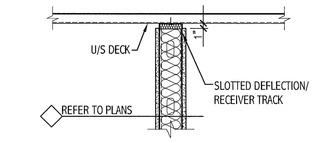

GYPSUM WALL (NON-RATED)
(PERPENDICULAR TO DECK FLUTES)



GYPSUM WALL (NON-RATED)
(PARALLEL TO DECK FLUTES)

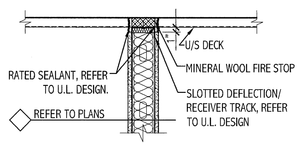

GYPSUM WALL (RATED)
(PERPENDICULAR TO DECK FLUTES)
U.L. DESIGN-HW-D-0027
(1 HOUR, REFER TO U.L. DESIGN FOR SPECIFIC REQUIREMENTS)

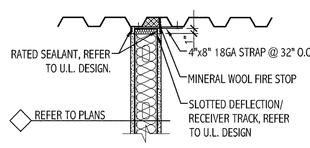

GYPSUM WALL (RATED)
(PARALLEL TO DECK FLUTES)
U.L. DESIGN-HW-D-0027
(1 HOUR, REFER TO U.L. DESIGN FOR SPECIFIC REQUIREMENTS)



GYPSUM WALL (NON-RATED)
(PERPENDICULAR TO STRUCTURE)

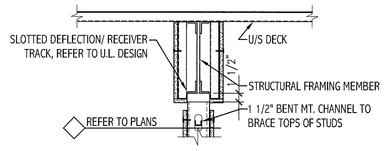

GYPSUM WALL (NON-RATED)
(PARALLEL TO STRUCTURE)

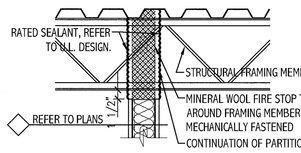

GYPSUM WALL (RATED)
(PERPENDICULAR TO STRUCTURE)
U.L. DESIGN-HW-D-0027
(1 HOUR, REFER TO U.L. DESIGN FOR SPECIFIC REQUIREMENTS)

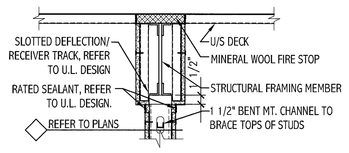

GYPSUM WALL (RATED)
(PARALLEL TO STRUCTURE)
U.L. DESIGN-HW-D-0027
(1 HOUR, REFER TO U.L. DESIGN FOR SPECIFIC REQUIREMENTS)



GYPSUM WALL PENETRATION (RATED)
U.L. DESIGN-W-L-7028
NOTE:
REFER TO U.L. DESIGN DESCRIPTION FOR DUCT SIZE & MATERIAL LIMITATIONS



MASONRY WALL PENETRATION (RATED)
U.L. DESIGN-W-L-1479
NOTE:
REFER TO U.L. DESIGN DESCRIPTION FOR DUCT SIZE & MATERIAL LIMITATIONS

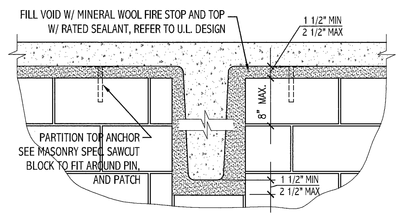

MASONRY WALL (RATED)
(PERPENDICULAR TO STRUCTURE)
U.L. DESIGN-HW-D-0027
(1 HOUR, REFER TO U.L. DESIGN FOR SPECIFIC REQUIREMENTS)

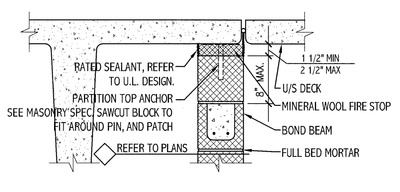

MASONRY WALL (RATED)
(PARALLEL TO STRUCTURE)
U.L. DESIGN-HW-D-0027
(1 HOUR, REFER TO U.L. DESIGN FOR SPECIFIC REQUIREMENTS)

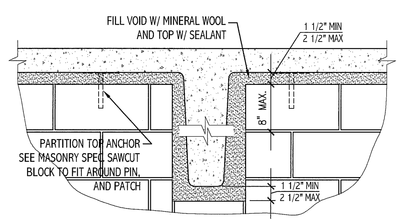

MASONRY WALL (NON-RATED)
(PERPENDICULAR TO STRUCTURE)

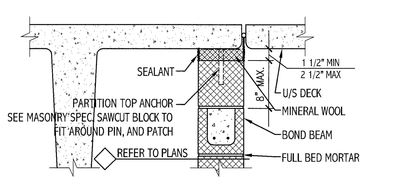

MASONRY WALL (NON-RATED)
(PARALLEL TO STRUCTURE)

PARTITION LEGEND

S1 PARTITION
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK
3 5/8" STEEL STUDS @ 16" O.C. TO DECK
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO DECK
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK

S2 PARTITION
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO 6" ABOVE CEILING
3 5/8" STEEL STUDS @ 16" O.C. TO DECK
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO 6" ABOVE CEILING

S3 SMOKE PARTITION
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
3 5/8" STEEL STUDS @ 16" O.C. TO DECK
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO DECK
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS

S4 1 HOUR FIRE RATED PARTITION: UL DESIGN U419????
(1) LAYER 5/8"x4' TYPE 'X' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
20 GAGE 3 5/8"x1 1/4" STEEL FLOOR AND CEILING RUNNERS FASTENED @ 24" O.C. (MAX.)
20 GAGE 3 5/8"x1 5/8" STEEL STUDS W/ 3/8" RETURNS SPACED @ 16" O.C.
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO DECK
(1) LAYER 5/8"x4' TYPE 'X' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS

S5 RADIATION PROTECTION PARTITION
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK
3 5/8" STEEL STUDS @ 16" O.C. TO DECK
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO DECK
(1) LAYER 5/8" LEAD-LAMINATED GYPSUM BOARD TO DECK
TAGGED SIDE

S6 SOUND-ATTENUATING PARTITION
(2) LAYERS 1/2"x4' TYPE 'C' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
20 GAGE 6"x1 1/4" STEEL FLOOR AND CEILING RUNNERS FASTENED @ 24" O.C. (MAX.)
20 GAGE 6"x1 5/8" STEEL STUDS W/ 3/8" RETURNS SPACED @ 24" O.C.
5" UNFACED, MINERAL WOOL BATT INSULATION TO DECK
RC-1 RESILIENT CHANNELS @ 24" O.C. HORIZONTALLY (ONE SIDE)
(2) LAYERS 1/2"x4' TYPE 'C' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
TAGGED SIDE

S7 SOUND-ATTENUATING SMOKE PARTITION
(2) LAYERS 1/2"x4' TYPE 'C' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
20 GAGE 6"x1 1/4" STEEL FLOOR AND CEILING RUNNERS FASTENED @ 24" O.C. (MAX.)
20 GAGE 6"x1 5/8" STEEL STUDS W/ 3/8" RETURNS SPACED @ 24" O.C.
5" UNFACED, MINERAL WOOL BATT INSULATION TO DECK
RC-1 RESILIENT CHANNELS @ 24" O.C. HORIZONTALLY (ONE SIDE)
(2) LAYERS 1/2"x4' TYPE 'C' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
TAGGED SIDE

S8 SOUND-ATTENUATING 1 HOUR FIRE RATED PARTITION: UL DESIGN U454
(2) LAYERS 1/2"x4' TYPE 'C' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
20 GAGE 6"x1 1/4" STEEL FLOOR AND CEILING RUNNERS FASTENED @ 24" O.C. (MAX.)
20 GAGE 6"x1 5/8" STEEL STUDS W/ 3/8" RETURNS SPACED @ 24" O.C.
5" UNFACED, MINERAL WOOL BATT INSULATION TO DECK
RC-1 RESILIENT CHANNELS @ 24" O.C. HORIZONTALLY (ONE SIDE)
(2) LAYERS 1/2"x4' TYPE 'C' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
TAGGED SIDE

S9 PARTITION
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK
6" STEEL STUDS @ 16" O.C. TO DECK
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO DECK
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK

S10 SMOKE PARTITION
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
6" STEEL STUDS @ 16" O.C. TO DECK
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO DECK
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS

S11 1 HOUR FIRE RATED PARTITION: UL DESIGN U419
(1) LAYER 5/8"x4' TYPE 'X' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
20 GAGE 6"x1 1/4" STEEL FLOOR AND CEILING RUNNERS FASTENED @ 24" O.C. (MAX.)
20 GAGE 6"x1 5/8" STEEL STUDS W/ 3/8" RETURNS SPACED @ 16" O.C.
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO DECK
(1) LAYER 5/8"x4' TYPE 'X' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS

S12 2 HOUR FIRE RATED PARTITION: UL DESIGN U423
(2) LAYERS 5/8"x4' TYPE 'X' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
6" STEEL STUDS, RE: STRUCTURAL FOR GAGE AND SPACING(@ 80% OF DESIGN LOAD)
(2) LAYERS 5/8"x4' TYPE 'X' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS

S13 2 HOUR FIRE RATED PARTITION: UL DESIGN U423
(2) LAYERS 5/8"x4' TYPE 'X' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS
6" STEEL STUDS @ 16" O.C. TO DECK
(2) LAYERS 5/8"x4' TYPE 'X' INTERIOR GYPSUM BOARD TO DECK, FIRESTOPPING SEALANT @ PERIMETERS

S14 PARTITION
6" STEEL STUDS, RE: STRUCTURAL FOR GAGE AND SPACING.
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK, TAGGED SIDE.
TAGGED SIDE

S15 PARTITION
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK
8" STEEL STUDS @ 16" O.C. TO DECK
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO DECK
(1) LAYER 5/8" INTERIOR GYPSUM BOARD TO DECK

PARTITION LEGEND

S16 2 HOUR FIRE RATED SHAFT WALL: UL DESIGN U415 - SYSTEM B
3-1/2" 22 GAGE 'I' SHAPED FLOOR AND CEILING RUNNERS ATTACHED TO STRUCTURAL SUPPORTS 2" (MAX) FROM EDGE AND 24" (MAX) O.C. 22 GAGE 3-1/2" 'C-H' SHAPED STUDS SPACED 24" O.C. (MAX). 1" GWB LINER PANELS INSERTED INTO 'H' SECTION OF 'C-H' STUDS, ATTACH TO LONG LEG OF 'I' SHAPE WITH 1-5/8" TYPE S SELF DRILLING, SELF TAPPING SCREWS 12" O.C. (MAX). FASTEN (1) LAYER 5/8" TYPE X GWB TO OUTER FACE OF 'C' PORTION OF 'C-H' STUDS WITH 1" TYPE S SELF TAPPING SCREWS AT 8" O.C. ALONG EDGES & 12" O.C. INFIELD. INSTALL BOARD WITH VERTICAL JOINTS STAGGERED. APPLY 2" PAPER JOINTS AND FINISH W/2 COATS OF JOINT COMPOUND. SEAL TIGHT TO STRUCTURE AND DECK.

S17 STRUCTURAL STUD WALL
STEEL STUD WALL: RE: STRUCTURAL FOR SIZE & SPACING.
ALIGN STUD CAVITY TO MATCH OPENING OF ACCESS PANEL DEPICTED ON PLAN

S18 CHASE WALL
(1) LAYER 5/8" GWB TO DECK
3 5/8" METAL STUDS TO DECK
BATT INSULATION STUD INFILL TO DECK
(2) PIECES 24" HIGH GYPSUM PANEL BRACING
3-5/8" METAL STUDS TO DECK
(1) LAYER 5/8" GWB TO DECK
SEE PLAN

F1 FURRING
2" METAL Z-CHANNELS @ 16" O.C. TO 6" ABOVE CEILING
RIGID INSULATION INFILL TO 6" ABOVE CEILING
(1) LAYER 5/8" GWB TO 6" ABOVE CEILING TAGGED SIDE.
TAGGED SIDE

F2 FURRING
1-1/2" METAL Z-CHANNELS @ 16" O.C. TO 6" ABOVE CEILING
RIGID INSULATION INFILL TO 6" ABOVE CEILING
(1) LAYER 5/8" GWB TO 6" ABOVE CEILING TAGGED SIDE.
TAGGED SIDE

F3 FURRING
1 5/8" STEEL STUDS @ 16" O.C. TO 6" ABOVE CEILING
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO 6" ABOVE CEILING
(1) LAYER 5/8" GWB TO 6" ABOVE CEILING TAGGED SIDE.
TAGGED SIDE

F4 FURRING
3 5/8" STEEL STUDS @ 16" O.C. TO 6" ABOVE CEILING
UNFACED, GLASS-FIBER BLANKET INSULATION STUD INFILL TO 6" ABOVE CEILING
(1) LAYER 5/8" GWB TO 6" ABOVE CEILING TAGGED SIDE.
TAGGED SIDE

M1 INSULATED MASONRY WALL
8"x8"x16" CONCRETE MASONRY UNIT TO DECK, SEALANT @ T.OWALL/B.O.DECK
MOLDED INSULATION INSERTS IN BLOCK CORES

M2 INSULATED MASONRY WALL (SEE PARTITION NOTE 16)
8"x8"x16" CONCRETE MASONRY UNIT TO TOP OF MINERAL WOOL BOARD INSULATION OF ADJACENT CEILING SYSTEM
MOLDED INSULATION INSERTS IN BLOCK CORES

M3 SMOKE PARTITION INSULATED MASONRY WALL (SEE PARTITION NOTE 16)
8"x8"x16" CONCRETE MASONRY UNIT TO TOP OF MINERAL WOOL BOARD INSULATION OF ADJACENT CEILING SYSTEM
MOLDED INSULATION INSERTS IN BLOCK CORES

M4 1 HOUR FIRE RATED INSULATED MASONRY WALL (SEE PARTITION NOTE 6)
8"x8"x16" CONCRETE MASONRY UNIT TO DECK, FIRESTOPPING SEALANT @ T.OWALL/B.O.DECK
MOLDED INSULATION INSERTS IN BLOCK CORES

M5 2 HOUR FIRE RATED INSULATED MASONRY WALL (SEE PARTITION NOTE 6)
8"x8"x16" CONCRETE MASONRY UNIT TO DECK, FIRESTOPPING SEALANT @ T.OWALL/B.O.DECK
MOLDED INSULATION INSERTS IN BLOCK CORES

M6 2 HOUR FIRE RATED MASONRY WALL (SEE PARTITION NOTE 6)
8"x8"x16" CONCRETE MASONRY WALL TO DECK, FIRESTOPPING SEALANT @ T.OWALL/B.O.DECK

M7 4" MASONRY VENEER
FACE OF WALL
1" TOLERANCE SPACE
4"x8"x16" CONCRETE MASONRY UNIT
4 5/8"
TAGGED SIDE

C1 2 HOUR FIRE RATED PRE-CAST CONCRETE WALL
10" PRE-CAST CONCRETE PANELS, RE: STRUCTURAL AND STAIR & ELEVATOR DRAWINGS

ROOF ASSEMBLY LEGEND

R1 LOOSELY LAID AND BALLASTED EPDM MEMBRANE ROOFING ASSEMBLY
AGGREGATE BALLAST
PROTECTION MAT (IF TYPE OF BALLAST NECESSITATES USE)
SINGLE PLY EPDM MEMBRANE
6" PREFORMED ROOF INSULATION BOARD
ROOF DECK, RE: STRUCTURAL
ROOF FRAMING, RE: STRUCTURAL
5"

R2 LOOSELY LAID AND BALLASTED EPDM MEMBRANE ROOFING ASSEMBLY
AGGREGATE BALLAST
PROTECTION MAT (IF TYPE OF BALLAST NECESSITATES USE)
SINGLE PLY EPDM MEMBRANE
6" PREFORMED ROOF INSULATION BOARD
CONCRETE SLAB, RE: STRUCTURAL
ROOF DECK, RE: STRUCTURAL
ROOF FRAMING, RE: STRUCTURAL
5"
6"

R3 STEEL ROOFING ASSEMBLY
STANDING SEAM METAL ROOFING
SELF-ADHERING WATERPROOF UNDERLAYMENT MEMBRANE
COMPOSITE NAIL BASE INSULATED ROOF SHEATHING:
5/8" ORIENTED STRAND BOARD
1 1/2" WOOD VENTILATING SPACER BLOCKS
6" CONTINUOUS POLYISOCYANURATE INSULATION
ROOF DECK, RE: STRUCTURAL
ROOF FRAMING, RE: STRUCTURAL
1 1/2"
6"

R4 CANOPY ROOFING ASSEMBLY

EXTERIOR WALL LEGEND

W1 MASONRY WITH BRICK VENEER
FACE BRICK
MASONRY ANCHORS, TYP.
AIR SPACE
AIR/WATER BARRIER
12" CONCRETE MASONRY UNITS
EXTERIOR
1'-6"
INTERIOR

W2 MASONRY WITH BRICK VENEER
FACE BRICK
MASONRY ANCHORS, TYP.
AIR SPACE
2" FOAM-PLASTIC BOARD INSULATION
AIR/WATER BARRIER
10" CONCRETE MASONRY UNITS
2 1/2" STEEL STUDS @ 16" O.C.
5/8" INTERIOR GYPSUM BOARD
EXTERIOR
1'-6"
3 1/8"
INTERIOR

W3 CONCRETE WITH BRICK VENEER
FACE BRICK
MASONRY ANCHORS, TYP.
AIR SPACE
2" FOAM-PLASTIC BOARD INSULATION
AIR/WATER BARRIER
10" PRECAST CONCRETE, RE: STRUCTURAL
EXTERIOR
1'-6 3/8"
INTERIOR

W4 CONCRETE WITH BRICK VENEER
FACE BRICK
MASONRY ANCHORS, TYP.
2-3/4" AIR SPACE
2" FOAM-PLASTIC BOARD INSULATION
AIR/WATER BARRIER
10" CAST-IN-PLACE CONCRETE, RE: STRUCTURAL
EXTERIOR
1'-6"
INTERIOR

W5 METAL STUD WITH METAL WALL PANEL
CONCEALED-FASTENER, LAP-SEAM METAL WALL PANEL
2" Z-SHAPED FURRING CHANNELS @ 2'-0" O.C. HORIZONTALLY
2" FOAM-PLASTIC BOARD INSULATION
AIR/WATER BARRIER
5/8" GLASS-MAT GYPSUM WALL SHEATHING
6" STEEL STUDS, RE: STRUCTURAL
EXTERIOR
10 3/4"
INTERIOR

W6 METAL STUD WITH METAL-FACED COMPOSITE WALL PANEL
METAL-FACED COMPOSITE WALL PANEL SYSTEM:
3/4" PANELS, 1-1/4 MOUNTING HARDWARE
2" Z-FURRING CHANNELS @ 2'-0" O.C. HORIZONTALLY
2" FOAM-PLASTIC BOARD INSULATION
AIR/WATER BARRIER
5/8" GLASS-MAT GYPSUM WALL SHEATHING
6" STEEL STUDS, RE: STRUCTURAL
5/8" INTERIOR GYPSUM BOARD
EXTERIOR
11 1/4"
INTERIOR

GENERAL NOTES:

1. SEE GI001 FOR PROJECT GENERAL NOTES

PARTITION NOTES:

1. PARTITION TYPE DRAWINGS ARE GRAPHIC REPRESENTATION ONLY, THEY ARE NOT TO SCALE TYPICAL.
2. MORTAR USED IN THE RATED ASSEMBLIES SHALL HAVE SAND TO CEMENT RATIO BETWEEN 2.25 & 3.5, AND HYDRATED LIME TO CEMENT RATIO LESS THAN 0.5.
3. ALL BATT INSULATION IS TO BE FULL THICKNESS AND FULL HEIGHT UNLESS NOTED OTHERWISE.
4. REFER TO FINISH SCHEDULE FOR EXTENT OF FINISHES APPLIED TO WALLS.
5. BRACE WALLS WHICH DO NOT EXTEND FULL HEIGHT TO STRUCTURE FOR ALL WALL LENGTHS GREATER THAN 8' BETWEEN CORNERS. BRACE WITH 45° STUD TO STRUCTURE AT 8'-0" ON CENTER MAX.
6. FIRE ENDURANCES FOR CMU ASSEMBLIES HAVE BEEN DESIGNED PER CALCULATIONS INDENTIFIED IN "ANALYTICAL METHODS OF DETERMINING FIRE ENDURANCE OF CONCRETE AND MASONRY - MODEL CODE APPROVED PROCEDURES" AS PUBLISHED BY THE CONCRETE AND MASONRY INDUSTRY FIRESAFETY COMMITTEE. BY CALCULATION, ALL ASSEMBLIES MEET OR EXCEED THE REQUIREMENT. SOLID GROUT WALLS AS REQUIRED TO PROVIDE AN EQUIVALENT THICKNESS OF NOT LESS THAN 2.8" THICKNESS FOR 1 HOUR PROTECTION.
7. FASTEN GWB W/ 1" TYPE 'S' SELF TAPPING SCREWS @ 8" O.C. ALONG EDGES & 12" O.C. @ IN FIELD
8. INSTALL GWB W/ VERTICAL JOINTS STAGGERED, APPLY 2" PAPER JOINTS AND FINISH W/ (2) COATS OF JOINT COMPOUND.
9. APPLY CONTINUOUS FIRESTOPPING SEALANT @ ALL PENETRATIONS IN FIRE RATED AND SMOKE PARTITIONS.
10. REFER TO ROOM FINISH SCHEDULE FOR APPLIED FINISHES SUCH AS TILE. PROVIDE SPECIFIED WALL FINISH SUBSTRATE IN PLACE OF GYPSUM BOARD WHERE TILE IS SCHEDULED.
11. CMU LAID IN FULL 3/8" MORTAR BED WITH VERTICAL JOINTS STAGGERED.
12. REFER TO STRUCTURAL FOR REQUIRED REINFORCING OF MASONRY WALLS.
13. BULLNOSE BLOCK AT ALL MASONRY OPENING EXPOSED CORNERS AND SIDES.
14. AT EXTERIOR MASONRY WALL ASSEMBLY CMU IS EXTENDED TO STRUCTURE ABOVE WITH #4 VERTICAL REINFORCING @ 8" CENTERS (U.N.O BY STRUCTURAL), HORIZONTAL LADDER TYPE REINFORCING @ 16" CENTERS, AND SOLID GROUT. PROVIDE WALL TOP CONNECTION AS REQUIRED BY STRUCTURAL
15. TYPICAL TOP OF WALL DETAILS AND THROUGH WALL PENETRATION DETAILS ARE TO BE COORDINATED FOR EACH INDIVIDUAL WALL CONDITION BY THE CONTRACTOR PRIOR TO PROCEEDING WITH WORK. NOTIFY ARCHITECT IN WRITING OF ANY DISCREPANCIES OR INCONSISTENCIES BETWEEN THE DETAIL PROVIDED AND THE TRUE WALL CONDITION. FAILURE TO REPORT ANY DISCREPANCIES WITHIN THESE CONSTRUCTION DOCUMENTS TO THE ARCHITECT WILL NOT BE GROUNDS FOR ADDITIONAL COST OR CHANGE ORDERS.
16. THE CONCRETE MASONRY UNITS FOR THIS WALL ASSEMBLY WILL NEED TO MAINTAIN A 2 HOUR FIRE RATING DUE TO ITS PENETRATION OF THE ADJACENT RATED CEILING ASSEMBLY. ALL COMPONENTS WITHIN THE WALL ASSEMBLY BELOW THE CEILING WILL MAINTAIN THE RATING INDICATED BY THE PARTITION TAG, IF APPLICABLE.

PARTITION SYMBOLS:

1/A* AFF = HEIGHT AT TOP OF PARTIAL HEIGHT WALL

- INTERIOR STUD PARTITION
- CHASE WALL SYSTEM
- FURRED WALL SYSTEM
- CONCRETE WALL SYSTEM
- INTERIOR MASONRY PARTITION
- EXTERIOR WALL SYSTEM
- ROOF SYSTEM

REV.	DESCRIPTION	DATE

ISSUED FOR G.M.P. & PERMITTING
4-3-09

CURRENT ISSUE STATUS:

PROJECT NORTH

SMRT
ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070
www.smrtinc.com

MARTIN'S POINT HEALTH CARE
MEDICAL OFFICE BUILDING
PORTLAND, MAINE

GENERAL INFORMATION

SHEET TITLE:

SCALE:	AS NOTED	DATE:	
PROJECT MANAGER:	SLB	GRAPHIC SCALE:	0" 1"
JOB CAP/DRAWN:	TCM/MLE		
A/E OF RECORD:	SLB	SHEET No.	GI002
SMRT CAD FILE:	GI002-08139		
PROJECT No.	08139		

©2019 SMRT

PROGRESS PRINT

A1	TYPICAL TOP OF WALL AND THROUGH WALL PENETRATION DETAILS	A7	INTERIOR PARTITION, EXTERIOR WALL ASSEMBLY & ROOF ASSEMBLY LEGENDS
NOT TO SCALE		NOT TO SCALE	