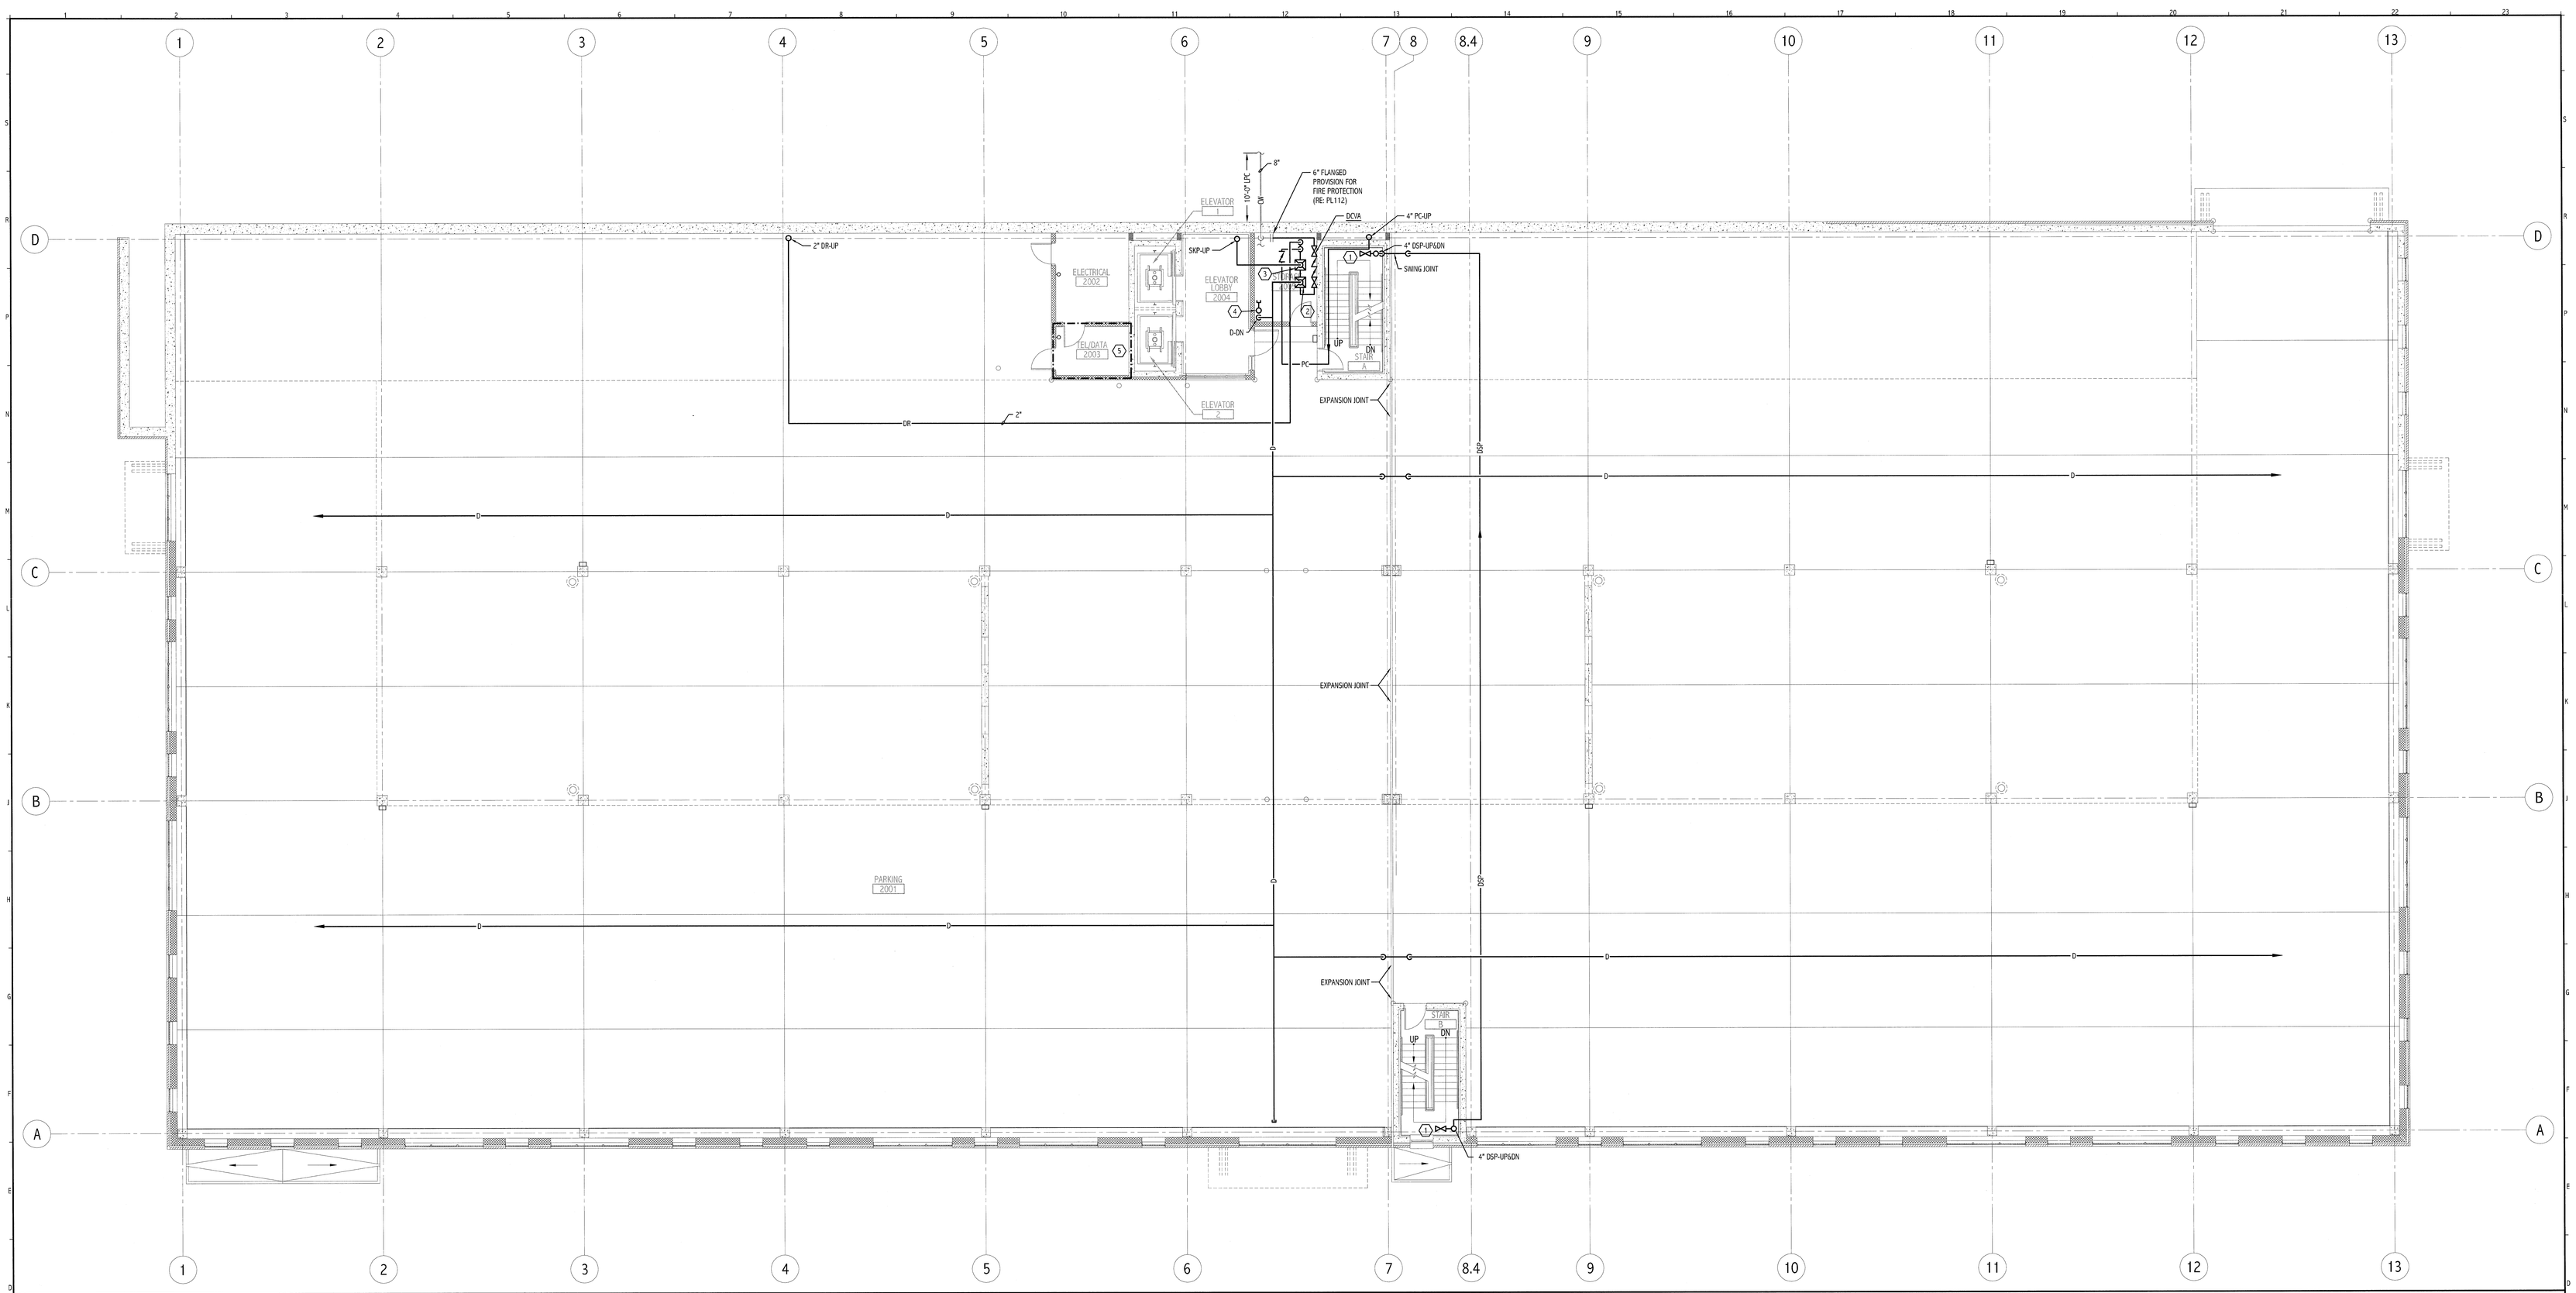

D1	SECOND LEVEL FLOOR PLAN
1/8" = 1'-0"	-

KEYED NOTES:

1. FIRE DEPARTMENT VALVE. TURN FDV 1/16 AWAY FROM WALL TO ALLOW GREATER ACCESS TO THREADS TO FIRE DEPARTMENT.
2. DRY PIPE SPRINKLER ALARM CHECK VALVE. SEE DETAIL E17/FP001.
3. WET PIPE SPRINKLER ALARM CHECK VALVE. SEE DETAIL A17/FP001.
4. 3/4" HOSE CONNECTION AND SHUT-OFF VALVE FOR SPRINKLER SYSTEM DRAIN.
5. CLEAN AGENT FIRE SUPPRESSIN SYSTEM.

NOTES:

1. SEE G001 FOR PROJECT GENERAL NOTES.
2. SEE SHEET FP001 FOR FIRE PROTECTION LEGEND AND ABBREVIATIONS.
3. DRY SYSTEM LOW-POINT DRAINS TO BE INSTALLED IN HEATED SPACE.
4. SPRINKLER HEAD LOCATIONS: THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING COMPLETE SPRINKLER COVERAGE THROUGHOUT THE FACILITY PER REQUIREMENTS OF NFPA 13, 13900 SERIES SPECIFICATIONS AND PER AUTHORITIES HAVING JURISDICTION. COORDINATE SPRINKLER HEAD LOCATIONS WITHIN THE CEILING WITH THE ARCHITECTURAL REFLECTED CEILING PLAN.
5. SPRINKLER HEAD TYPES: REFER TO 13900 SERIES SPECIFICATIONS FOR SPRINKLER HEAD TYPES FOR EACH SPECIFIC LOCATION.
6. PROVIDE SWING JOINT OR ENGINEER APPROVED FLEXIBLE CONNECTOR WHERE PIPES PASS EXPANSION JOINT.

REV.	DESCRIPTION	DATE

ISSUED FOR G.M.P. & PERMITTING
4-3-09

CURRENT ISSUE STATUS:

PROJECT NORTH

SMRT
ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING
144 Fore Street/P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070
www.smrtinc.com

MARTIN'S POINT HEALTH CARE
MEDICAL OFFICE BUILDING
PORTLAND, MAINE

SECOND LEVEL: PARKING GARAGE
FIRE PROTECTION PLAN
SHEET TITLE:

SCALE:	AS NOTED	DATE:	
PROJECT MANAGER:	SLB	GRAPHIC SCALE:	0" 1"
JOB CAP/DRAWN:	TCM/JPB		
A/E OF RECORD:	TAC	SHEET No.	FP102
SMRT CAD FILE:	FP102-08139		
PROJECT No.	08139		

©COPYRIGHT 2008 SMRT INC

PROGRESS PRINT