## NOTE:

1. SEE G1001 FOR PROJECT GENERAL NOTES
2. SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.

## KEYED NOTES:

1. DUCT SMOKE DETECTORS TO REPORT A SUPERVISORY SIGNAL TO THE FIRE ALARM CONTROL PANEL AND SHUT DOWN HVAC EQUIPMENT INDICATED.
2. PROVIDE SUPERVISED CONNECTION TO GASEOUS FIRE PROTECTION SYSTEM CONTROL PANEL. COORDINATE NECESSARY REQUIREMENTS W/ FIRE PROTECTION CONTRACTOR.
3. SMOKE DETECTORS TO TIE INTO ELEVATOR CONTROL PANEL FOR ELEVATOR RECALL FUNCTIONS.
4. HEAT DETECTORS TO TIE INTO ELEVATOR CONTROL PANEL AS WELL AS ENERGIZE SHUNT TRIP CIRCUIT BREAKER TO DE-ENERGIZED ELEVATORS.
5. SPRINKLER FLOW SWITCH ACTUAL LOCATIONS ARE SHOWN ON FIRE PROTECTION PLAN. FLOW SWITCHES TO BE ALARM SIGNAL TO THE FIRE ALARM SYSTEM. COORDINATE ALL WORK W/ SPRINKLER CONTRACTOR.
6. SPRINKLER TAMPER SWITCH ACTUAL LOCATIONS ARE SHOWN ON FIRE PROTECTION PLAN. TAMPER SWITCHES TO BE A SUPERVISORY SIGNAL TO THE FIRE ALARM SYSTEM. COORDINATE ALL WORK W/ SPRINKLER CONTRACTOR.
7. SPRINKLER PRESSURE SWITCH ACTUAL LOCATIONS ARE SHOWN ON FIRE PROTECTION PLAN. PRESSURE SWITCHES TO BE A SUPERVISORY SIGNAL TO THE FIRE ALARM SYSTEM. COORDINATE ALL WORK W/ SPRINKLER CONTRACTOR.

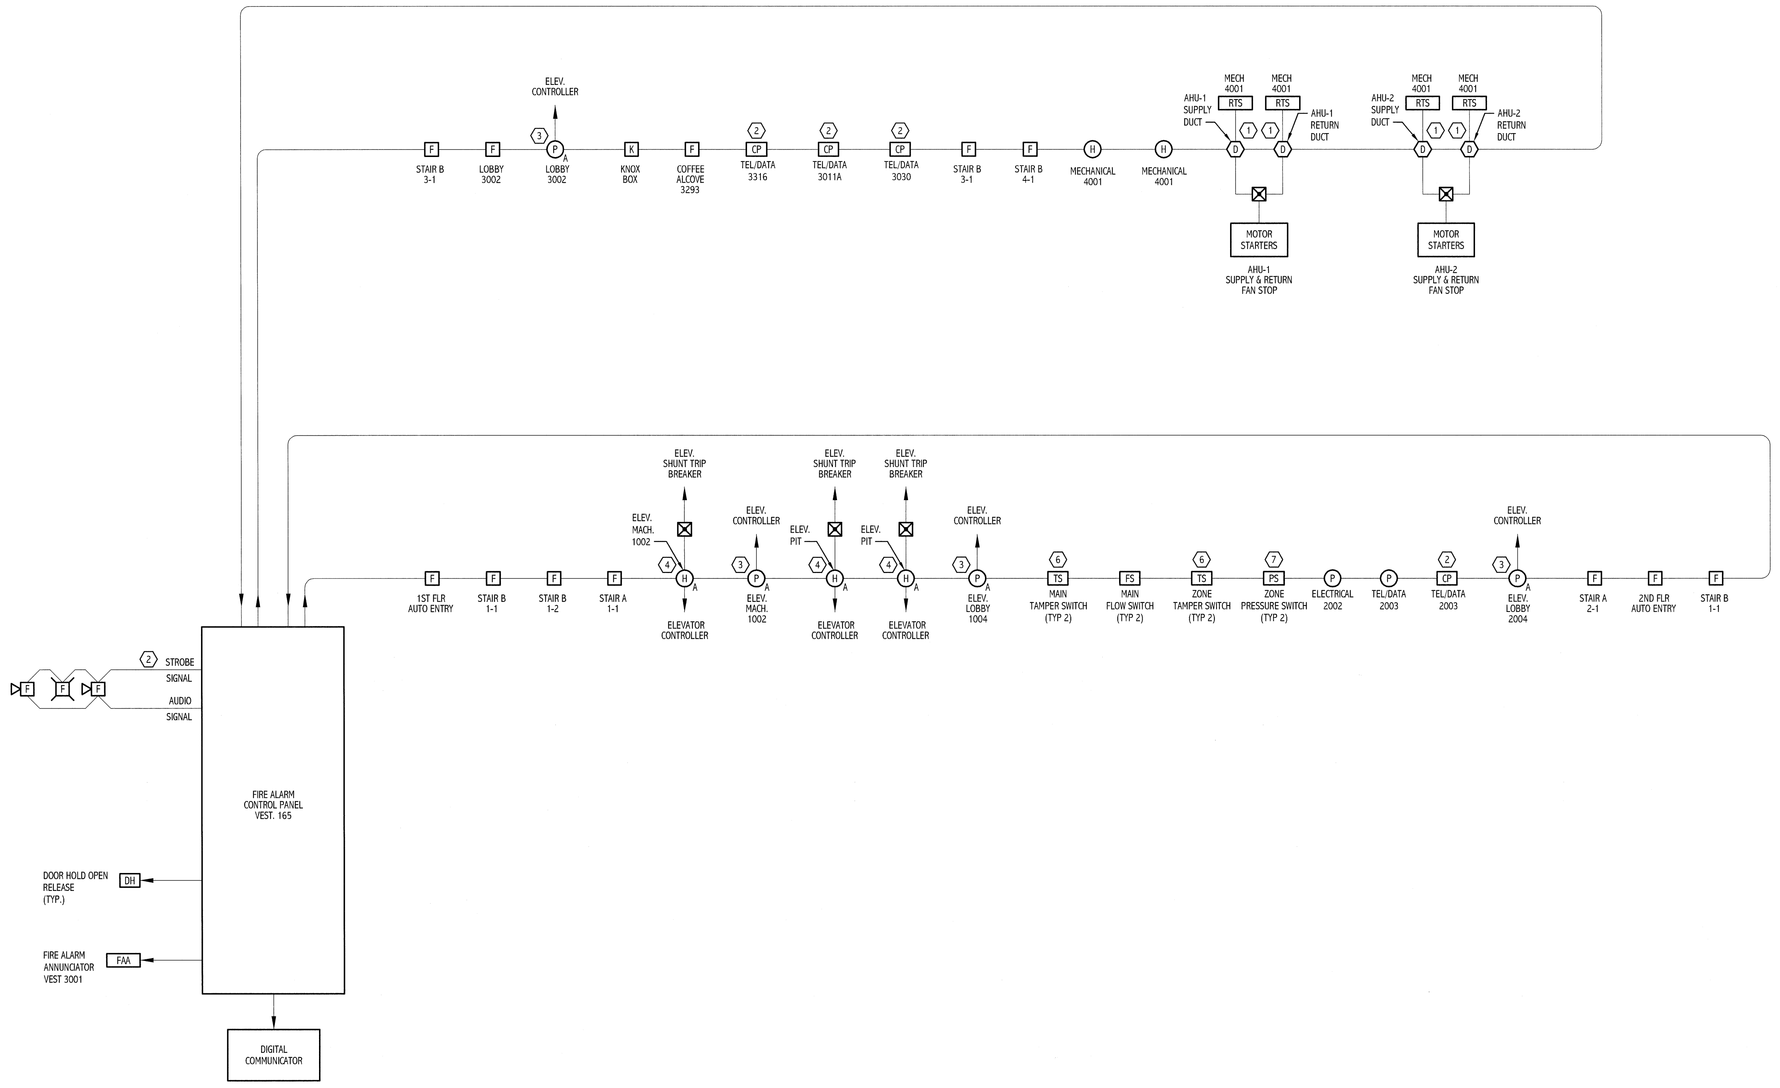


| | |
|---|---|
| A1 | FIRE ALARM RISER DIAGRAM |
| NONE | |

| REV. | DESCRIPTION | DATE |
|---|---|---|
| | | |

ISSUED FOR G.M.P. & PERMITTING
4-3-09

CURRENT ISSUE STATUS:

PROJECT NORTH


SMRT
ARCHITECTURE
ENGINEERING
PLANNING
INTERIOR DESIGN
COMMISSIONING
144 Fore Street,P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070
www.smrtinc.com


MARTIN'S POINT HEALTH CARE
MEDICAL OFFICE BUILDING
PORTLAND, MAINE

FIRE ALARM
RISER DIAGRAM

SHEET TITLE:

| | | | |
|---|---|---|---|
| SCALE: | NONE | DATE: | |
| PROJECT MANAGER: | SLB | GRAPHIC SCALE: | 0" 1" |
| JOB CAP/DRAWN: | TCM/CDS | | |
| A/E OF RECORD: | DJT | SHEET No. | |
| SMRT CAD FILE: | EY651-08139 | EY651 | |
| PROJECT No. | 08139 | | |

©COPYRIGHT 2009 SMRT, INC.

PROGRESS PRINT