

**City of Portland, Maine – Building or Use Permit Application** 389 Congress Street, 04101, Tel: (207) 874-8703, FAX: 874-8716

Location of Construction: 77 Woodlawn Ave		Owner: Frank A. Fowler, Jr.	Phone:	Permit No: 970634
Owner Address: SAA Portland, ME 04103	Lessee/Buyer's Name:	Phone:	Business Name:	<div style="border: 2px solid black; padding: 5px; text-align: center;"> <b>PERMIT ISSUED</b>                  JUN 20 1997  <b>CITY OF PORTLAND</b> </div> Permit Issued: Zone: R-5 CBL: 435-R-011
Contractor Name: Suburban Propane	Address:	Phone:		
Past Use: 1-fam	Proposed Use: Same	<b>COST OF WORK:</b> \$	<b>PERMIT FEE:</b> \$ 25.00	
		<b>FIRE DEPT.</b> <input checked="" type="checkbox"/> Approved <input type="checkbox"/> Denied	<b>INSPECTION:</b> Use Group: Type:	
Proposed Project Description: Install 2-100 Gallon propane Tanks		Signature: [Signature]	Signature: [Signature]	Zoning Approval: Special Zone or Reviews: <input type="checkbox"/> Shoreland <input type="checkbox"/> Wetland <input type="checkbox"/> Flood Zone <input type="checkbox"/> Subdivision <input type="checkbox"/> Site Plan maj <input type="checkbox"/> minor <input type="checkbox"/> mm <input type="checkbox"/>
Permit Taken By: Mary Gresik	Date Applied For: 18 June 1997	<b>PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.)</b> Action: <input type="checkbox"/> Approved <input type="checkbox"/> Approved with Conditions <input type="checkbox"/> Denied Signature: Date:		<b>Zoning Appeal</b> <input type="checkbox"/> Variance <input type="checkbox"/> Miscellaneous <input type="checkbox"/> Conditional Use <input type="checkbox"/> Interpretation <input type="checkbox"/> Approved <input type="checkbox"/> Denied

- This permit application does not preclude the Applicant(s) from meeting applicable State and Federal rules.
- Building permits do not include plumbing, septic or electrical work.
- Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work..

**PERMIT ISSUED WITH REQUIREMENTS**

**CERTIFICATION**

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application is issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit

SIGNATURE OF APPLICANT: Frank Fowler      ADDRESS: \_\_\_\_\_      DATE: 18 June 1997      PHONE: \_\_\_\_\_

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE \_\_\_\_\_ PHONE: \_\_\_\_\_

White-Permit Desk   Green-Assessor's   Canary-D.P.W.   Pink-Public File   Ivory Card-Inspector


CEO DISTRICT 6

## FIRE CODE PERMIT REPORT

DATE: 6/20/97 ADDRESS: 77 Woodlawn AvePERMIT TO: Frank FowlerOWNER/CONTRACTOR: Suburban PropaneAPPROVED  DENIED CONDITIONS OF APPROVAL/DENIAL

1. The boiler or furnace shall be protected by enclosing with one hour fire rated construction including fire doors and ceiling or by providing automatic extinguishment and smoke protected enclosure. Sprinkler piping serving not more than six sprinklers may be connected to a domestic water supply system having a capacity sufficient to provide a 0.15 gpm, per square foot of floor throughout the entire area. An indicating shut-off valve shall be installed in an accessible location between the sprinkler and the connection to the domestic water supply. Minimum pipe size shall be 3/4 inch copper or 1 inch steel. Maximum coverage area of a residential sprinkler is 144 square feet per sprinkler.
2. All required Fire Alarm Systems shall have the capability of "Zone Disconnect" via switches or key pad program provided the method is approved by the Fire Prevention Bureau.
3. All remote annunciators shall have a visible "trouble" indicator along with the Fire Alarm "Zone" indicators.
4. Any Master Box connected to the Municipal Fire Alarm System shall have a supervised Municipal Disconnect Switch.
5. All Master Box locations shall be approved by the Fire Department Director of Communications. A Master Box shall be located so that the center of the box is five feet above finished floor.
6. All Master Box locations are required to have a locked box (knoxbox).
7. A fire alarm acceptance report shall be submitted to the Portland Fire Department.
8. All underground tank removal(s) and/or installation(s) shall be done in accordance with the Department of Environmental Regulations (Chapter 691).
9. No cutting of tanks on site. Cutting of tanks is to be done at an approved tank disposal site.
10. Fire Dispatcher must be at least 48 hours in advance of removal and/or transportation of tanks.
11. All above ground L/P storage tanks shall be located in accordance with NFPA 58 Standards.
12. Any tank located near the path of vehicle movement shall be protected with appropriate permanent barricades.

13. All piping shall be protected from possible mechanical damage and vandalism.
14. A 4" storz fire department connection is required.
15. Any new sprinkler construction over six sprinkler heads needs to have State Fire Marshal approval.
16. Any renovations of sprinkler systems over 20 sprinkler heads needs to have State Fire Marshal approval.
17. A sprinkler performance test shall be submitted to the Portland Fire Department after completion of sprinkler work.
18. State Fire Marshal approval is required for this project.




Lt. G. McDougall  
Fire Prevention Officer  
City of Portland

Frank A. Fowler JR.  
77 Woodlawn Ave.  
Portland, Me.

O = Propane tank  
30" diameter

Allowing the tanks  
to be 6" away from  
the house this leaves  
9ft. from the tank to  
the property line.

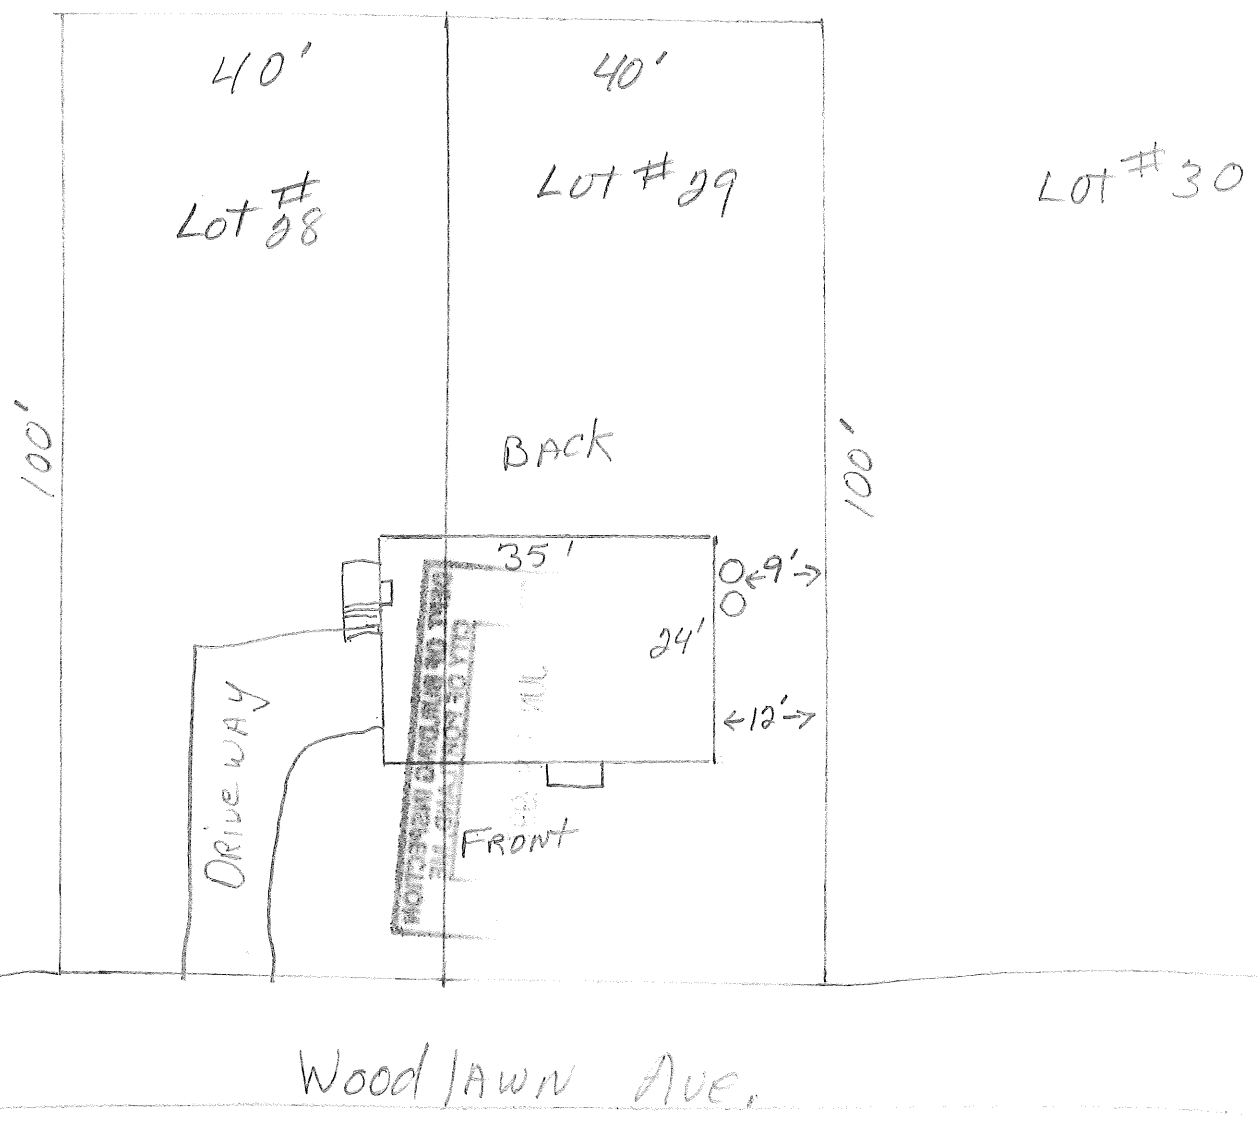

77 WOODLAWN Ave.