
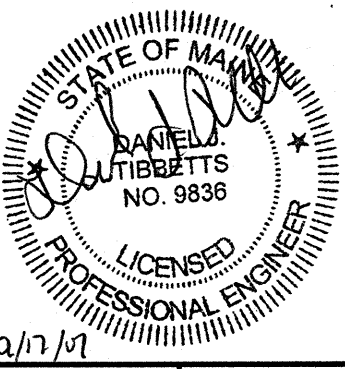


NOTE:

- SEE SHEET E-001 FOR LEGEND AND GENERAL NOTES.

KEYED NOTE:

- PROVIDE A 70A, 3P SHUNT TRIP CIRCUIT BREAKER FOR ELEVATOR FEED. ACTIVATION OF A HEAT DETECTOR TO OPEN SHUNT TRIP CIRCUIT BREAKER. PROVIDE AUXILIARY CONTACTS TO DISABLE BATTERY LOWERING UNIT UPON ACTIVATION OF A HEAT DETECTOR OR MANUAL OPENING OF CIRCUIT BREAKER. COORDINATE ALL WORK W/ ELEVATOR INSTALLER.
- PROVIDE POWER FOR GENERATOR BLOCK HEATER AND BATTERY CHARGER.

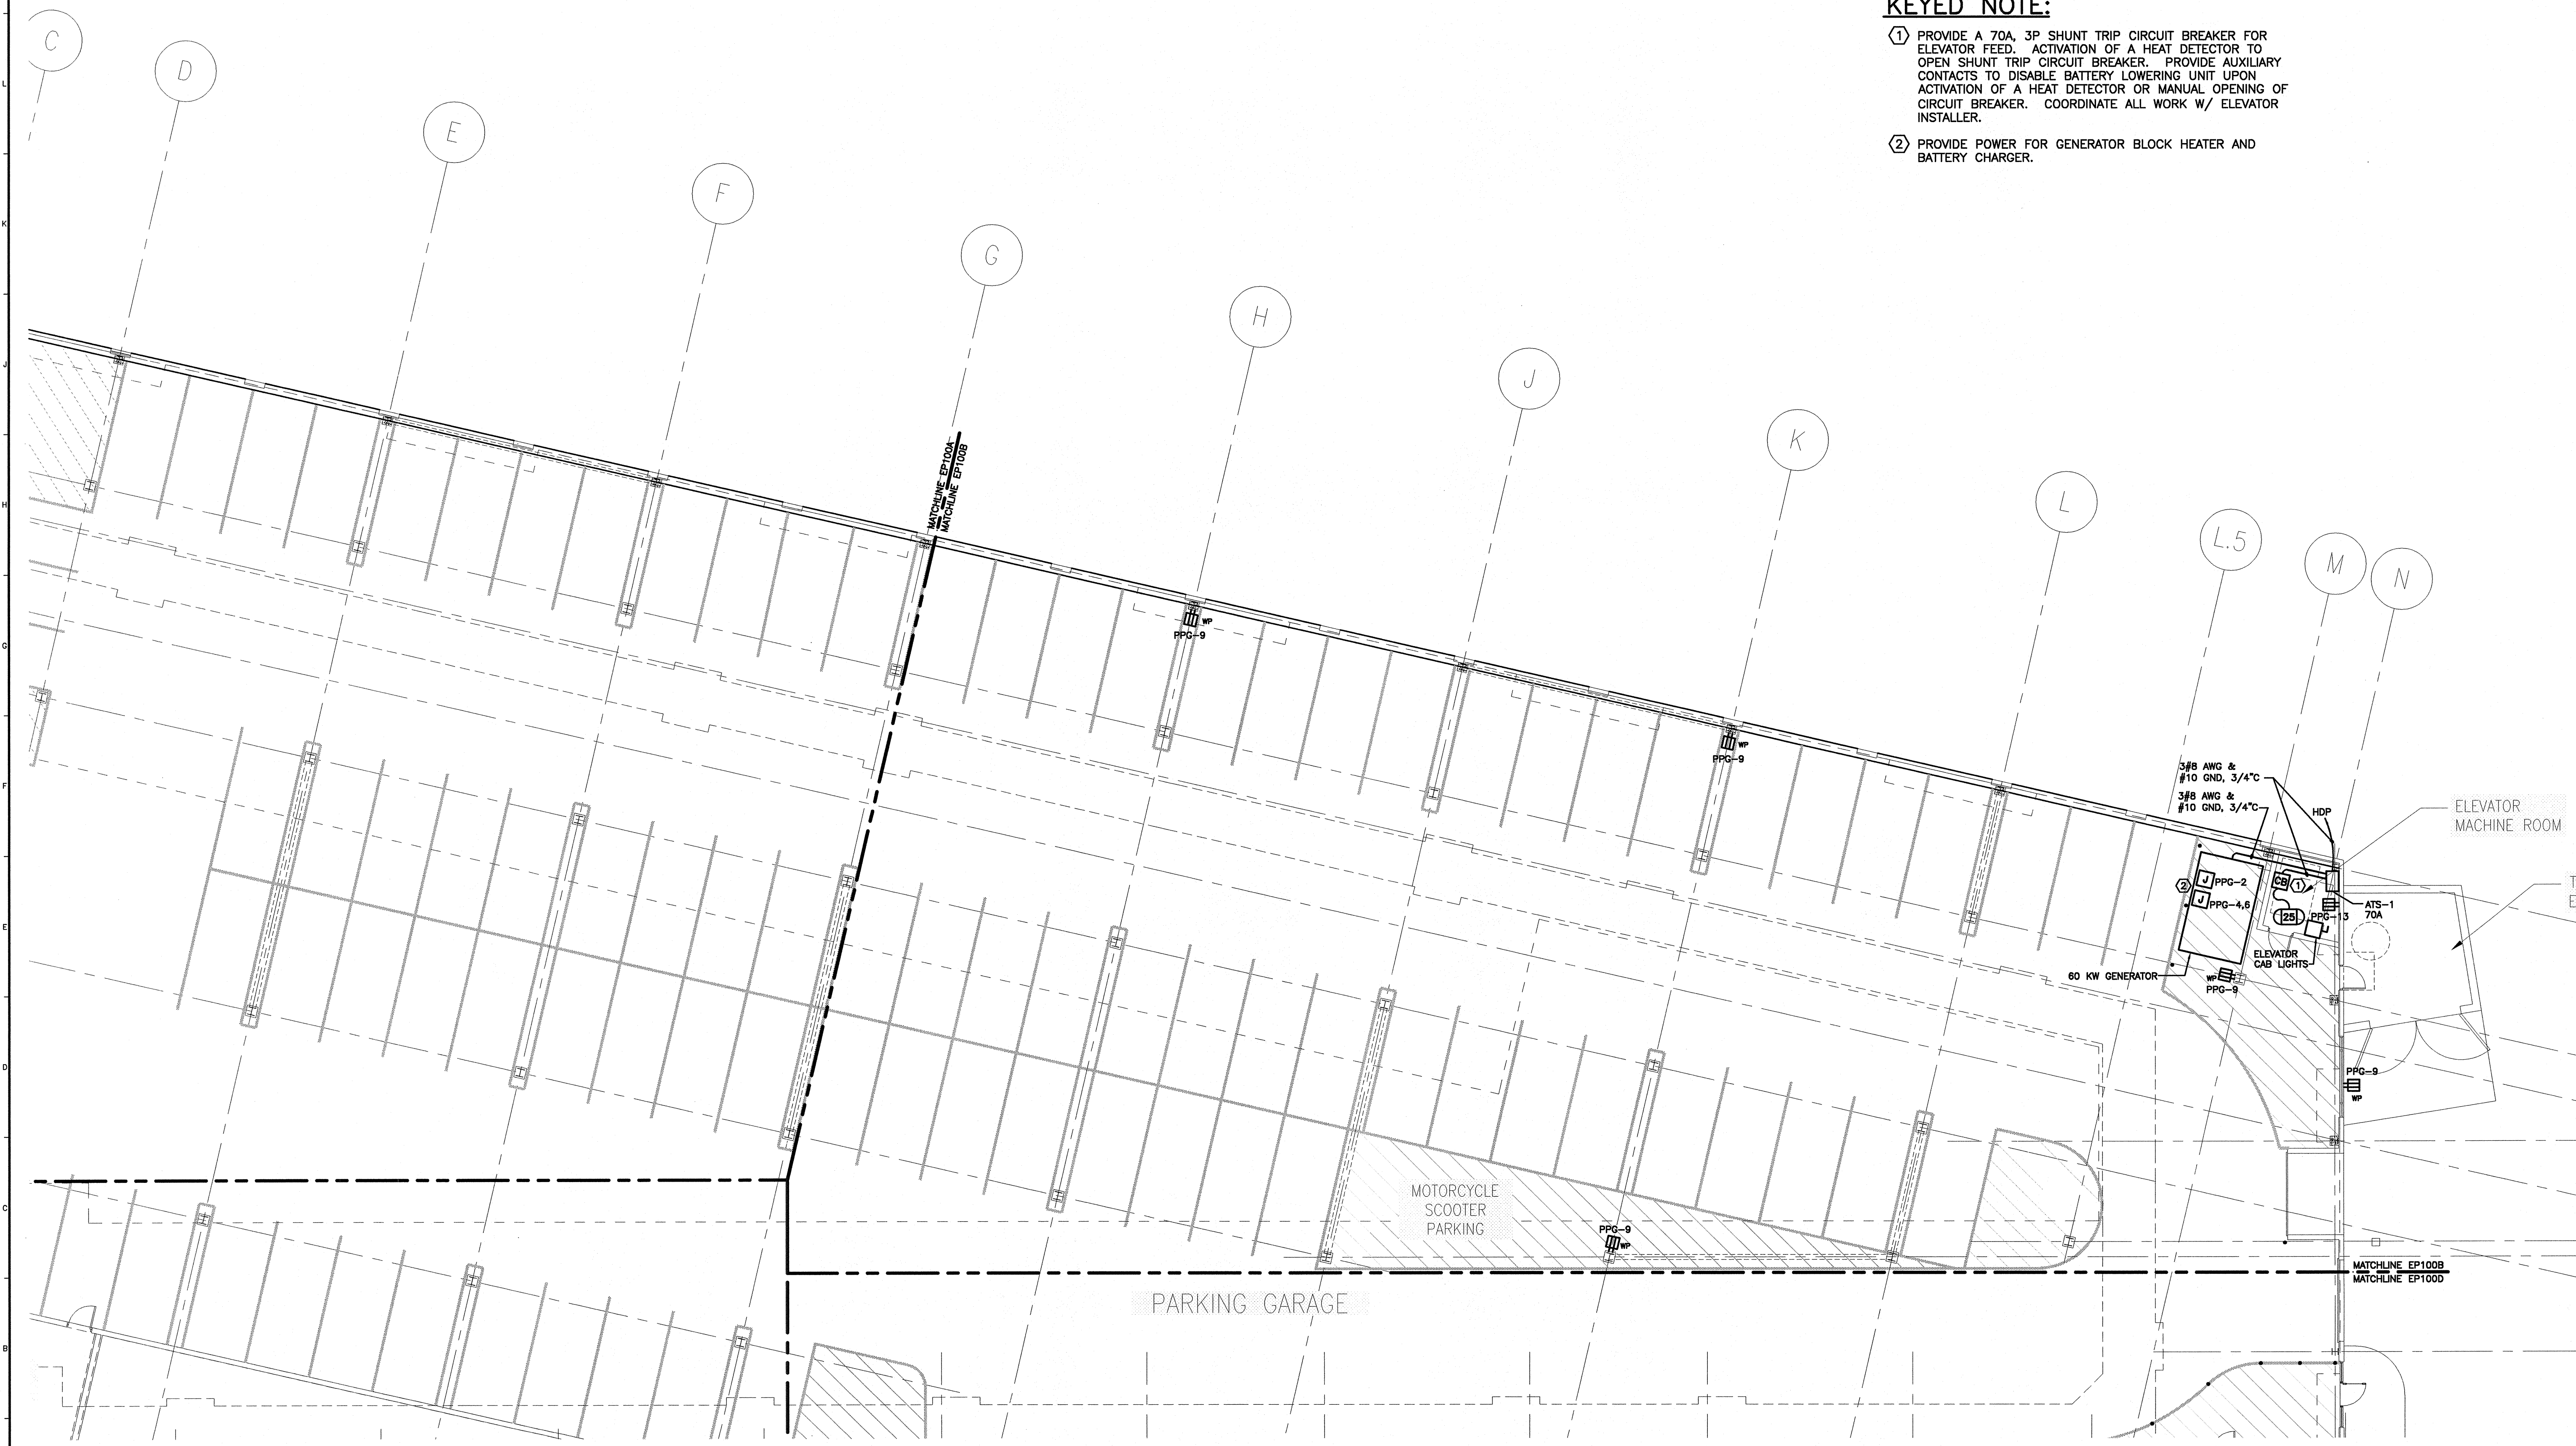

**BAYSIDE VILLAGE
 STUDENT HOUSING COMPLEX**
 PORTLAND, ME

PROJECT TITLE:
 CURRENT ISSUE STATUS:
**ISSUED FOR CONSTRUCTION
 9-14-07**

REV	DESCRIPTION	DATE
0	ISSUED FOR CONSTRUCTION	9-14-07

GRAPHIC SCALE:
 0' 1'

SCALE: 1/8"=1'-0"
 PROJECT MANAGER: DJT
 JC/DRAWN BY: CDS
 A/E OF RECORD: DJT
 CAD FILE: EP100B-07125
 PROJECT NO: 07125
 DATE: 9-14-07

SHEET TITLE:
**LOWER LEVEL
 POWER PLAN B**

SHEET No.
EP100B

A1 LOWER LEVEL PLAN

1/8"=1'-0"