




E.S. BOULOS CO
ELECTRICAL CONTRACTORS

45 BRADLEY DRIVE
WESTBROOK, ME 04092
TEL: (207) 464-3706
FAX: (207) 464-1833

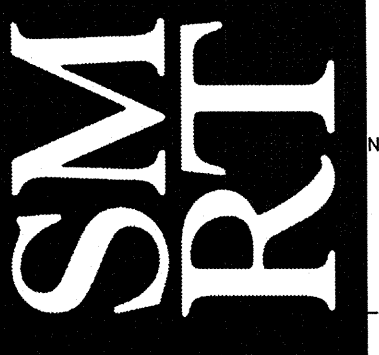

ARCHITECTURE ENGINEERING PLANNING
SMART
144 Fore Street, P.O. Box 618
Portland, Maine 04104
tel. (207) 772-3846
fax. (207) 772-1070

DIRECTORY	kVA LOAD			CKT NO.	BKR AMPS	A B C	BKR AMPS	CKT NO.	kVA LOAD			DIRECTORY	
	A	B	C						A	B	C		
EXHAUST FANS EF-1,2	1.2	1.2		1	15			2	0.6	0.6		EXHAUST FAN EF-3	
			1.2	3				4			0.6		
				5				6			0.6		
MAKE UP AIR UNIT MAU-1	2.1	2.1		7	20			8	2.1	2.1		MAKE UP AIR UNIT MAU-2	
			2.1	9				10			2.1		
SPACE				11				12			2.1		
SPACE				13				14					
SPACE				15				16					
SPACE				17				18					
SPACE				19				20					
SPACE				21				22					
SPACE				23				24					
SPACE				25				26					
SPACE				27				28					
SPACE				29				30					
SUB-TOTAL	3.3	3.3	3.3	NEUTRAL BUS			GROUND BUS			2.7	2.7	2.7	SUB-TOTAL
VOLTAGE: 480Y/277V 3 PHASE 4 WIRE 100 AMP BUS				TOTAL kVA A				6.0				PANEL NO.	
MAIN LUGS ONLY 100 AMP LUGS				TOTAL kVA B				6.0				HP4A	
MOUNTING: SURFACE				TOTAL kVA C				6.0				LOCATION	
SC RATING: 14,000 AIC				TOTAL kVA				18.0				MECH ROOM	
NOTES: *													

DIRECTORY	kVA LOAD			CKT NO.	BKR AMPS	A B C	BKR AMPS	CKT NO.	kVA LOAD			DIRECTORY	
	A	B	C						A	B	C		
EXHAUST FANS EF-4,5	1.2	1.2		1	15			2	0.6	0.6		EXHAUST FAN EF-6	
			1.2	3				4			0.6		
				5				6			0.6		
MAKE UP AIR UNIT MAU-3	2.1	2.1		7	20			8	2.1	2.1		MAKE UP AIR UNIT MAU-4	
			2.1	9				10			2.1		
SPACE				11				12			2.1		
SPACE				13				14					
SPACE				15				16					
SPACE				17				18					
SPACE				19				20					
SPACE				21				22					
SPACE				23				24					
SPACE				25				26					
SPACE				27				28					
SPACE				29				30					
SUB-TOTAL	3.3	3.3	3.3	NEUTRAL BUS			GROUND BUS			2.7	2.7	2.7	SUB-TOTAL
VOLTAGE: 480Y/277V 3 PHASE 4 WIRE 100 AMP BUS				TOTAL kVA A				6.0				PANEL NO.	
MAIN LUGS ONLY 100 AMP LUGS				TOTAL kVA B				6.0				HP4B	
MOUNTING: SURFACE				TOTAL kVA C				6.0				LOCATION	
SC RATING: 14,000 AIC				TOTAL kVA				18.0				MECH ROOM	
NOTES: *													

DIRECTORY	kVA LOAD			CKT NO.	BKR AMPS	A B C	BKR AMPS	CKT NO.	kVA LOAD			DIRECTORY	
	A	B	C						A	B	C		
EXTERIOR RECEPITS	0.4			1	20			2	1.1			CORRIDOR LTG	
CORRIDOR RECEPITS		0.9		3	20			4		0.7		CORRIDOR NIGHT LTG/ MECHANICAL	
RECEPITS ELECTRICAL/ MECHANICAL			0.8	5	20			6				SPARE	
SPARE				7	20			8				SPARE	
SPARE				9	20			10				SPARE	
SPARE				11	20			12				SPARE	
SPACE				13				14				SPACE	
SPACE				15				16				SPACE	
SPACE				17				18				SPACE	
SPACE				19				20				SPACE	
SPACE				21				22				SPACE	
SPACE				23				24				SPACE	
SPACE				25				26				SPACE	
SPACE				27				28				SPACE	
SPACE				29				30				SPACE	
SUB-TOTAL	0.4	0.9	0.8	NEUTRAL BUS			GROUND BUS			1.1	0.7	0.0	SUB-TOTAL
VOLTAGE: 208Y/120V 3 PHASE 4 WIRE 100 AMP BUS				TOTAL kVA A				1.5				PANEL NO.	
MAIN LUGS ONLY 100 AMP LUGS				TOTAL kVA B				1.8				PP1A	
MOUNTING: SURFACE				TOTAL kVA C				0.8				LOCATION	
SC RATING: 10,000 AIC				TOTAL kVA				3.9				MECH RM	
NOTES: 1. PROVIDE WITH FEED THROUGH LUGS													

DIRECTORY	kVA LOAD			CKT NO.	BKR AMPS	A B C	BKR AMPS	CKT NO.	kVA LOAD			DIRECTORY	
	A	B	C						A	B	C		
RECEPITS CORRIDOR/ EXIT/ MECH	0.9			1	20			2	0.8			LTG CORRIDOR	
RECEPITS CORRIDOR/ JANITOR		0.9		3	20			4		0.6		LTG CORRIDOR/ MECH. JANITOR	
RECEPITS OFFICE/ EXTERIOR			0.8	5	20			6		0.9		LTG CORRIDOR	
RECEPITS OFFICE	0.6			7	20			8	1.0			LTG CORRIDOR/ LOUNGE	
RECEPITS CORRIDOR/ MECH		0.9		9	20			10		1.1		NIGHT LTG CORR/ LOUNGE, OFFICE LTG	
RECEPITS STUDY LOUNGE			0.8	11	20			12		1.0		COUNTER RECEIPT LOUNGE	
VENDING RECEIPT LOUNGE	1.0			13	20			14	1.0			REFRIGERATOR LOUNGE	
VENDING RECEIPT LOUNGE		1.0		15	20			16		1.0		HVAC CONTROLS	
COUNTER RECEIPT LOUNGE			1.0	17	20			18				SPARE	
SPACE				19				20				SPARE	
SPACE				21				22				SPARE	
SPACE				23				24				SPARE	
SPACE				25				26				SPARE	
SPACE				27				28				SPARE	
SPACE				29				30				SPARE	
SUB-TOTAL	2.5	2.8	2.6	NEUTRAL BUS			GROUND BUS			2.8	2.7	1.9	SUB-TOTAL
VOLTAGE: 208Y/120V 3 PHASE 4 WIRE 225 AMP BUS				TOTAL kVA A				5.3				PANEL NO.	
MAIN BREAKER 150 AMP TRIP				TOTAL kVA B				5.5				PP1B	
MOUNTING: SURFACE				TOTAL kVA C				4.5				LOCATION	
SC RATING: 10,000 AIC				TOTAL kVA				15.3				MECH RM	
NOTES: 1. PROVIDE WITH FEED THROUGH LUGS													

DIRECTORY	kVA LOAD			CKT NO.	BKR AMPS	A B C	BKR AMPS	CKT NO.	kVA LOAD			DIRECTORY	
	A	B	C						A	B	C		
RECEPITS CORRIDORS	1.1			1	20			2	0.7			CORRIDOR NIGHT LTG/ MECHANICAL	
RECEPITS ELEC/ MECHANICAL		0.8		3	20			4				SPARE	
CORRIDOR LTG			1.0	5	20			6				SPARE	
SPARE				7	20			8				SPARE	
SPARE				9	20			10				SPARE	
SPARE				11	20			12				SPARE	
SPACE				13				14				SPACE	
SPACE				15				16				SPACE	
SPACE				17				18				SPACE	
SPACE				19				20				SPACE	
SPACE				21				22				SPACE	
SPACE				23				24				SPACE	
SPACE				25				26				SPACE	
SPACE				27				28				SPACE	
SPACE				29				30				SPACE	
SUB-TOTAL	1.1	0.8	1.0	NEUTRAL BUS			GROUND BUS			0.7	0.0	0.0	SUB-TOTAL
VOLTAGE: 208Y/120V 3 PHASE 4 WIRE 100 AMP BUS				TOTAL kVA A				1.8				PANEL NO.	
MAIN LUGS ONLY 100 AMP LUGS				TOTAL kVA B				0.8				PP1C	
MOUNTING: SURFACE				TOTAL kVA C				1.0				LOCATION	
SC RATING: 10,000 AIC				TOTAL kVA				3.6				MECH RM	
NOTES: 1. PROVIDE WITH FEED THROUGH LUGS													

DIRECTORY	kVA LOAD			CKT NO.	BKR AMPS	A B C	BKR AMPS	CKT NO.	kVA LOAD			DIRECTORY	
	A	B	C						A	B	C		
RECEPITS CORRIDOR	0.9			1	20			2	0.7			LTG CORRIDOR/ MECHANICAL	
RECEPITS ELECTRICAL/ MECH		0.8		3	20			4				SPARE	
CORRIDOR LTG			1.1	5	20			6				SPARE	
SPARE				7	20			8				SPARE	
SPARE				9	20			10				SPARE	
SPARE				11	20			12				SPARE	
SPACE				13				14				SPACE	
SPACE				15				16				SPACE	
SPACE				17				18				SPACE	
SPACE				19				20				SPACE	
SPACE				21				22				SPACE	
SPACE				23				24				SPACE	
SPACE				25				26				SPACE	
SPACE				27				28				SPACE	
SPACE				29				30				SPACE	
SUB-TOTAL	0.9	0.8	1.1	NEUTRAL BUS			GROUND BUS			0.7	0.0	0.0	SUB-TOTAL
VOLTAGE: 208Y/120V 3 PHASE 4 WIRE 100 AMP BUS				TOTAL kVA A				1.6				PANEL NO.	
MAIN LUGS ONLY 100 AMP LUGS				TOTAL kVA B				0.8				PP2A	
MOUNTING: SURFACE				TOTAL kVA C				1.1				LOCATION	
SC RATING: 10,000 AIC				TOTAL kVA				3.5				MECH RM	
NOTES: 1. PROVIDE WITH FEED THROUGH LUGS													

DIRECTORY	kVA LOAD			CKT NO.	BKR AMPS	A B C	BKR AMPS	CKT NO.	kVA LOAD			DIRECTORY
	A	B	C						A	B	C	
RECEPITS CORRIDOR/ MECH	0.8			1	20			2	0.8			LTG CORRIDOR
RECEPITS CORRIDOR/ JANITOR		0.8		3	20			4		0.7		LTG CORRIDOR/ MECHANICAL
RECEPITS OFFICE			0.8	5	20			6		0.9	</	