

HEADER SCHEDULE			
MARK	HEADER SIZE	JACK STUDS	KING STUDS
2H1	(3)2x12	(4)2x6	(2)2x6
2H2	(3)2x12	(5)2x6	(2)2x6
2H3	(2)2x8	(2)2x6	(2)2x6
2H4	(2)1 3/4x7 1/4 LVL	(3)2x6	(2)2x6
2H5	(2)1 3/4x11 7/8 LVL	(2)2x6	(2)2x6
2H6	(3)1 3/4x11 7/8 LVL	(3)2x6	(3)2x6


SECOND FLOOR BEAM SCHEDULE		
MARK	BEAM SIZE	POST (EA END, U.N.O.)
2B1	(2)1 3/4x9 1/2 LVL	(5)2x6
2B2	(3)1 3/4x14 LVL	SEE PLAN

SECOND FLOOR FRAMING PLAN
1/16"=1'-0"

NOTES:

- TOP OF SUBFLOOR EL 124'-8".
- INDICATES SPAN DIRECTION OF FLOOR SHEATHING.
- TYPICAL HEADER IN EXTERIOR WALL SHALL BE 2H3, U.N.O.
- G.C. RESPONSIBLE FOR COORDINATING FRAMING LAYOUT W/ MECHANICAL AND PLUMBING CHASES, DROPS, ETC. TRUSS SPACING MAY BE MODIFIED AS REQD WHILE MAINTAINING MAXIMUM TRUSS SPACING INDICATED.
- INDICATES SHEARWALL. REFER TO SHEARWALL SCHEDULE FOR SHEATHING AND NAILING REQUIREMENTS.
- EXTERIOR WALLS SHALL BE SHEATHED WITH 1/2" APA RATED SHEATHING NAILED WITH 8d NAILS @ 4" O.C., U.N.O.
- COORDINATE EXPANSION JOINT DETAILS W/ ARCH.
- PROVIDE CMU LINTELS AT OPENINGS IN STAIR AND ELEVATOR SHAFTS. SEE TYP CMU DETAILS, DWG S2.1 FOR ADDL INFO.
- SP INDICATES STEEL POST. SEE DWG S1.2 FOR SIZE.

BEARING WALL SCHEDULE		
MARK	HEADER SIZE	NOTES
BW-1	2x6 @24" O.C.	BLKG @4'-0" O.C. MAX VERT
BW-2	2x6 @24" O.C.	WHERE WALL IS NOT SHEATHED, BLOCK @3'-4" O.C. MAX VERT
BW-3	(2)2x6 @24" O.C.	BLKG @4'-0" O.C. MAX VERT
BW-4	(2)2x6 @24" O.C.	WHERE WALL IS NOT SHEATHED, BLOCK @3'-4" O.C. MAX VERT
BW-5	(3)2x6 @24" O.C.	BLKG @4'-0" O.C. MAX VERT

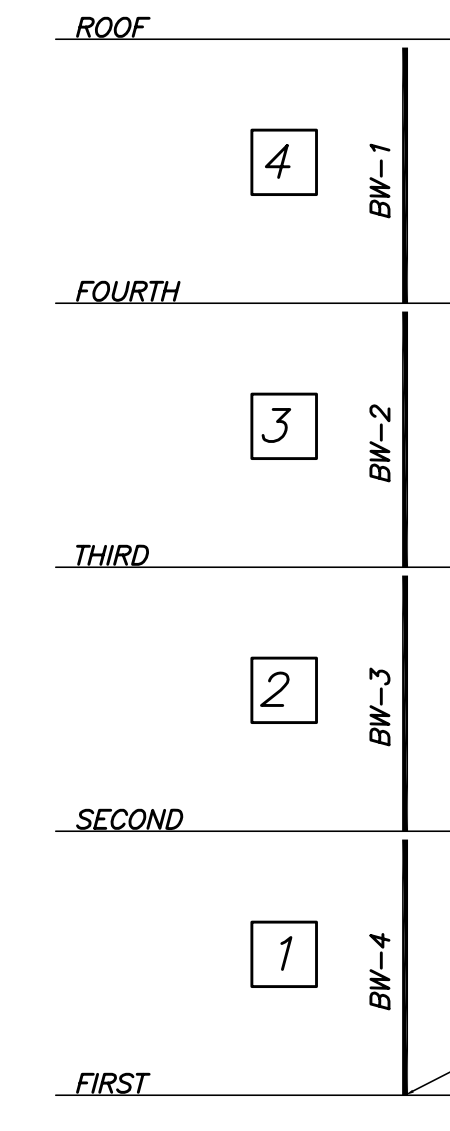

TYP WALL STUDS SCHEMATIC U.N.O. IN PLAN

NOTE: THIS STUD CONFIGURATION TO BE USED AT ALL EXTERIOR WALLS & INTERIOR BEARING WALLS. AT ALL OTHER LOCATIONS USE (1)2x6 @ 24" O.C. STUDS ARE REQD TO LINE UP DIRECTLY BELOW TRUSS BEARINGS & FLOOR-TO-FLOOR

