


Filename:

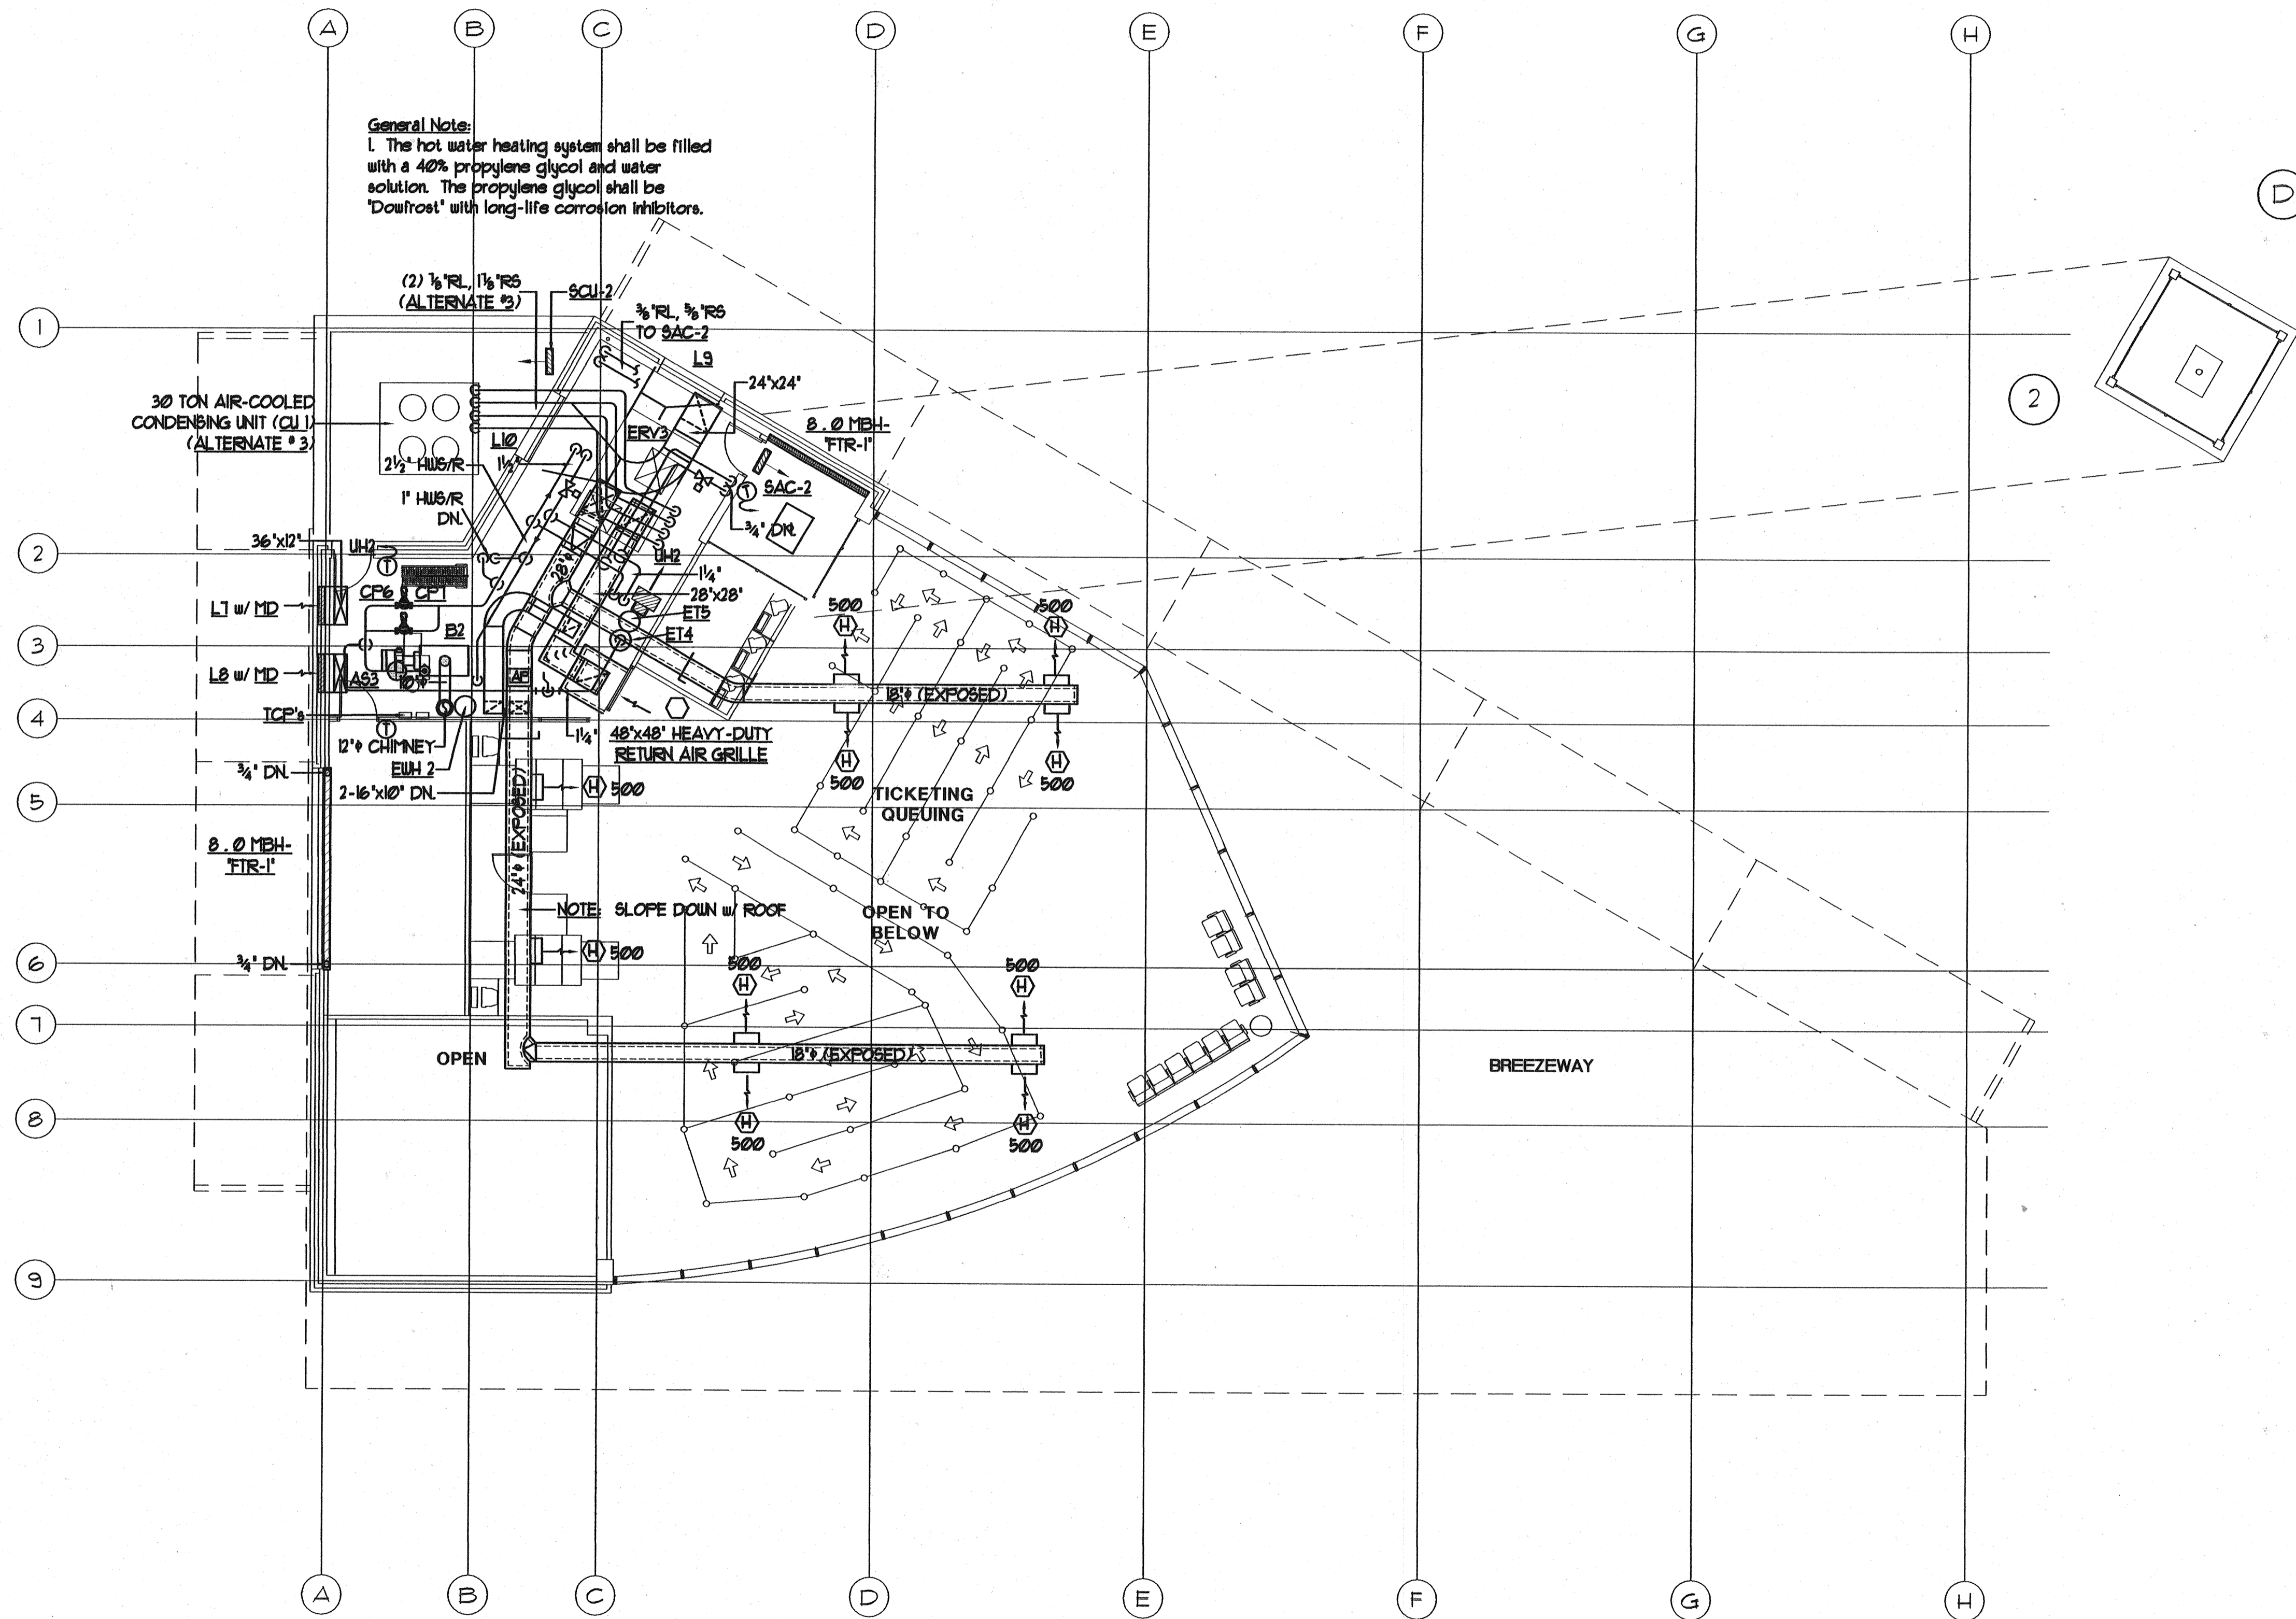


**General Note:**  
 1. The hot water heating system shall be filled with a 40% propylene glycol and water solution. The propylene glycol shall be 'Dowfrost' with long-life corrosion inhibitors.

**RECEIVING STATION MEZZANINE LEVEL PLAN**  
 SCALE: 1/8"=1'-0"

**BENNETT ENGINEERING**  
 CONSULTING ENGINEERS

STATE OF MAINE  
 DEPARTMENT OF TRANSPORTATION  
 PROJECT NUMBER 009215.00  
 PIN 009215.00

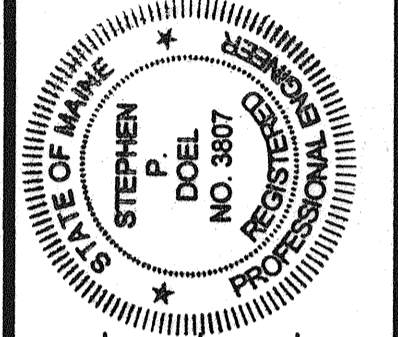

Signature: *Stephen P. Doel*  
 P.E. NUMBER: 3807  
 DATE: 10/15/04

PROJ. MANAGER	PAUL POTTLE	DATE
DESIGN-DETAILED	SMR	10/05/04
CHECKED-REVIEWED	SMR	10/05/04
DESIGN-DETAILED	SMR	
DESIGN-DETAILED	SMR	
REVISIONS 1		
REVISIONS 2		
REVISIONS 3		
REVISIONS 4		
FIELD CHANGES		

CITY OF PORTLAND  
 OCEAN GATEWAY PHASE 1  
 RECEIVING STATION  
 HVAC MEZZANINE PLAN

H101-R