



75 ATLANTIC STREET

CITY OF PORTLAND, MAINE
Department of Building Inspection

75 Atlantic Street

March 8, 1973

Mr. Ralph S. Nappi
75 Atlantic Street

Dear Mr. Nappi:

C
O
P
Y

A motor vehicle is being parked on the left side of this building at the above named location as you face it from the street. It is necessary that you apply for a certificate of occupancy here at this office (fee \$5.00) to locate this motor vehicle at this location as we have not given permission in the past to park on this side of the building. A motor vehicle may be parked here as long as it is 5 feet from the lot line (Section 602.14F) of the Zoning Ordinance, if the car is closer than 50 feet to the street line. A check of your property shows that this can be done. If you will apply for a certificate of occupancy at this office with a plot plan showing the location of a parking space, 8 feet by 18 feet on your lot on this side of the building, a distance of 5 feet from the lot line and its location to the house, we will be able to check it out for compliance with the Zoning Ordinance.

If you have any further questions on this matter please do not hesitate to call me at this office at City Hall.

Very truly yours,

A. Allan Soule
Assistant Director

AAS:m

CITY OF PORTLAND, MAINE

Department of Building Inspection

75 Atlantic Street

February 2, 1973

C
O
P
Y
Robert Haley
91 Atlantic Street

Dear Mr. Haley:

I have checked out the parking of a car on the left hand side of the building at the above named location. This motor vehicle was approximately 4 feet from the wire fence which I presume is the side lot line. It could have been moved and set closer to the house so that it would be 5 feet from the line, required under Section 602.14F of the Zoning Ordinance which says, in part, "the motor vehicle shall not be located closer than 50 feet to any street line if less than 5 feet from any lot line", and shall not be closer to any street line than the required depth of the front yard to the same lot." The parking of this car would seem to meet this requirement.

If there is some fact that I have overlooked, then please contact me here in this office in Room 113, City Hall.

Very truly yours,

A. Allan Soule
Assistant Director

AAS:m



CITY OF PORTLAND, MAINE
 DEPARTMENT OF BUILDING INSPECTION
COMPLAINT

Location:
75 Atlantic St

INSPECTION COPY

COMPLAINT NO. 35/73

Date Received March 8th, 73

Location 75 Atlantic St Use of Building _____

Owner's name and address 75 Atlantic St Ralph S Nappi Telephone 774-0293

Tenant's name and address _____ Telephone _____


Complainant's name and address Mr Ben Haley Telephone _____

Description: Parking car along side of the house, permit needed.

NOTES: 3/8/73 Talked with Al, about this, he said he would take care of it.

The owner said he was coming in to, take out a permit etc.

6-29-73 - Mr. Nappi has taken care of this.



1/ *Robert S. & Gloria A. Maffei*

16-3-16

3-30-73
2-16-73

FOLLOW UP --- ALLAN

774-0293

PARKING CAR --- 75 Atlantic St.

(~~Van~~ Haley)

(Rt. 91 Atlantic)

3/8/73 Talked with AH, about this,
said he would take care of it -
The gentleman is coming in to
apply for a c/o. to keep the car
there.

AH,

75 Atlantic Street

March 8, 1973

Mr. Ralph S. Nappi
75 Atlantic Street

Dear Mr. Nappi:

A motor vehicle is being parked on the left side of this building at the above named location as you face it from the street. It is necessary that you apply for a certificate of occupancy here at this office (fee \$5.00) to locate this motor vehicle at this location as we have not given permission in the past to park on this side of the building. A motor vehicle may be parked here as long as it is 5 feet from the lot line (Section 602.142) of the Zoning Ordinance, if the car is closer than 50 feet to the street line. A check of your property shows that this can be done. If you will apply for a certificate of occupancy at this office with a plot plan showing the location of a parking space, 8 feet by 18 feet on your lot on this side of the building, a distance of 5 feet from the lot line and its location to the house, we will be able to check it out for compliance with the Zoning Ordinance.

If you have any further questions on this matter please do not hesitate to call me at this office at City Hall.

Very truly yours,

A. Allan Soule
Assistant Director

AAS:m

file

75 Atlantic Street

February 2, 1973

Robert Haley
91 Atlantic Street

Dear Mr. Haley:

I have checked out the parking of a car on the left hand side of the building at the above named location. This motor vehicle was approximately 4 feet from the wire fence which I presume is the side lot line. It could have been moved and set closer to the house so that it would be 5 feet from the line, required under Section 602.14F of the Zoning Ordinance which says, in part, "the motor vehicle shall not be located closer than 50 feet to any street line if less than 5 feet from any lot line", and shall not be closer to any street line than the required depth of the front yard to the same lot." The parking of this car would seem to meet this requirement.

If there is some fact that I have overlooked, then please contact me here in this office in Room 113, City Hall.

Very truly yours,

A. Allan Soule
Assistant Director

AAS:m



FILL IN AND SIGN WITH INK

APPLICATION FOR PERMIT FOR HEATING, COOKING OR POWER EQUIPMENT

PERMIT ISSUED

JUL 17 1972

0848

CITY of PORTLAND

Portland, Maine, July 17, 1972

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location 75 Atlantic St. Use of Building Dwelling No. Stories New Building Existing Name and address of owner of appliance Ralph Nappi Installer's name and address Breggy Oil, 64 Congress St. Telephone

General Description of Work

To install complete oil fired heating system replacing steam (forced hot water)

IF HEATER, OR POWER BOILER

Location of appliance basement Any burnable material in floor surface or beneath? no Kind of fuel? oil Minimum clearance to burnable material, from top of appliance or casing top of furnace 3' From front of appliance 10' From sides or back of appliance 3' Size of chimney flue 8x12 Other connections to same flue no If gas fired, how vented? Rated maximum demand per hour Will sufficient fresh air be supplied to the appliance to insure proper and safe combustion? yes

IF OIL BURNER

Name and type of burner Wayne - gun type Labelled by underwriters laboratories? yes Will operator be always in attendance? no Does oil supply line feed from top of tank? bottom Type of floor beneath burner concrete Height of vent pipe 1 1/2" Location of oil storage basement Number and capacity of tanks 1 - 275 Low water shut off Make No Will all tanks be more than five feet from any flame? yes How many tanks enclosed? Total capacity of any existing storage tanks for furnace burners

IF COOKING APPLIANCE

Location of appliance Any burnable material in floor surface or beneath? If so, how protected? Height of Legs, if any Skirting at bottom of appliance? Distance to combustible material from top of appliance? From front of appliance From sides and back From top of smoke pipe Size of chimney flue Other connections to same flue Is hood to be provided? If so, how vented? Forced or gravity? If gas fired, how vented? Rated maximum demand per hour

MISCELLANEOUS EQUIPMENT OR SPECIAL INFORMATION

Amount of fee enclosed? \$10. (\$2.00 for one heater, etc. \$1.00 additional for each additional heater, etc. in same building at same time.)

APPROVED: O.K. E.B. 7/17/72

Will there be in charge of the above work a person competent to see that the State and City requirements pertaining thereto are observed? yes

CS 300

INSPECTION COPY

Signature of Installer

Breggy Oil L.W. Jordan #2357

CITY OF PORTLAND, MAINE
Application for Permit to Install Wires

Permit No. 5908.1
 Issued July 17, 1972
 Portland, Maine

To the City Electrician, Portland, Maine:

The undersigned hereby applies for a permit to install wires for the purpose of conducting electric current, in accordance with the laws of Maine, the Electrical Ordinance of the City of Portland, and the following specifications:

(This form must be completely filled out - Minimum Fee, \$1.00)

Owner's Name and Address RALPH NAEMI Tel. _____
 Contractor's Name and Address BREYER Oil & Electric Tel. 772-8631
 Location 75 ATLANTIC ST Use of Building RES
 Number of Families 2 Apartments _____ Stores _____ Number of Stories _____
 Description of Wiring: New Work Additions _____ Alterations

Pipe _____ Cable _____ Metal Molding _____ BX Cable _____ Plug Molding (No. of feet) _____
 No. Light Outlets _____ Plugs _____ Light Circuits _____ Plug Circuits _____
 FIXTURES: No. _____ Fluor. or Strip Lighting (No. feet) _____
 SERVICE: Pipe _____ Cable _____ Underground _____ No. of Wires _____ Size _____
 METERS: Relocated _____ Added _____ Total No. Meters _____
 MOTORS: Number _____ Phase _____ H. P. _____ Amps _____ Volts _____ Starter 1/8
 HEATING UNITS: Domestic (Oil) No. Motors 1 Phase 1 H.P. _____
 Commercial (Oil) _____ No. Motors _____ Phase _____ H.P. _____
 Electric Heat (No. of Rooms) _____

APPLIANCES: No. Ranges _____ Watts _____ Brand Feeds (Size and No.) _____
 Elec. Heaters _____ Watts _____
 Miscellaneous _____ Watts _____ Extra Cabinets or Panels _____
 Transformers _____ Air Conditioners (No. Units) _____ Signs (No. Units) _____
 Will commence _____ 19 _____ Ready to cover in _____ 19 _____ Inspection _____ 19 _____
 Amount of Fee \$ 2.00

Signed Lloyd W. Jordan
Breyer Oil

DO NOT WRITE BELOW THIS LINE

SERVICE	METER	GROUND			
VISITS: 1	2	3	4	5	6
7	8	9	10	11	12

REMARKS:

INSPECTED BY [Signature]
 (OVER)

LOCATION Atlantic St. 75-
 INSPECTION DATE 7/21/72
 WORK COMPLETED 7/21/72
 TOTAL NO. INSPECTIONS
 REMARKS:

FEE S FOR WIRING PERMITS EFFECTIVE JULY 31, 1963

WIRING

1 to 30 Outlets	\$ 2.00
31 to 60 Outlets	3.50
Over 60 Outlets, each Outlet05

(Each twelve feet or fraction thereof of fluorescent lighting or any type of plug molding will be classed as one outlet).

SERVICES

Single Phase	2.00
Three Phase	4.00

MOTORS

Not exceeding 50 H.P.	3.00
Over 50 H.P.	4.00

HEATING UNITS

Domestic (Oil)	2.00
Commercial (Oil)	4.00
Electric Heat (Each Room)75

APPLIANCES

Ranges, Cooking Tops, Ovens, Water Heaters, Disposals, Built-in Dishwashers, Dryers, and any permanent built-in appliance -- each unit ..	1.50
---	------

MISCELLANEOUS

Temporary Service, Single Phase	1.00
Temporary Service, Three Phase	2.00
Circuses, Carnivals, Fairs, etc.	10.00
Meters, relocate	1.00
Distribution Cabinet or Panel, per unit	1.00
Transformers, per unit	2.00
Air Conditioners, per unit	2.00
Signs, per unit	2.00

ADDITIONS

5 Outlets, or less	1.00
Over 5 Outlets, Regular Wiring Rates	

CITY OF PORTLAND, MAINE
 Application for Permit to Install Wires

Permit No. 54251
 Issued 8-27-70
Aug 27, 1970

To the City Electrician, Portland, Maine:

Portland, Maine

The undersigned hereby applies for a permit to install wires for the purpose of conducting electric current, in accordance with the laws of Maine, the Electrical Ordinance of the City of Portland, and the following specifications:

(This form must be completely filled out - Minimum Fee, \$1.00)

Owner's Name and Address Margaret Poggi Tel.
 Contractor's Name and Address Paul P. Threume Tel.
 Location 75 Atlantic St. Use of Building Dwelling
 Number of Families 2 Apartments Stores Number of Stories 2
 Description of Wiring: New Work Additions Alterations
30-amp change to 100 amp service
 Pipe . . . Cable . . . Metal Molding . . . BX Cable . . . Plug Molding (No. of feet) . . .
 No. Light Outlets . . . Plugs . . . Light Circuits . . . Plug Circuits . . .
 FIXTURES: No. Fluor. or Strip Lighting (No. feet)
 SERVICE: Pipe . . . Cable . . . Underground . . . No. of Wires . . . Size . . .
 METERS: Relocated . . . Added . . . Total No. Meters . . .
 MOTORS: Number . . . Phase . . . H. P. . . . Amps . . . Volts . . . Starter . . .
 HEATING UNITS: Domestic (Oil) . . . No. Motors . . . Phase . . . H.P. . . .
 Commercial (Oil) . . . No. Motors . . . Phase . . . H.P. . . .
 Electric Heat (No. of Rooms)
 APPLIANCES: No. Ranges . . . Watts . . . Brand Feeds (Size and No.) . . .
 Elec. Heaters . . . Watts . . .
 Miscellaneous . . . Watts . . . Extra Cabinets or Panels . . .
 Transformers 2 Air Conditioners (No. Units) . . . Signs (No. Units) will call
 Will commence work Thursday 1970 Ready to cover in . . . 1970 Inspection will call
 Amount of Fee \$ 2.00


Signed Paul P. Threume

DO NOT WRITE BELOW THIS LINE

SERVICE	METER	GROUND
VISITS: 1 2	3 4	5 6
7 8	9 10	11 12

REMARKS:

INSPECTED BY Ju. H. T.
 (OVER)

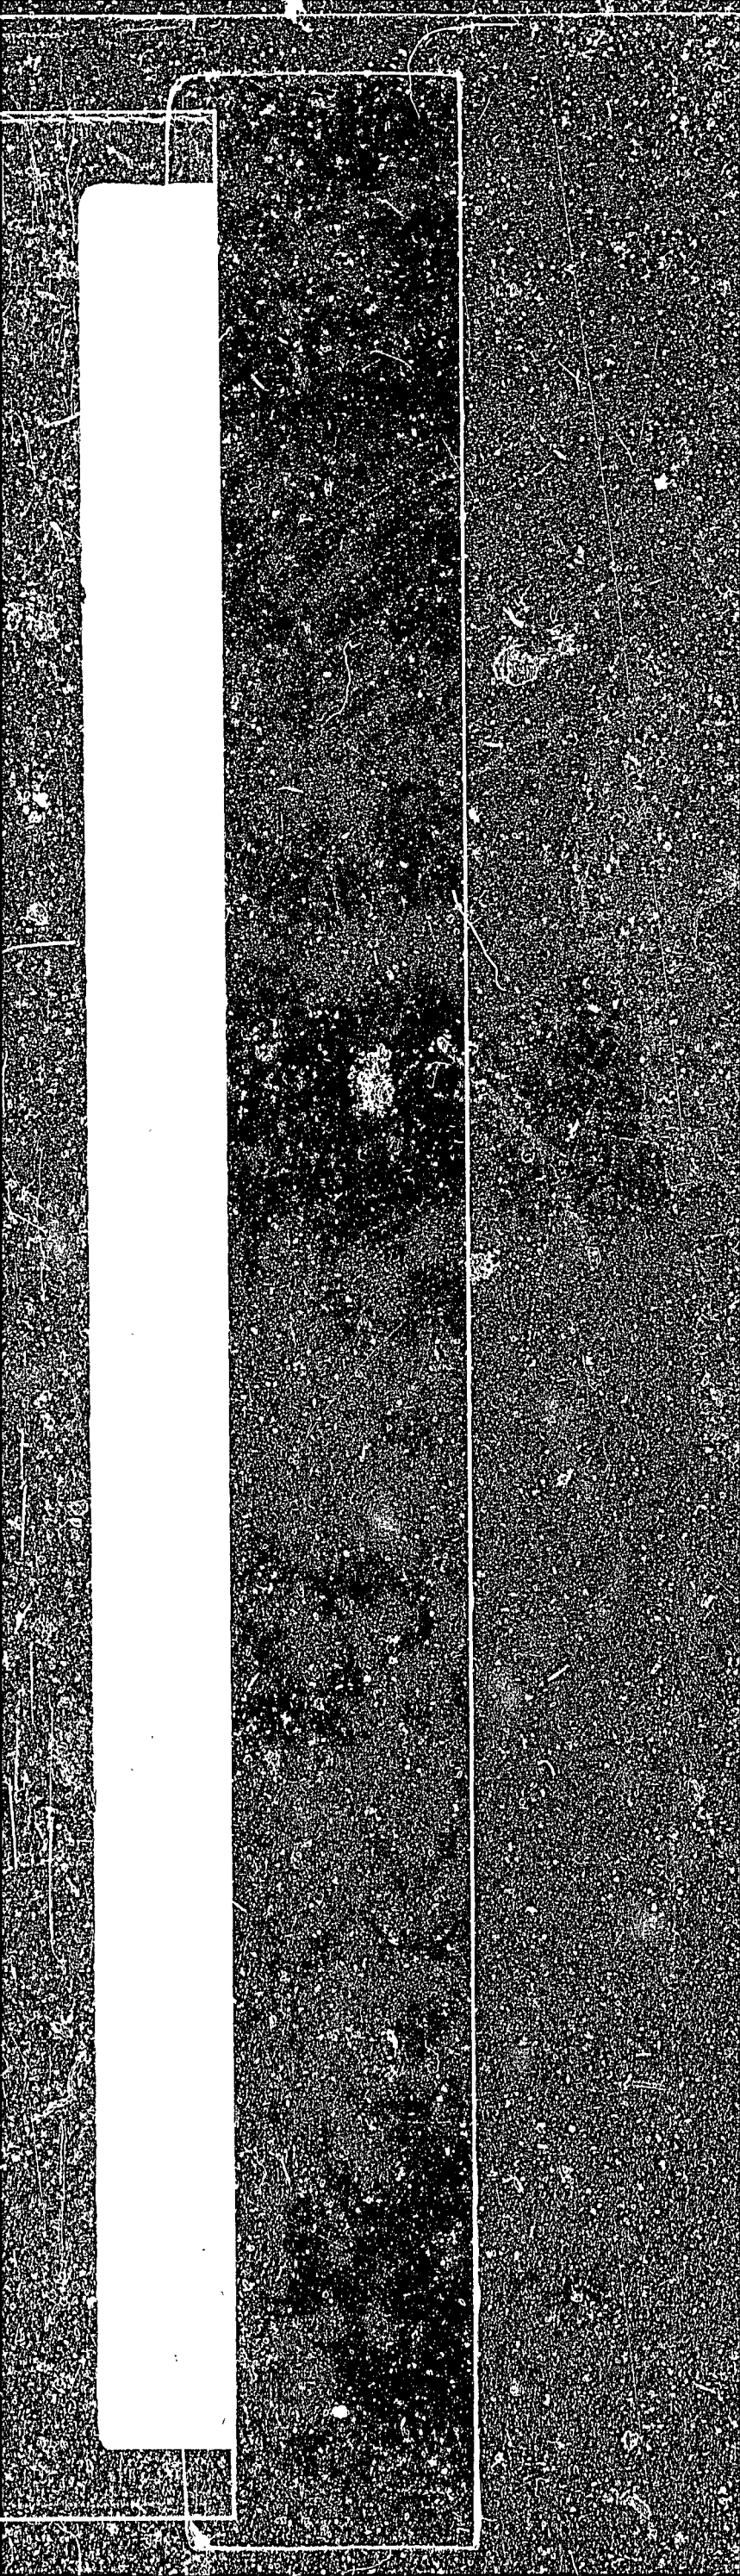

LOCATION Atlantic S.
 INSPECTION DATE 8/31/68
 WORK COMPLETED 8/31/68
 TOTAL, NO. INSPECTIONS
 REMARKS:

FEE SCHEDULE FOR WIRING PERMITS EFFECTIVE JULY 31, 1968

WIRING	
1 to 30 Outlets	\$ 2.00
31 to 60 Outlets	3.00
Over 60 Outlets, each Outlet05
(Each twelve feet or fraction thereof of fluorescent lighting or any type of plug molding will be classed as one outlet).	
SERVICES	
Single Phase	2.00
Three Phase	4.00
MOTORS	
Not exceeding 50 H.P.	3.00
Over 50 H.P.	4.00
HEATING UNITS	
Domestic (Oil)	2.00
Commercial (Oil)	4.00
Electric Heat (Each Room)75
APPLIANCES	
Ranges, Cooking Tops, Ovens, Water Heaters, Disposals, Built-in Dishwashers, Dryers, and any permanent built-in appliance — each unit	1.50
MISCELLANEOUS	
Temporary Service, Single Phase	1.00
Temporary Service, Three Phase	2.00
Circuses, Carnivals, Fairs, etc.	10.00
Meters, relocate	1.00
Distribution Cabinet or Panel, per unit	1.00
Transformers, per unit	2.00
Air Conditioners, per unit	2.00
Signs, per unit	2.00
ADDITIONS	
5 Outlets, or less	1.00
Over 5 Outlets, Regular Wiring Rates	

MAINE PRINTING CO., PORTLAND

CITY OF PORTLAND
HEALTH DEPARTMENT
HOUSING DIVISION



Loc. 75 Atlantic Street
Loc w/i S Manjoy (168)
Bldg Fire Elec Other
Issued September 28, 1966
Expires October 28, 1966

Mrs. Margaret Rozal
92 St. Lawrence Street
Portland, Maine

Madam:
Dear Sir:

On September 27, 1966 an examination was made of the premises located
at 75 Atlantic Street, Portland, Maine

Non-compliance with the ordinances relating to housing conditions was found as detailed below.
In accordance with the provisions of the above ordinance, you are hereby ordered to
correct these defects according to specifications within the time limits allowed. Failure to
comply with this notice will necessitate legal action.

Some repairs or improvements required will necessitate permits which are to be ob-
tained from the Building Inspector, Health, Fire or other City Departments. These must be ob-
tained before the work is started.

If any additional information is desired, visit or telephone the Housing Supervisor at
this Office, Tel. 774-8221, extension 226. Kindly notify this office as soon as all corrections
have been completed.

Very truly yours,
Boris A. Vanadzin, M.D.
Health Director

By _____
Housing Supervisor

VIOLATIONS & SPECIFICATIONS

Responsibility of Owner or Agent ** Responsibility of Occupant

STRUCTURAL

Repair and put in good order all dilapidated and hazardous parts of the structure as follows:

- a. Repair or replace the loose, worn, dilapidated and hazardous parts of the steps and railing of the side porch.
- b. Point up and seal the roof drain opening on the left side of the structure.
- c. Replace the missing downspouts for the left and right sides of the structure.
- d. Replace the missing baluster for the stairway in the front hall.
- e. Repair or replace the loose, worn or dilapidated moulding on the right side of the structure.
- f. Repair or replace the cracked joist under the rear porch floor on the third floor.
- g. Determine the reason and remedy the condition which causes the bulkhead door to close improperly.
- h. Repair or replace the loose, cracked or missing plaster on the ceiling in the cellar and rear halls from the first floor to the second floor.
- i. Repair or replace the loose, worn or missing treads for the steps in the rear hall from the first floor to the second floor.
- k. Determine the reason and remedy the condition which causes the gutters on the structure to be loose.
- l. Repair or replace the loose, worn or dilapidated treads for the stairway in the cellar.

- Determine the reason and remedy the condition which causes the ceiling to crack in the bedroom on the first floor.
- r. Replace the broken window panes in the bathroom on the first floor.
 - o. Putty the bedroom window in the first floor apartment.
 - p. Repair or replace the loose, cracked or missing plaster on the walls and ceilings of the storerooms and bedrooms on the third floor.
 - q. Replace the broken window panes in the bedroom on the third floor.
 - r. Repair or replace the dilapidated door jams in the kitchen on the second floor.
 - s. Make the bedroom door operable on the third floor.
 - t. Replace the missing door knobs in the storerooms and bedroom on the third floor.
 - u. Repair or replace the cracked panels in the bedroom and storeroom on the third floor.
 - w. Determine the reason and remedy the condition which causes the floorboards in the bedrooms on the third floor to be loose.
 - v. Repair or replace the loose, cracked or missing plaster on the wall in the hallway from the second to the third floor.

ELECTRICAL

Check and have repaired all defective electric wiring and electrical equipment throughout the structure.

- a. Replace the missing cover plate for the fixture in the front hall on the second floor.
- b. Repair or replace the defective switch for the first floor apartment.
- c. Install adequate artificial illumination in the hallway from the second to the third floor.

Our inspection reveals that the wiring is defective throughout the entire structure be thoroughly checked by a competent licensed electrician.

HEATING

- a. Install a clean-out door at the base of the rear chimney.

PLUMBING

- a. Properly cap the clean-out trap for the waste line in the front cellar.

OBSTACLES AND INSANITARY CONDITIONS

- a. Accomplish a general clean-up of the cellar by removing and properly disposing of all debris and loose plaster.

The above mentioned conditions are in violation of Chapter 307 of the Municipal Code of the City of Portland and must be corrected on or before October 28, 1966.

Re: 75 Atlantic Street

October 3, 1966

Mrs. D. Rozzi,
92 St. Lawrence St.
Portland, Maine

Dear Mrs. Rozzi:

At the request of the Urban Renewal Authority an electrical inspection was made of this property and the following electrical hazards were found:

Exposed switch at top of cellar stairs must be replaced.

Loose wires in cellar and junction boxes must be covered.

Oversize fuses in branch circuits must be removed and replaced with proper sizes.

This work must be done by a licensed electrician.

Very truly yours,

F. W. Herbert
Electrical Inspector

FWH/h

PERMIT TO INSTALL PLUMBING

PERMIT NUMBER 8669

Address: 75 Atlantic Street

Date Issued: 4-15-60
 PORTLAND PLUMBING INSPECTOR

Installation For: *Wm. Ernest J. [unclear]*

Owner of Bldg.: *Wm. Ernest J. [unclear]*

Owner's Address: 75 Atlantic Street

By: *[Signature]*
 APPROVED FIRST INSPECTION

Plumber: *Portland Plumbing Co.* Date: *4/18/60*

Date: 4/18/60

By: *[Signature]*
 APPROVED FINAL INSPECTION

- TYPE OF BUILDING
- COMMERCIAL
 - RESIDENTIAL
 - SINGLE
 - MULTI FAMILY
 - NEW CONSTRUCTION
 - REMODELING

NEW	REP'L	PROPOSED INSTALLATIONS	NUMBER	FEE
		SINKS		
		LAVATORIES		
		TOILETS		
		BATH TUBS		
		SHOWERS		
		DRAINS		
1		HOT WATER TANKS	3	1 \$2.00
		TANKLESS WATER HEATERS		
		GARBAGE GRINDERS		
		SEPTIC TANKS		
		HOUSE SEWERS		
		ROOF LEADERS (conn. to house drain)		
				Total 1 \$2.00

MAINE PRINTING CO., PORTLAND

CITY OF PORTLAND
HEALTH DEPARTMENT
HOUSING DIVISION



Loc. 75 Atlantic Street
Loc w/i S
Bldg. Fire Elec. Other x
Issued August 9, 1965
Expires September 9, 1965

Mrs. Margaret Rozzie
75 Atlantic Street
Portland, Maine

Dear ~~Mr.~~ Madam:
On February 18, 1965 an examination was made of the premises located
at 75 Atlantic Street, Portland, Maine

Non-compliance with the ordinances relating to housing conditions was found as detailed below.
In accordance with the provisions of the above ordinance, you are hereby ordered to
correct these defects according to specifications within the time limits allowed. Failure to
comply with this notice will necessitate legal action.
Some repairs or improvements required will necessitate permits which are to be ob-
tained from the Building Inspector, Health, Fire or other City Departments. These must be ob-
tained before the work is started.

If any additional information is desired, visit or telephone the Housing Supervisor at
this Office, Tel. 774-8221, extension 226. Kindly notify this office as soon as all corrections
have been completed.

Very truly yours,
Boris A. Vanadzian, M.D.
Health Director

By Jarvis C. [Signature]
Housing Supervisor

VIOLATIONS & SPECIFICATIONS

Responsibility of Owner or Agent ** Responsibility of Occupant

STRUCTURAL

- Repair and put in good order all dilapidated and hazardous parts of the structure as follows:
 - a. Repair or replace the loose, worn, dilapidated and hazardous downspout on the left side of the structure.
 - b. Repair or replace the loose, worn, or missing downspout on the right side of the structure.
 - c. Properly connect the disconnected downspout on the left front side of the structure.
 - d. Repair or replace the loose, worn, dilapidated and hazardous parts of the treads on the stairway of the rear hall from the 1st to 2nd floor apt.
 - e. Repair or replace the loose, worn, or missing lock in the living room window of the 1st floor apt.
 - f. Repair or replace the deteriorated jamb on the door in the kitchen of 1st floor apt.
 - g. Repair or replace the loose, worn, dilapidated and hazardous door in the living room and bedroom of 1st floor apt.
 - h. Putty the loose window panes, tighten the loose window sashes in the window in the kitchen of the 2nd floor apt.

HAZARDOUS

- a. Install a clean out door at the rear of the chimney.

ELECTRICAL EQUIPMENT

- a. Repair or replace the defective fixtures in the front hall of the 2nd floor apt. bedroom of the 2nd floor apt. and the closet of the 3rd floor apt.



R6 RESIDENCE ZONE
 CITY OF PORTLAND, MAINE
 DEPARTMENT OF BUILDING INSPECTION

Location
 75 Atlantic Street

COMPLAINT

INSPECTION COPY

COMPLAINT NO. 65/27 Date Received May 20, 1965

Location 75 Atlantic Street Use of Building _____
 Owner's name and address Margaret Rozzi, 75 Atlantic Street Telephone _____
 Tenant's name and address _____ Telephone _____
 Complainant's name and address Vivian Prive, 73 Atlantic Street Telephone _____

Description: Two junk cars in yard.

NOTES: 5/21/65 - Two cars here upon blocks Both cars
unlicensed but one was licensed last year. Both cars
are about 7 or 8 years old but look to be in fair
shape. I couldn't call them junk. Doors locked &
windows shut tight. It could be that they are abandoned.
Tried to contact both Mrs. Rozzi & Prive but they are
not in. -- Allan



FILL IN AND SIGN WITH INK

APPLICATION FOR PERMIT FOR HEATING, COOKING OR POWER EQUIPMENT

Portland, Maine, Nov. 3, 1958

PERMIT NO. 41581

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location 75 Atlantic St. Use of Building 2 1/2 fam dwelling No. Stories 2 1/2 New Building Existing "
Name and address of owner of appliance Dominic Rozzi, 90 St. Lawrence St.
Installer's name and address Pallotta Oil Co., 112 Exchange St. Telephone 4-2671

General Description of Work

To install used oil burner in old steam boiler (Conversion)

IF HEATER, OR POWER BOILER

Location of appliance Any burnable material in floor surface or beneath?
If so, how protected? Kind of fuel?
Minimum distance to burnable material, from top of appliance or casing top of furnace
From top of smoke pipe From front of appliance From sides or back of appliance
Size of chimney flue Other connections to same flue
If gas fired, how vented? Rated maximum demand per hour
Will sufficient fresh air be supplied to the appliance to insure proper and safe combustion?

IF OIL BURNER

Name and type of burner Easternoil Labeled by underwriters' laboratories? Yes
Will operator be always in attendance? No Does oil supply line feed from top or bottom of tank? Bottom
Type of floor beneath Concrete Size of vent pipe 1 1/4
Location of oil storage Basement Number and capacity of tanks 1-275
Low water shut off Yes Make McDonald-Miller No 67
Will all tanks be more than five feet from any flame? Yes How many tanks enclosed? None
Total capacity of any existing storage tanks for furnace burners None

IF COOKING APPLIANCE

Location of appliance Any burnable material in floor surface or beneath?
If so, how protected? Height of Legs, if any
Skirting at bottom of appliance? Distance to combustible material from top of appliance?
From front of appliance From sides and back From top of smokepipe
Size of chimney flue Other connections to same flue
Is hood to be provided? If so, how vented? Forced or gravity?
If gas fired, how vented? Rated maximum demand per hour

MISCELLANEOUS EQUIPMENT OR SPECIAL INFORMATION

Amount of fee enclosed? \$2.00 (\$2.00 for one heater, etc., 50 cents additional for each additional heater, etc., in same building at same time.)

APPROVED 11-3-58 [Signature]

Will there be in charge of the above work a person competent to see that the State and City requirements pertaining thereto are observed? Yes

[Signature of Installer]

Signature of Installer

INSPECTION COPY

agv.

YOU!

are responsible for complying with the law, whether you are the owner, contractor, or architect. Location, Ownership, and details must be correct, complete and legible. Separate applications required for every building. Plans must be filed with this application. Get All Questions Settled BEFORE Commencing Work. Failure to do so May Prohibit Work.



Application for Permit for Alterations, etc.

To the INSPECTOR OF BUILDINGS: EXPENSIVE February 21, 19 25.

The undersigned applies for a permit to alter the following described building:—

Description of Present Bldg. Location 75 Atlantic Street Ward 1 in fire-limits? Yes Name of Owner or Lessee, Patrick McNally Address 75 Atlantic St. Contractor, D. W. Dalzell 204 Congress St. Architect, Material of Building is Wood Style of Roof, Pitch Material of Roofing, Shingles Size of Building is 20 feet long; 18 feet wide. No. of Stories, 2 1/2 Cellar Wall is constructed of brick is 12 inches wide on bottom and batters to inches on top. Underpinning is rock is 18 inches thick; is 2 1/2 feet in height. Height of Building Wall, if Brick; 1st, 2d, 3d, 4th, 5th. What was Building last used for? dwelling No. of Families? 2 What will Building now be used for? dwelling

PERMIT MUST BE OBTAINED BEFORE BEGINNING WORK

Detail of Proposed Work

To erect a porch for the second story, all to comply with the building ordinance. Estimated Cost \$ 100.

If Extended On Any Side

Size of Extension, No. of feet long; No. of feet wide; No. of feet high above sidewalk? No. of Stories high? Style of Roof? Material of Roofing? Of what material will the Extension be built? Foundation? If of Brick, what will be the thickness of External Walls? inches; and Party Walls inches. How will the extension be occupied? How connected with Main Building?

When Moved, Raised or Built Upon

No. of Stories in height when Moved, Raised, or Built upon? Proposed Foundations? No. of feet high from level of ground to highest part of Roof to be? How many feet will the External Walls be increased in height? Party Walls

If Any Portion of the External or Party Walls Are Removed

Will an opening be made in the Party or External Walls? in Story. Size of the opening? How protected? How will the remaining portion of the wall be supported?

Signature of Owner or Authorized Representative Patrick M. Nally Address 75 Atlantic Street City

Del, 4588 R



Location, ownership, and detail must be correct, complete and legible. Separate application required for every building.

APPLICATION FOR PERMIT TO BUILD A PRIVATE GARAGE

Portland, Me., March 29, 1924

To the
INSPECTOR OF BUILDINGS

The undersigned hereby applies for a permit to build, according to the following Specifications:--

Location 75 Atlantic Street Fire Districts 110 Ward 1
Name of owner is? Patrick Moly Address 75 Atlantic Street
Name of mechanic is? Halverson Bros Address 196 Federal Street
Proposes occupancy of building (purpose)? steel Private garage for two
cars only, and no space to be let.

Not nearer than two feet from any lot line, will not obstruct windows of adjoining property.

A Pyrene fire extinguisher to be kept in garage.

Size of building, No. of feet front? 18ft; No. of feet rear? 18ft; No. of feet deep? 18ft

No. of stories? 1

No. of feet in height from the mean grade of street to the highest part of the roof? 12ft

Floor to be? concrete

Will the roof be flat, pitch, mansard, or hip? pitch Material of roofing? steel

Will there be a chimney? no Will the flues be lined? No stoves to be used.

Will the building conform to the requirements of the law? yes

Will the building be as good in appearance as other surrounding buildings? no

Have you or any person acting for you previously applied for a permit to build a private garage? no

If so, state the particulars

Estimated Cost,

\$ 315.

Signature of owner or authorized representative,

Patrick Moly
Address, 75 Atlantic Street