

24-26 ANDERSON STREET



**APPLICATION FOR PERMIT**  
**DEPARTMENT OF BUILDING INSPECTIONS SERVICES**  
**ELECTRICAL INSTALLATIONS**

Date Oct. 26, 19 78  
 Receipt and Permit number A 13096

To the CHIEF ELECTRICAL INSPECTOR, Portland, Maine:

The undersigned hereby applies for a permit to make electrical installations in accordance with the laws of Maine, the Portland Electrical Ordinance, the National Electrical Code and the following specifications:

LOCATION OF WORK: 25 Anderson St.  
 OWNER'S NAME: Leroy A Jason Jr. ADDRESS: same

<b>OUTLETS:</b>	<b>FEE</b>
Receptacles _____ Switches _____ Plugmold _____ ft. TOTAL _____	
<b>FIXTURES: (number of)</b>	
Incandescent _____ Fluorescent _____ (not strip) TOTAL _____	
Strip Fluorescent _____ ft. _____	
<b>SERVICES:</b>	
Overhead _____ Underground _____ Temporary _____ TOTAL amperes _____	
<b>METERS: (number of)</b> _____	
<b>MOTORS: (number of)</b>	
Fractional _____	
1 HP or over _____	
<b>RESIDENTIAL HEATING:</b>	
Oil or Gas (number of units) <u>2</u> _____	6.00
Electric (number of rooms) _____	
<b>COMMERCIAL OR INDUSTRIAL HEATING:</b>	
Oil or Gas (by a main boiler) _____	
Oil or Gas (by separate units) _____	
Electric Under 20 kws _____ Over 20 kws _____	
<b>APPLIANCES: (number of)</b>	
Ranges _____	Water Heaters _____
Cook Tops _____	Disposals _____
Wall Ovens _____	Dishwashers _____
Dryers _____	Compactors _____
Fans _____	Others (denote) _____
<b>TOTAL</b> _____	
<b>MISCELLANEOUS: (number of)</b>	
Branch Panels _____	
Transformers _____	
Air Conditioners Central Unit _____	
Separate Units (windows) _____	
Signs 20 sq. ft. and under _____	
Over 20 sq. ft. _____	
Swimming Pools Above Ground _____	
In Ground _____	
Fire/Burglar Alarms Residential _____	
Commercial _____	
Heavy Duty Outlets, 220 Volt (such as welders) 30 amps and under _____	
over 30 amps _____	
Circus, Fairs, etc. _____	
Alterations to wires _____	
Repairs after fire _____	
Emergency Lights, battery _____	
Emergency Generators _____	
	<b>INSTALLATION FEE DUE:</b>
FOR ADDITIONAL WORK NOT ON ORIGINAL PERMIT ..... <b>DOUBLE FEE DUE:</b>	
FOR REMOVAL OF A "STOP ORDER" (304-16.b) .....	6.00
	<b>TOTAL AMOUNT DUE:</b>

**INSPECTION:**  
 Will be ready on \_\_\_\_\_, 19 \_\_\_\_; or Will Call xx  
**CONTRACTOR'S NAME:** Eastern Oil & Equip  
**ADDRESS:** 63 Prable St.  
**TEL.:** \_\_\_\_\_  
**MASTER LICENSE NO.:** on file **SIGNATURE OF CONTRACTOR:**  
**LIMITED LICENSE NO.:** \_\_\_\_\_ *Robert L. Jones B.F. Fisher*

INSPECTOR'S COPY -- WHITE  
 OFFICE COPY -- CANARY  
 CONTRACTOR'S COPY -- GREEN





EH 4225

**APPLICATION FOR PERMIT**  
DEPARTMENT OF BUILDING INSPECTIONS SERVICES  
ELECTRICAL INSTALLATIONS

Date Nov. 27, 1978  
Receipt and Permit number A 15879

To the CHIEF ELECTRICAL INSPECTOR, Portland, Maine:

The undersigned hereby applies for a permit to make electrical installations in accordance with the laws of Maine, the Portland Electrical Ordinance, the National Electrical Code and the following specifications:

LOCATION OF WORK: 26 Anderson Street  
OWNER'S NAME: Mr. Jayson ADDRESS: same

	FEES
OUTLETS: Receptacles _____ Switches _____ Plugmold _____ ft. TOTAL <u>1-30</u>	3.00
FIXTURES: (number of) Incandescent _____ Fluorescent _____ (not strip) TOTAL _____ Strip Fluorescent _____ ft. _____	
SERVICES: Overhead <u>xx</u> Underground _____ Temporary _____ TOTAL amperes _____	3.00 1.00
METERS: (number of) <u>2</u>	
MOTORS: (number of) Fractional _____ 1 HP or over _____	
RESIDENTIAL HEATING: Oil or Gas (number of units) _____ Electric (number of rooms) _____	
COMMERCIAL OR INDUSTRIAL HEATING: Oil or Gas (by a main boiler) _____ Oil or Gas (by separate units) _____ Electric Under 20 kws _____ Over 20 kws _____	
APPLIANCES: (number of) Ranges _____ Water Heaters _____ Cook Tops _____ Disposals _____ Wall Ovens _____ Dishwashers _____ Dryers _____ Compactors _____ Fans _____ Others (denote) _____	3.00
TOTAL _____	
MISCELLANEOUS: (number of) Branch Panels _____ Transformers _____ Air Conditioners Central Unit _____ Separate Units (windows) _____ Signs 20 sq. ft. and under _____ Over 20 sq. ft. _____ Swimming Pools Above Ground _____ In Ground _____ Fire/Burglar Alarms Residential _____ Commercial _____ Heavy Duty Outlets, 220 Volt (such as welders) 30 amps and under _____ over 30 amps _____ Circus, Fairs, etc. _____ Alterations to wires _____ Repairs after fire _____ Emergency Lights, battery _____ Emergency Generators _____	
FOR ADDITIONAL WORK NOT ON ORIGINAL PERMIT ..... INSTALLATION FEE DUE: _____ FOR REMOVAL OF A "STOP ORDER" (304-16.b) ..... DOUBLE FEE DUE: _____	
TOTAL AMOUNT DUE:	10.00

INSPECTION:  
Will be ready on \_\_\_\_\_, 19\_\_; or Will Call xx  
CONTRACTOR'S NAME: M & M Electric  
ADDRESS: 16 Chevrus Rd. Cape Eliz.  
TEL.: 767-2411  
MASTER LICENSE NO.: 94 SIGNATURE OF CONTRACTOR: [Signature]  
LIMITED LICENSE NO.: \_\_\_\_\_

INSPECTOR'S COPY — WHITE  
OFFICE COPY — CANARY  
CONTRACTOR'S COPY — GREEN



FILL IN AND SIGN WITH INK

APPLICATION FOR PERMIT FOR HEATING, COOKING OR POWER EQUIPMENT

Portland, Maine, Oct. 26, 1978

0936

PERMIT ISSUED

OCT 30 1978

CITY of PORTLAND

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location 26 Anderson St. Use of Building 2 family No. Stories 2 New Building Existing "
Name and address of owner of appliance Leroy A. Jason Jr. same
Installer's name and address Easternoil & Equip-63 Preble St. Telephone

General Description of Work

To install 2 forced hot water systems - replacements
information is the same for both burners.

IF HEATER, OR POWER BOILER

Location of appliance basement Any burnable material in floor surface or beneath? no
If so, how protected? Kind of fuel? # 2 fuel oil
Minimum distance to burnable material, from top of appliance or casing top of furnace 3 ft. all around
From top of smoke pipe From front of appliance From sides or back of appliance
Size of chimney flue 10 x 12 Other connections to same flue 1 other connection
If gas fired, how vented? Rated maximum demand per hour
Will sufficient fresh air be supplied to the appliance to insure proper and safe combustion? yes

IF OIL BURNER

Name and type of burner Mobil gun Labeled by underwriters' laboratories? yes
Will operator be always in attendance? no Does oil supply line feed from top or bottom of tank? bottom
Type of floor beneath burner concrete Size of vent pipe 1 1/2
Location of oil storage basement Number and capacity of tanks 2-275 gal.
Low water shut off Make No.
Will all tanks be more than five feet from any flame? yes How many tanks enclosed? none
Total capacity of any existing storage tanks for furnace burners 550 gal.

IF COOKING APPLIANCE

Location of appliance Any burnable material in floor surface or beneath?
If so, how protected? Height of Legs, if any
Skirting at bottom of appliance? Distance to combustible material from top of appliance?
From front of appliance From sides and back From top of smokepipe
Size of chimney flue Other connections to same flue
Is hood to be provided? If so, how vented? Forced or gravity?
If gas fired, how vented? Rated maximum demand per hour

MISCELLANEOUS EQUIPMENT OR SPECIAL INFORMATION

Amount of fee enclosed? 10.00

APPROVED:

01288 10/30/78

Will there be in charge of the above work a person competent to see that the State and City requirements pertaining thereto are observed?

Signature of Installer Easternoil Corp B-F Filice

CS 200

INSPECTION COPY


Nov 6/78

NOTES

Blank lined area for notes.

Permit No. 78/0936  
Location 96 Campbell St.  
Owner Frank G. ...  
Date of permit 10-25-78  
Approved 10-30-78

- 1. 1 1/2" FILL PIPE
- 2. 1 1/4" VENT PIPE
- 3. Risk Control
- 4. Burner Safety & Support
- 5. Name & Label
- 6. Burner Control
- 7. Risk Control
- 8. Safety Switch
- 9. 1/2" Vent Outlet
- 10. Risk Control
- 11. Risk Control & protection
- 12. Valve to Supply line
- 13. Safety of tanks
- 14. Burner Safety & Support
- 15. Oil Tank
- 16. Label Card
- 17. Oil Tank
- 18. Exhaust ventilation
- 19. Smothering to combustible
- 20. Thermostat Control switch

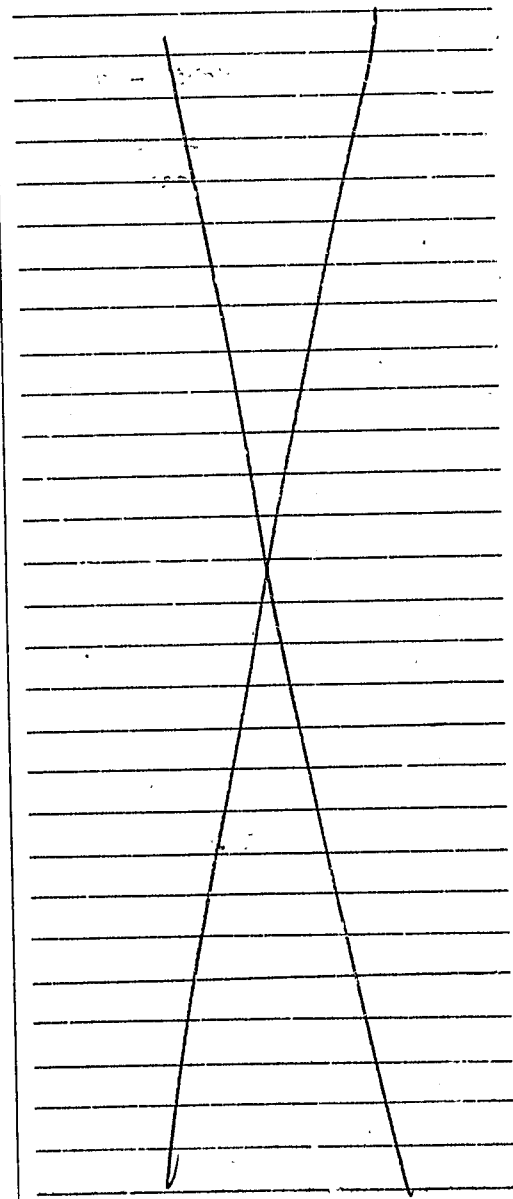

PERMIT TO INSTALL PLUMBING

Date Issued **10-26-78**  
 Portland Plumbing Inspector  
 By **ERNOLD R. GOODWIN**

Address **26 Anderson Street** PERMIT NUMBER **1758**  
 Installation For: **2 family**  
 Owner of Bldg.: **Leroy A. Jason Jr.**  
 Owner's Address: **same**  
 Plumber: **Easton Oil & Equip** Date: **10-26-78**  
**43 Prohle St.** NO. FEE

App. First Insp.  
 Date  
 By  
 App. Final Insp.  
 Date  
 By  
 Type of Bldg.  
 Commercial  
 Residential  
 Single  
 Multi Family  
 New Construction  
 Remodeling

NEW	REPL			
			SINKS	
			LAVATORIES	
			TOILETS	
			BATH TUBS	
			SHOWERS	
			DRAINS FLOOR SURFACE	
			HOT WATER TANKS	
			TANKLESS WATER HEATERS	
			GARBAGE DISPOSALS	2 4.00
			SEPTIC TANKS	
			HOUSE SEWERS	
			ROOF LEADERS	
			AUTOMATIC WASHERS <del>base fee</del>	3.00
			DISHWASHERS	
			OTHER	
			TOTAL	7.00

Building and Inspector Services Dept.: Plumbing Inspection

PERMIT TO INSTALL PLUMBING

PERMIT NUMBER 17822

Date Issued June 16, 1967  
 Portland Plumbing Inspector  
 By ERNOLD R. GOODWIN

App. First Insp.  
 Date JUN 19 1967  
 By ERNOLD R. GOODWIN  
 CHIEF PLUMBING INSPECTOR

App. Final Insp.  
 Date JUN 19 1967  
 By ERNOLD R. GOODWIN  
 CHIEF PLUMBING INSPECTOR  
 Commercial  
 Residential  
 Single  
 Multi Family  
 New Construction  
 Remodeling

Address <u>26 Madison Street</u>		Installation For:	
Owner of Bldg: <u>Mary Ann Jensen</u>		Date: <u>June 1967</u>	
Owner's Address: <u>26 Madison Street</u>		Plumber: <u>Portland Gas Light Co.</u>	
NEW	REPL.		NO.
		SINKS	
		LAVATORIES	
		TOILETS	
		BATH TUBS	
		SHOWERS	
		DRAINS FLOOR SURFACE	
1		HOT WATER TANKS	1 2.00
		TANKLESS WATER HEATERS	
		GARBAGE DISPOSALS	
		SEPTIC TANKS	
		HOUSE SEWERS	
		ROOF LEADERS	
		AUTOMATIC WASHERS	
		DISHWASHERS	
		OTHER	
		TOTAL	1 2.00

Building and Inspection Services Dept; Plumbing Inspection



STANDARD FORM NO. 64

DATE: 11-7-55

TO: [illegible]

FROM: [illegible]

SUBJECT: [illegible]

NO.	DESCRIPTION	QUANTITY	UNIT PRICE	TOTAL
1	[illegible]			
2	[illegible]			
3	[illegible]			
4	[illegible]			
5	[illegible]			
6	[illegible]			
7	[illegible]			
8	[illegible]			
9	[illegible]			
10	[illegible]			
11	[illegible]			
12	[illegible]			
13	[illegible]			
14	[illegible]			
15	[illegible]			
16	[illegible]			
17	[illegible]			
18	[illegible]			
19	[illegible]			
20	[illegible]			
21	[illegible]			
22	[illegible]			
23	[illegible]			
24	[illegible]			
25	[illegible]			
26	[illegible]			
27	[illegible]			
28	[illegible]			
29	[illegible]			
30	[illegible]			
31	[illegible]			
32	[illegible]			
33	[illegible]			
34	[illegible]			
35	[illegible]			
36	[illegible]			
37	[illegible]			
38	[illegible]			
39	[illegible]			
40	[illegible]			
41	[illegible]			
42	[illegible]			
43	[illegible]			
44	[illegible]			
45	[illegible]			
46	[illegible]			
47	[illegible]			
48	[illegible]			
49	[illegible]			
50	[illegible]			
51	[illegible]			
52	[illegible]			
53	[illegible]			
54	[illegible]			
55	[illegible]			
56	[illegible]			
57	[illegible]			
58	[illegible]			
59	[illegible]			
60	[illegible]			
61	[illegible]			
62	[illegible]			
63	[illegible]			
64	[illegible]			
65	[illegible]			
66	[illegible]			
67	[illegible]			
68	[illegible]			
69	[illegible]			
70	[illegible]			
71	[illegible]			
72	[illegible]			
73	[illegible]			
74	[illegible]			
75	[illegible]			
76	[illegible]			
77	[illegible]			
78	[illegible]			
79	[illegible]			
80	[illegible]			
81	[illegible]			
82	[illegible]			
83	[illegible]			
84	[illegible]			
85	[illegible]			
86	[illegible]			
87	[illegible]			
88	[illegible]			
89	[illegible]			
90	[illegible]			
91	[illegible]			
92	[illegible]			
93	[illegible]			
94	[illegible]			
95	[illegible]			
96	[illegible]			
97	[illegible]			
98	[illegible]			
99	[illegible]			
100	[illegible]			

TOTAL: [illegible]

GRAND TOTAL: [illegible]

APPROVED: [illegible]

DATE: [illegible]

STANDARD FORM NO. 64

3 0 904 Smith  
11-7-55  
Vols. T-6 PRU 9104 III

January 8, 1960

Mr. Roy Sicard  
24 Stevens Avenue  
Westbrook, Maine

Dear Mr. Sicard:

Re: 26 Anderson Street

We recently made an inspection of the property owned by you at 26 Anderson Street, Portland, Maine. As a result of the inspection, you are hereby ordered to correct the following substandard housing conditions:

## STRUCTURAL

Repair and put in good order all dilapidated and hazardous parts of the structure as follows:

- a. Replace the missing bricks and point up the loose joints on all sides of the outside foundation.
- b. Replace the broken window panes on the left rear side of the cellar.
- c. Replace the missing bricks and point up the loose joints on the front chimney above the roof line.

The above mentioned conditions are in violation of the City Ordinance, MINIMUM STANDARDS FOR CONTINUED OCCUPANCY, and AUTHORITY TO VACATE BUILDINGS, and must be corrected on or before February 8, 1960.


Very truly yours,

Douglas H. Brown, M. D.  
Health Director

By:

Gordon E. Martin  
Housing Supervisor

GEM:ew





FILL IN AND SIGN WITH INK

APPLICATION FOR PERMIT FOR HEATING, COOKING OR POWER EQUIPMENT

Portland, Maine, Nov. 8, 1955

PERMIT ISSUED 12094 NOV 1955 CITY OF PORTLAND

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location 26 Anderson St. Use of Building 2-family dwelling No. Stories 2 Building Existing Name and address of owner of appliance Roy Sicard, Spear St., Westbrook Installer's name and address Paine Heating Co., County Road, Westbrook Telephone 3-6823

General Description of Work

To install forced warm air heating system and oil burning equipment in place of stove heat (for first floor only)

IF HEATER, OR POWER BOILER

Location of appliance basement Any burnable material in floor surface or beneath? no If so, how protected? Kind of fuel? oil Minimum distance to burnable material, from top of appliance or casing top of furnace 3' from plenum chamber From top of smoke pipe 3' From front of appliance over 4' From sides or back of appliance over 3' Size of chimney flue 8x12 Other connections to same flue none If gas fired, how vented? Rated maximum demand per hour Will sufficient fresh air be supplied to the appliance to insure proper and safe combustion? yes

IF OIL BURNER

Permit Issued with Letter

Name and type of burner Silent Flame Labelled by underwriters' laboratories? yes Will operator be always in attendance? Does oil supply line feed from top or bottom of tank? bottom Type of floor beneath burner concrete Size of vent pipe 1 1/2" Location of oil storage basement Number and capacity of tanks 1-275 gal. Low water shut off make No Will all tanks be more than five feet from any flame? yes How many tanks enclosed? Total capacity of any existing storage tanks for furnace burners none

IF COOKING APPLIANCE

Location of appliance Any burnable material in floor surface or beneath? If so, how protected? Height of Legs, if any Skirting at bottom of appliance? Distance to combustible material from top of appliance? From front of appliance From sides and back From top of smokepipe Size of chimney flue Other connections to same flue Is hood to be provided? If so, how vented? Forced or gravity? If gas fired, how vented? Rated maximum demand per hour

MISCELLANEOUS EQUIPMENT OR SPECIAL INFORMATION

Permit Issued with Letter

Amount of fee enclosed? 2.00 (\$2.00 for one heater, etc., 50 cents additional for each additional heater, etc., in same building at same time.)

APPROVED:

Handwritten signature and date 11/8/55

Will there be in charge of the above work a person competent to see that the State and City requirements pertaining thereto are observed? yes

Paine Heating Co.

Signature of Installer by: Emma T. Sterling

INSPECTION COPY

C12-214-111 MARKS



078



(A) APARTMENT HOUSE ZONE  
APPLICATION FOR PERMIT

Class of Building or Type of Structure Third Class  
Portland, Maine, June 29, 1953

PERMIT ISSUED  
01044  
JUN 30 1953  
CITY of PORTLAND

To the INSPECTOR OF BUILDINGS, PORTLAND, MAINE

The undersigned hereby applies for a permit to ~~erect~~ ~~alter~~ ~~repair~~ ~~work~~ the following building ~~erected~~ ~~erect~~ in accordance with the Laws of the State of Maine, the Building Code and Zoning Ordinance of the City of Portland, plans and specifications, if any, submitted herewith and the following specifications:

Location 26 Anderson St. Within Fire Limits? yes Dist. No. \_\_\_\_\_  
 Owner's name and address Lee H. Jones, 9 Hill St. Telephone \_\_\_\_\_  
 Lessee's name and address \_\_\_\_\_ Telephone \_\_\_\_\_  
 Contractor's name and address William Bradford, 7 Anderson St. Telephone \_\_\_\_\_  
 Architect \_\_\_\_\_ Specifications \_\_\_\_\_ Plans no No. of sheets \_\_\_\_\_  
 Proposed use of building dwelling house No. families 2  
 Last use \_\_\_\_\_ " " \_\_\_\_\_ No. families 2  
 Material wood No. stories 2 1/2 Heat \_\_\_\_\_ Style of roof \_\_\_\_\_ Roofing \_\_\_\_\_  
 Other buildings on same lot \_\_\_\_\_ Fee \$ 2.00  
 Estimated cost \$ 500.

General Description of New Work

To repair after fire to former condition without alterations and without change of use, but if conditions in the areas of repair are found to be dangerously substandard of Building Code requirements, both Building Department and owner will be notified immediately. Fire caused from children playing with matches. Fire took place recently. No structural damage.

CERTIFICATE OF OCCUPANCY  
REQUIREMENT IS MET BY

It is understood that this permit does not include installation of heating apparatus which is to be taken out ~~separately~~ and in the name of the heating contractor. PERMIT TO BE ISSUED TO William Bradford

Details of New Work

Is any plumbing involved in this work? \_\_\_\_\_ Is any electrical work involved in this work? \_\_\_\_\_  
 Is connection to be made to public sewer? \_\_\_\_\_ If not, what is proposed for sewage? \_\_\_\_\_  
 Height average grade to top of plate \_\_\_\_\_ Height average grade to highest point of roof \_\_\_\_\_  
 Size, front \_\_\_\_\_ depth \_\_\_\_\_ No. stories \_\_\_\_\_ solid or filled land? \_\_\_\_\_ earth or rock? \_\_\_\_\_  
 Material of foundation \_\_\_\_\_ Thickness, top \_\_\_\_\_ bottom \_\_\_\_\_ cellar \_\_\_\_\_  
 Material of underpinning \_\_\_\_\_ Height \_\_\_\_\_ Thickness \_\_\_\_\_  
 Kind of roof \_\_\_\_\_ Rise per foot \_\_\_\_\_ Roof covering \_\_\_\_\_  
 No. of chimneys \_\_\_\_\_ Material of chimneys \_\_\_\_\_ of lining \_\_\_\_\_ Kind of heat \_\_\_\_\_ fuel \_\_\_\_\_  
 Framing lumber—Kind \_\_\_\_\_ Dressed or full size? \_\_\_\_\_  
 Corner posts \_\_\_\_\_ Sills \_\_\_\_\_ Girt or ledger board? \_\_\_\_\_ Size \_\_\_\_\_  
 Girders \_\_\_\_\_ Size \_\_\_\_\_ Columns under girders \_\_\_\_\_ Size \_\_\_\_\_ Max. on centers \_\_\_\_\_  
 Studs (outside walls and carrying partitions) 2x4-16" O. C. Bridging in every floor and flat roof span over 8 feet.  
 Joists and rafters: 1st floor \_\_\_\_\_, 2nd \_\_\_\_\_, 3rd \_\_\_\_\_, roof \_\_\_\_\_  
 On centers: 1st floor \_\_\_\_\_, 2nd \_\_\_\_\_, 3rd \_\_\_\_\_, roof \_\_\_\_\_  
 Maximum span: 1st floor \_\_\_\_\_, 2nd \_\_\_\_\_, 3rd \_\_\_\_\_, roof \_\_\_\_\_  
 If one story building with masonry walls, thickness of walls? \_\_\_\_\_ height? \_\_\_\_\_

If a Garage

No. cars now accommodated on same lot \_\_\_\_\_, to be accommodated \_\_\_\_\_ number commercial cars to be accommodated \_\_\_\_\_  
 Will automobile repairing be done other than minor repairs to cars habitually stored in the proposed building? \_\_\_\_\_

Miscellaneous

Will work require disturbing of any tree on a public street? no  
 Will there be in charge of the above work a person competent to see that the State and City requirements pertaining thereto are observed? yes

APPROVED:

OK - 1/30/53 - a.g.l.

Lee H. Jones

Signature of owner by: William H. Bradford

INSPECTION COPY





# APPLICATION FOR PERMIT

PERMIT ISSUED  
0226  
MAR 12 1931

Class of Building or Type of Structure Third Class

Portland, Maine, March 12, 1931

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to erect alter install the following building structure equipment in accordance with the Laws of the State of Maine, the Building Code of the City of Portland, plans and specifications, if any, submitted herewith and the following specifications:

Location 28 Anderson Street Ward 2 Within Fire Limits? yes Dist. No. 1  
 Owner's or Lessee's name and address Annie L. Mulherrin, 27 Anderson St. Telephone no  
 Contractor's name and address not let Telephone \_\_\_\_\_  
 Architect's name and address \_\_\_\_\_  
 Proposed use of building dwelling house No. families 2  
 Other buildings on same lot \_\_\_\_\_  
 Plans filed as part of this application? no No. of sheets \_\_\_\_\_  
 Estimated cost \$ 10. Fee \$ .25

### Description of Present Building to be Altered

Material wood No. stories 2 1/2 Heat \_\_\_\_\_ Style of roof \_\_\_\_\_ Roofing \_\_\_\_\_  
 Last use dwelling house No. families 2

### General Description of New Work

To cut in one new window on first floor for ventilation of bath room which is to be provided in an existing room - window to be at least three square feet in area

CERTIFICATE OF OCCUPANCY  
REQUIREMENTS IS WAIVED  
NOTIFICATION BEFORE CLOSING-IN IS WAIVED

It is understood that this permit does not include installation of heating apparatus which is to be taken out separately by and in the name of the heating contractor.

### Details of New Work

Height average grade to top of plate \_\_\_\_\_  
 Size, front \_\_\_\_\_ depth \_\_\_\_\_ No. stories \_\_\_\_\_ Height average grade to highest point of roof \_\_\_\_\_  
 To be erected on solid or filled land? \_\_\_\_\_ earth or rock? \_\_\_\_\_  
 Material of foundation \_\_\_\_\_ Thickness, top \_\_\_\_\_ bottom \_\_\_\_\_  
 Material of underpinning \_\_\_\_\_ Height \_\_\_\_\_ Thickness \_\_\_\_\_  
 Kind of Roof \_\_\_\_\_ Rise per foot \_\_\_\_\_ Roof covering \_\_\_\_\_  
 No. of chimneys \_\_\_\_\_ Material of chimneys \_\_\_\_\_ of lining \_\_\_\_\_  
 Kind of heat \_\_\_\_\_ Type of fuel \_\_\_\_\_ Is gas fitting involved? \_\_\_\_\_  
 Corner posts \_\_\_\_\_ Sills \_\_\_\_\_ Girt or ledger board? \_\_\_\_\_ Size \_\_\_\_\_  
 Material columns under girders \_\_\_\_\_ Size \_\_\_\_\_ Max. on centers \_\_\_\_\_  
 Studs (outside walls and carrying partitions) 2x4-16" O. C. Girders 6x8 or larger. Bridging in every floor and flat roof span over 8 feet. Sills and corner posts all one piece in cross section.  
 Joists and rafters: 1st floor \_\_\_\_\_, 2nd \_\_\_\_\_, 3rd \_\_\_\_\_, roof \_\_\_\_\_  
 On centers: 1st floor \_\_\_\_\_, 2nd \_\_\_\_\_, 3rd \_\_\_\_\_, roof \_\_\_\_\_  
 Maximum span: 1st floor \_\_\_\_\_, 2nd \_\_\_\_\_, 3rd \_\_\_\_\_, roof \_\_\_\_\_  
 If one story building with masonry walls, thickness of walls? \_\_\_\_\_ height? \_\_\_\_\_

### If a Garage

No. cars now accommodated on same lot \_\_\_\_\_, to be accommodated \_\_\_\_\_  
 Total number commercial cars to be accommodated \_\_\_\_\_  
 Will automobile repairing be done other than minor repairs to cars habitually stored in the proposed building? \_\_\_\_\_

### Miscellaneous

Will above work require removal or disturbing of any shade tree on a public street? no  
 Will there be in charge of the above work a person competent to see that the State and City requirements pertaining thereto are observed? JNS

Signature of owner Annie L. Mulherrin

INSPECTION COPY

4226



Location, Ownership and detail must be correct, complete and legible.  
 Separate application required for every building.  
 Plans must be filed with this application.

26/1/22  
145

**Application for Permit for Alterations, etc.**

Portland, Me., Mar. 27, 1925. 10

To the  
 INSPECTOR OF BUILDINGS:

The undersigned applies for a permit to alter the following described building:—

Location ..... 26 Anderson St. .... Ward ..... 2 ..... in fire-limit? ..... No.  
 Name of Owner ~~James~~ Annie ~~Mulherrin~~ Mulherrin ..... Address ..... 27 Anderson St. ....  
 " " Contractor, L. E. Butland ..... " ..... 175 Cible St. ....  
 " " Architect, ..... " .....  
 Material of Building is Wood ..... Style of Roof, ..... Material of Roofing, .....  
 Size of Building is ..... feet long; ..... feet wide. No. of Stories, .....  
 Cellar Wall is constructed of ..... is ..... inches wide on bottom and batters to ..... inches on top.  
 Underpinning is ..... is ..... inches thick; is ..... feet in height.  
 Height of Building ..... Wall, if Brick; 1st, ..... 2d, ..... 3d, ..... 4th, ..... 5th, .....  
 What was Building last used for? Dwelling ..... No. of Families? .....  
 What will Building now be used for? Same

PERMIT MUST BE OBTAINED BEFORE BEGINNING WORK

**Detail of Proposed Work**

..... Cut ~~4~~ window in exterior wall of bathroom on second story, all work to  
 conform with the building ordinance.  
 before  
 LATHING OR CLOSING IN  
 W.A.I.V.E.D.  
 Estimated Cost \$..... 25.00

**If Extended On Any Side**

Size of Extension, No. of feet long? .....; No. of feet wide? .....; No. of feet high above sidewalk? .....  
 No. of Stories high? .....; Style of Roof? .....; Material of Roofing? .....  
 Of what material will the Extension be built? ..... Foundation? .....  
 If of Brick, what will be the thickness of External Walls? ..... inches; and Party Walls ..... inches.  
 How will the extension be occupied? ..... How connected with Main Building? .....

**When Moved, Raised or Built Upon**

No. of Stories in height when Moved, Raised, or Built upon? ..... Proposed Foundations? .....  
 No. of feet high from level of ground to highest part of Roof to be? .....  
 How many feet will the External Walls be increased in height? ..... Party Walls .....

**If Any Portion of the External or Party Walls Are Removed**

Will an opening be made in the Party or External Walls? ..... in ..... Story.  
 Size of the opening? ..... How protected? .....  
 How will the remaining portion of the wall be supported? .....

Signature of Owner or  
 Authorized Representative ..... Annie Mulherrin  
 Address ..... By L. E. Butland

Fee \$ 0.25

89