


PRINCE AVE., PEAKS ISLAND 91-1-1



CITY OF PORTLAND
HEALTH DEPARTMENT
HOUSING DIVISION

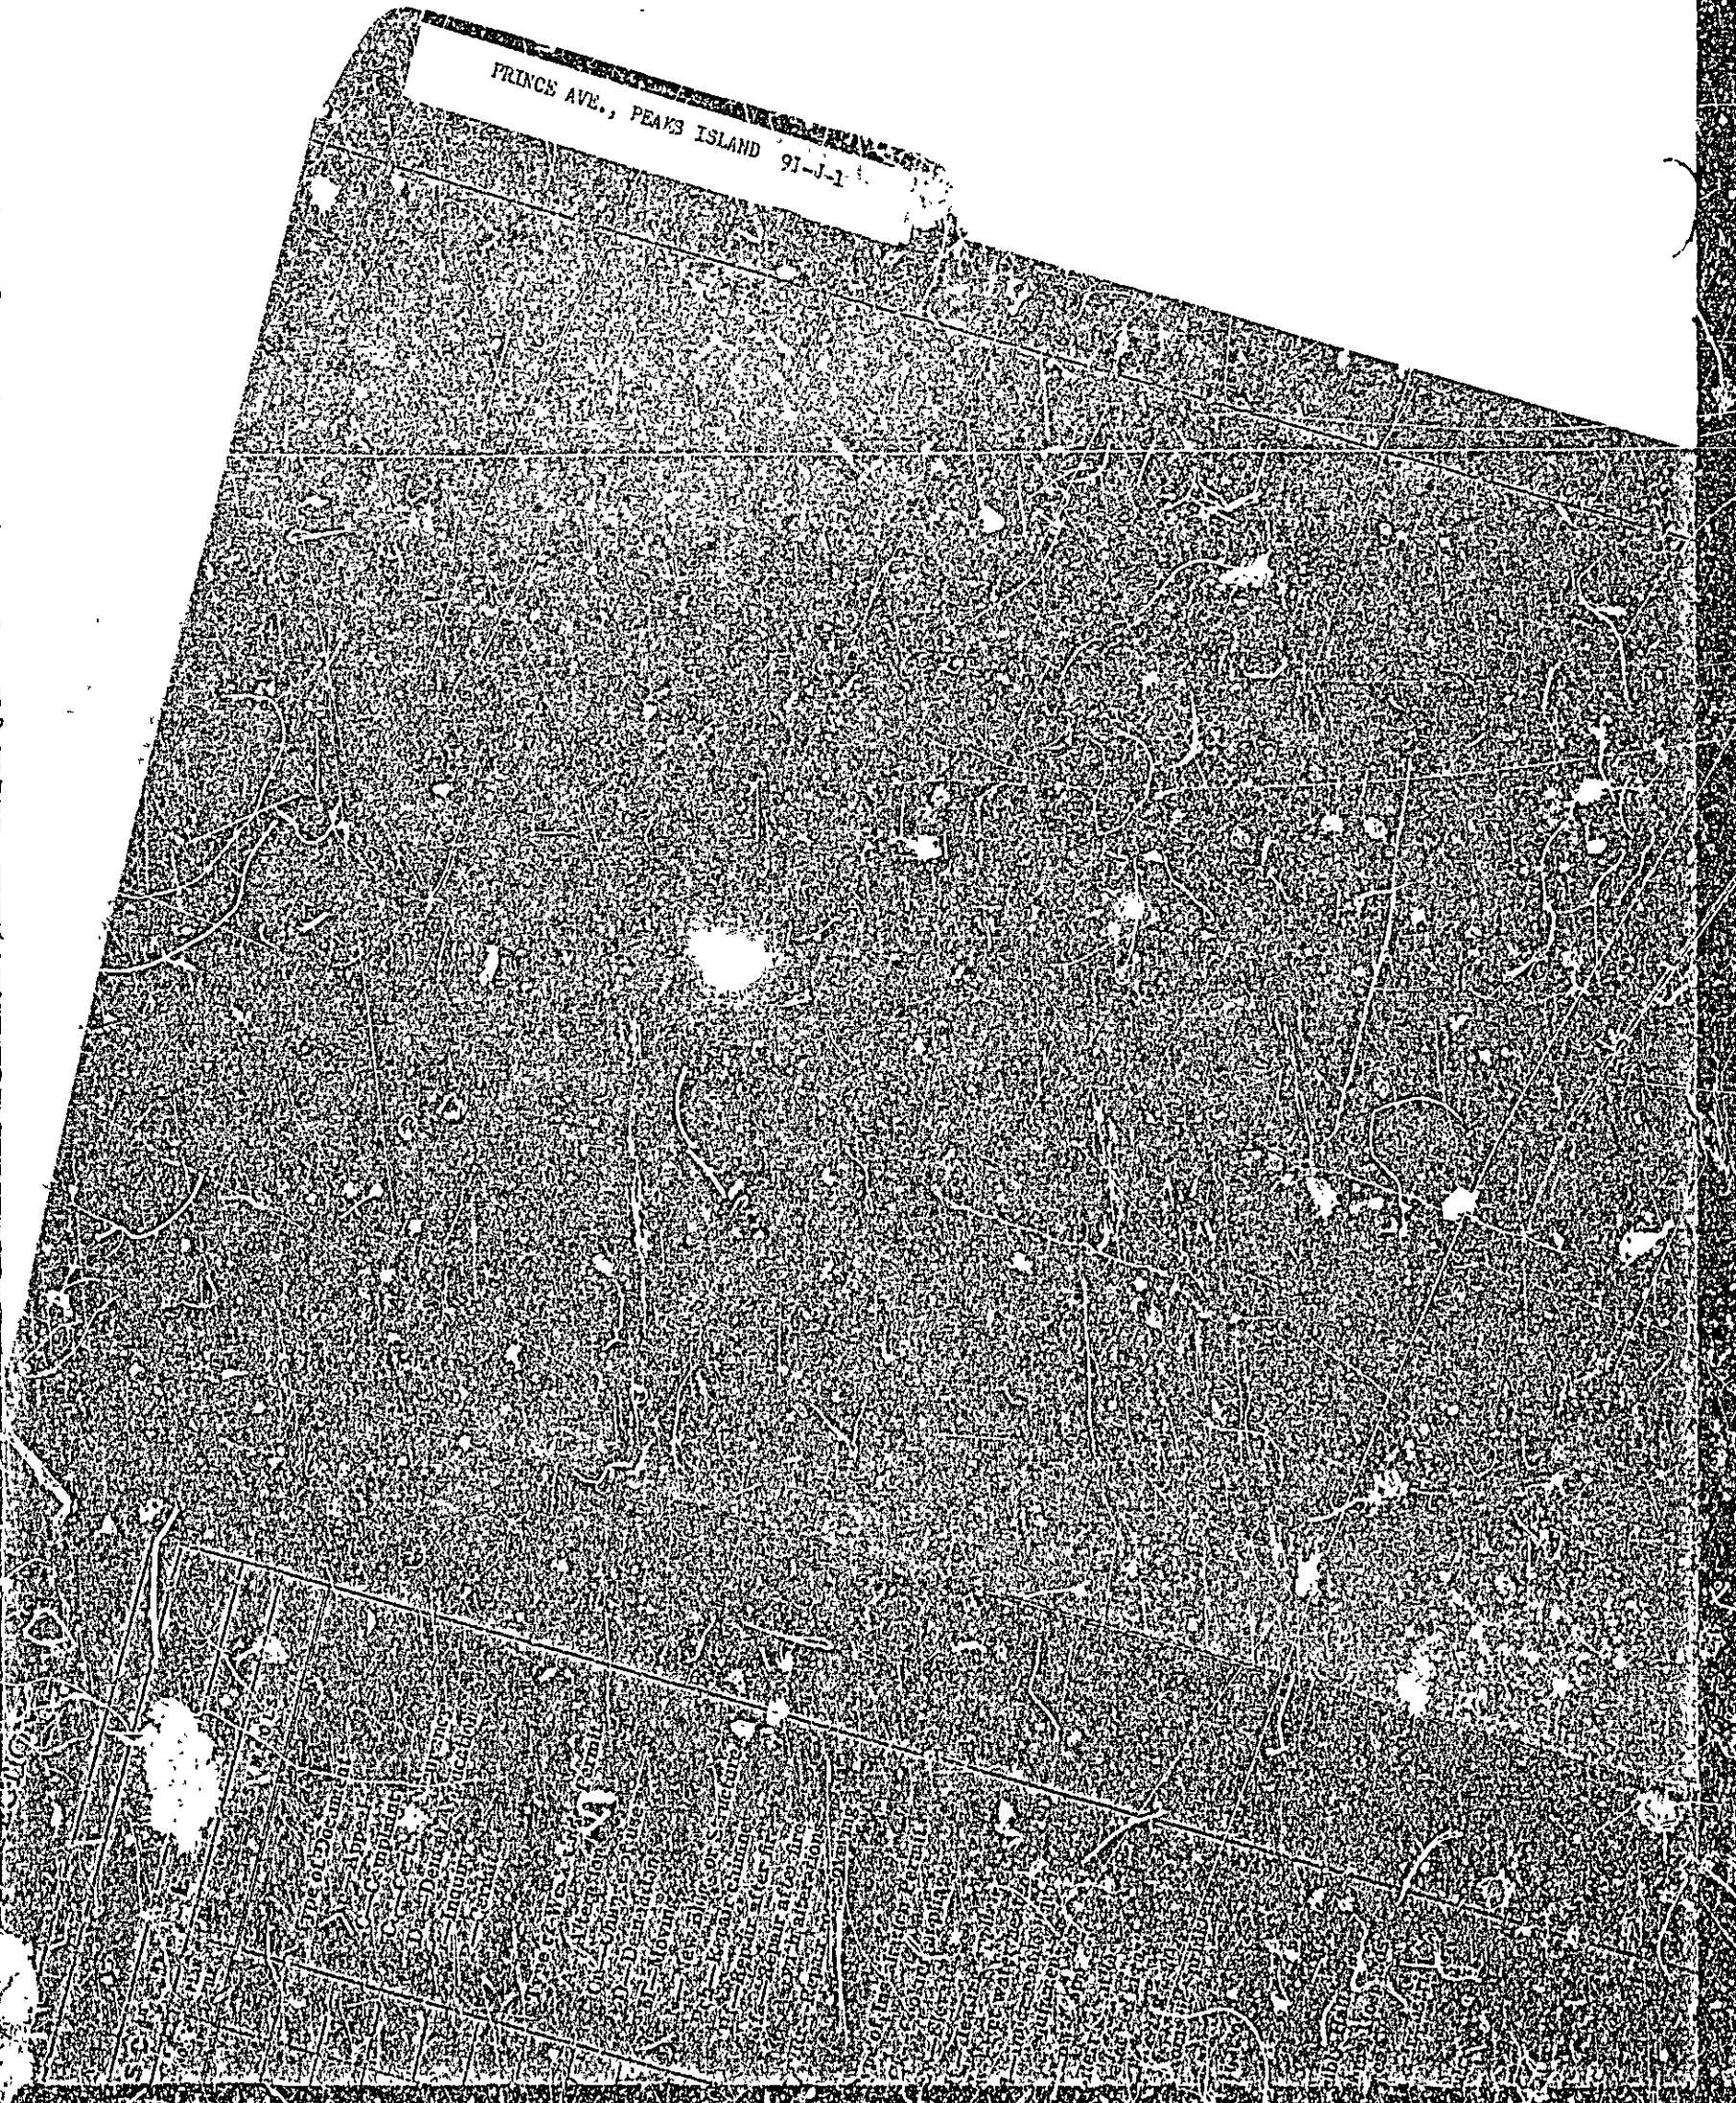

Berry Farm 131
5 Eastern Promenade
Portland, Maine

Loc Prince Av., Peaks Island
Loc w/i S B
Bldg X Fire X Elec X Other
Issued January 6, 1953
Expires February 6, 1953

Dear Sir:

On November 29, 1952 ⁹¹⁻⁸⁻¹ an examination was made of the premises located at Prince Ave., Peaks Island, (Now, or Formerly, occupied by Mrs. Margaret Robb). Non-compliance with the ordinances relating to housing conditions was found as detailed below.

In accordance with the provisions of the above ordinance, you are hereby ordered to correct these defects according to specifications within the time limits allowed. Failure to comply with this notice will necessitate legal action.

Some repairs or improvements required will necessitate permits which are to be obtained from the Building Inspector, Health, Fire or other City Departments. These must be obtained before the work is started. If any additional information is desired, visit or telephone the Housing Supervisor at this Office, telephone 4-1431, extension 226. Kindly notify this office as soon as all corrections have been completed.

Very truly yours,
Edwara W. Colby, M.D.
Health Director

By _____
Housing Supervisor

VIOLATIONS & SPECIFICATIONS

Responsibility of Owner or Agent ** Responsibility of Occupant

Plumbing

Check and have repaired all defective plumbing and plumbing fixtures throughout the structure.

- Supply water satisfactory drinking purposes by means of suitable plumbing so as to permit a continuous ample flow at the sink.
- Supply suitable plumbing to the flush toilet connected to a continuous ample flow of water sufficient to flush the toilet.

Electrical Equipment

Check and have repaired all defective electric wiring and electrical fixtures throughout the structure.

- Provide convenient outlets in all the rooms where there is a dangerous excessive use of extension cords.

Heating

Install a clean cut door at the base of the chimney.

- Clear the chimney by removing and properly disposing of all the soot.

Structural Repairs

Repair and put in good order all dilapidated and hazardous parts of the structure as follows:

- Repair or replace the loose, dilapidated, or worn treads; the component parts of the out-side stairway.
- Repair or replace the cracked window panes in the windows of the dining room and bedroom.
- Replace the missing window panes in the cellar windows.
- Repair or replace the split or broken rafters in the roof.
- Determine the reason and remedy the condition which is now causing the roof to leak.

The above mentioned conditions are in violation of the City Ordinance "Minimum Standard for Continued Occupancy" and "Authority to Vacate Buildings" and must be corrected on or before February 6, 1953.

To: Housing Division, Health Department
From _____

Date _____

This is to inform you that detection of which this Department has been notified, have been corrected to our satisfaction.

Remarks: _____

Loc Prince Av., Peaks Island
Loc w/i S B
Bldg X Fire X Elec X Other
Issued January 6, 1953
Expires February 6, 1953

Signature _____

(Please return to Housing Division of Health Department when corrections have been COMPLETED)