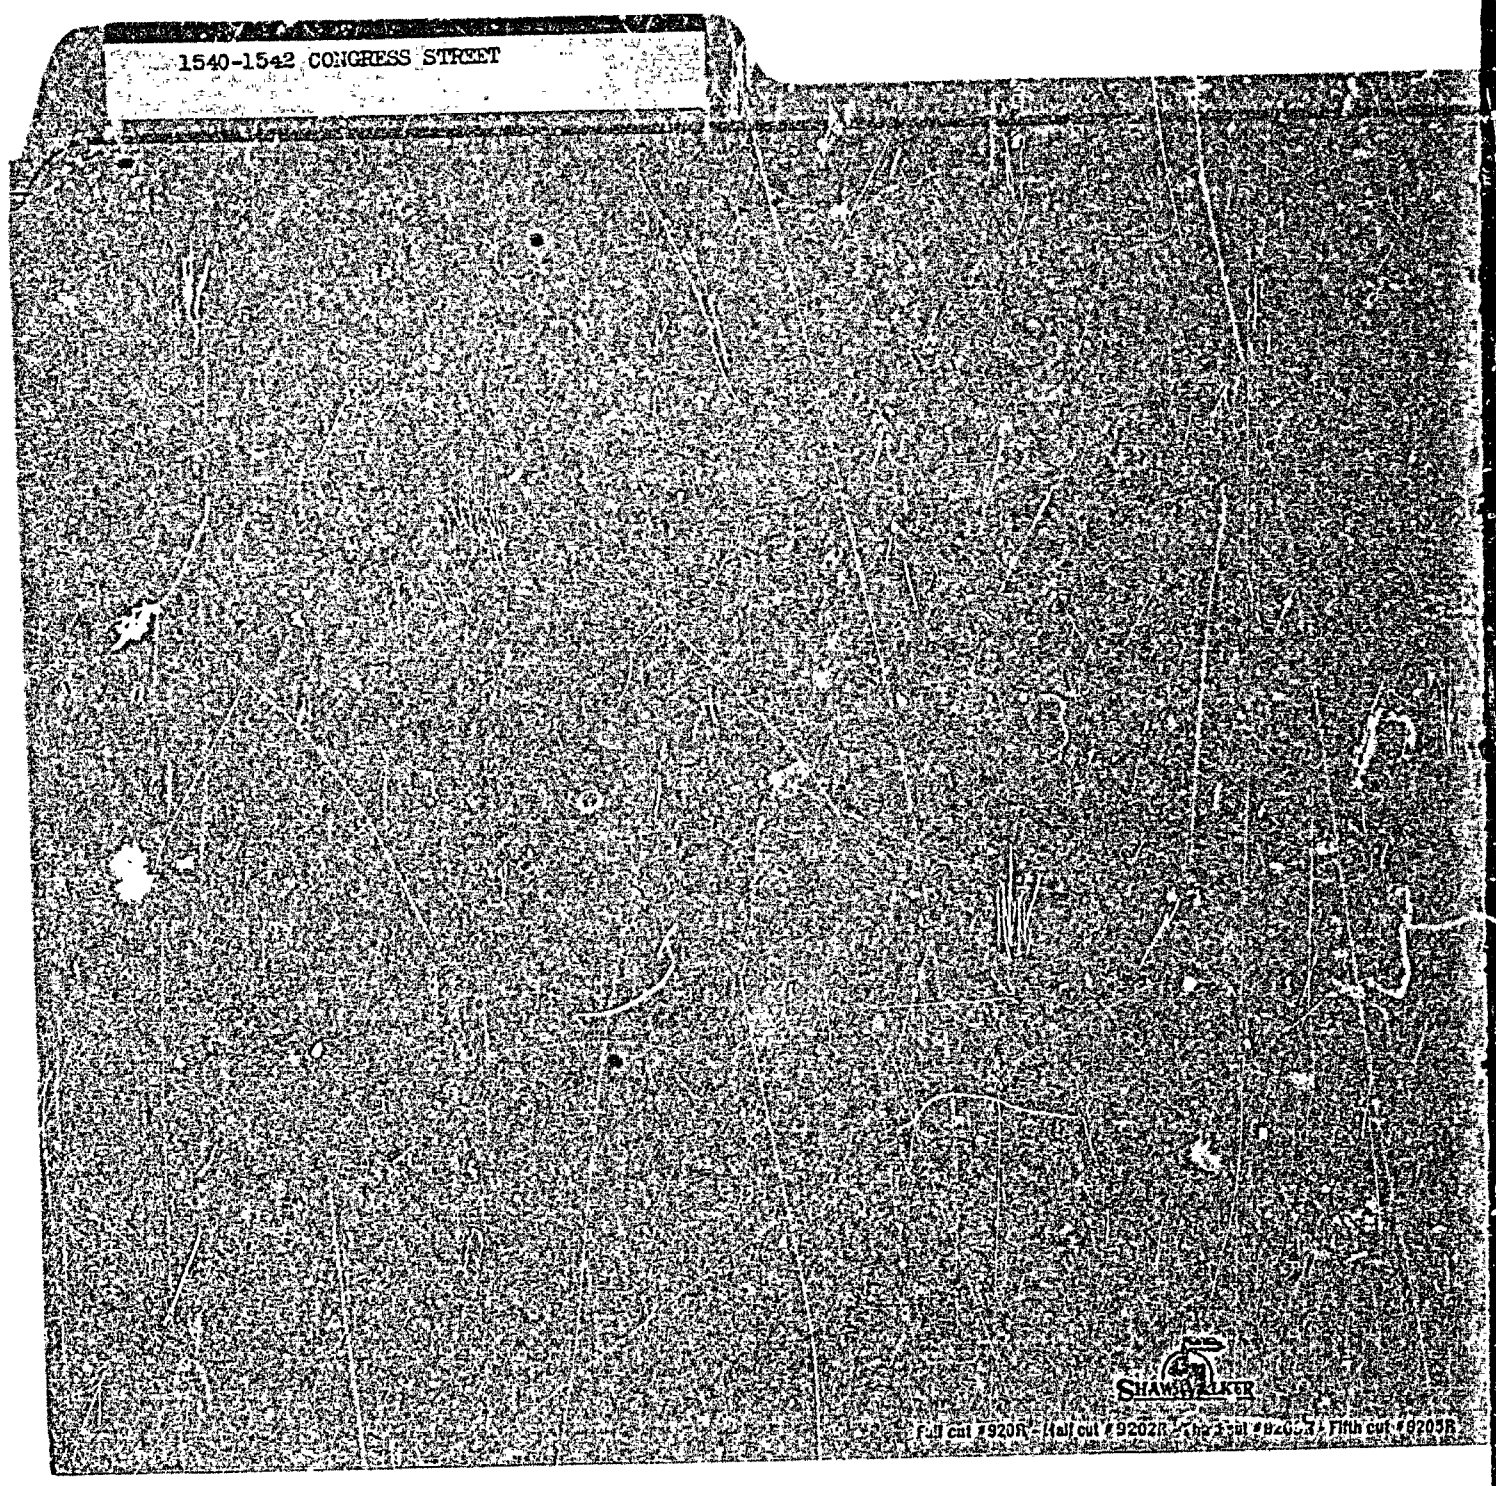
1540-1542 CONGRESS STREET
SHAW-WALKER
Full cut #920R - Half cut #9202R - Third cut #9203R - Fifth cut #9205R

APPLICATION FOR PERMIT

DEPARTMENT OF BUILDING INSPECTIONS SERVICES

ELECTRICAL INSTALLATIONS

Date Nov. 15, 1977

Receipt and Permit number A 03461

To the CHIEF ELECTRICAL INSPECTOR, *Portland, Maine:*

The undersigned hereby applies for a permit to make electrical installations in accordance with the laws of Maine, the Portland Electrical Ordinance, the National Electrical Code and the following specifications:

LOCATION OF WORK: 1542 Congress St.

OWNER'S NAME: George Curry ADDRESS: same

		FEES
OUTLETS (number of)		
Lights		
Receptacles		
Switches		
Plugmold	(number of feet)	
TOTAL		
FIXTURES (number of)		
Incandescent		
Fluorescent	(Do not include strip fluorescent)	
TOTAL		
Strip Fluorescent, in feet		
SERVICES:		
Permanent, total amperes 100		3.00
Temporary		
METERS: (number of) 1		.50
MOTORS: (number of)		
Fractional		
1 HP or over		
RESIDENTIAL HEATING:		
Oil or Gas (number of units)		
Electric (number of rooms)		
COMMERCIAL OR INDUSTRIAL HEATING:		
Oil or Gas (by a main boiler)		
Oil or Gas (by separate units)		
Electric (total number of kws)		

APPLIANCES: (number of)

Ranges		Water Heaters	
Cook Tops		Disposals	
Wall Ovens		Dishwashers	
Dryers		Compactors	
Fans		Others (denote)	

TOTAL

MISCELLANEOUS: (number of)

Branch Panels	
Transformers	
Air Conditioners	
Signs	
Fire/Burglar Alarms	
Circus, Fairs, etc.	
Alterations to wires	
Repairs after fire	
Heavy Duty, 220v outlets	
Emergency Lights, battery	
Emergency Generators	

INSTALLATION FEE DUE:

FOR ADDITIONAL WORK NOT ON ORIGINAL PERMIT ..... DOUBLE FEE DUE:

FOR REMOVAL OF A "STOP ORDER" (304-16.b) .....

FOR PERFORMING WORK WITHOUT A PERMIT (304-9) .....

TOTAL AMOUNT DUE: 3.50

INSPECTION:

Will be ready on ____, 19__; or Will Call xx

CONTRACTOR'S NAME: Michael Goan

ADDRESS: RFD # 1 Saco Rd. West Buxton

TEL.: 642-3962

MASTER LICENSE NO.: 2106

LIMITED LICENSE NO.:

SIGNATURE OF CONTRACTOR: Michael Goan

INSPECTOR'S COPY

ELECTRICAL INSTALLATIONS—

Permit Number 3516

Location 1542 Congress St

Owner George Curry

Date of Permit 11-15-77

Final Inspection 11-22-77

By Inspector [illegible]

Permit Application Register Page No. 121

INSPECTIONS: Service ✓ by Libby

Service called in 11-22-77

Closing-in _____ by _____

PROGRESS INSPECTIONS: _____ / _____ / _____

_____ / _____ / _____

_____ / _____ / _____

_____ / _____ / _____

_____ / _____ / _____

_____ / _____ / _____

CODE COMPLIANCE COMPLETED

DATE 11-22-77

DATE:	REMARKS:
	OK

CITY OF PORTLAND, MAINE
Application for Permit to Install Wires

Permit No. 53900

Issued 5/18/ 1965

Portland, Maine

To the City Electrician, Portland, Maine:

The undersigned hereby applies for a permit to install wires for the purpose of conducting electric current, in accordance with the laws of Maine, the Electrical Ordinance of the City of Portland, and the following specifications:

(This form must be completely filled out — Minimum Fee, $1.00)

Owner's Name and Address Mr Guy Wyman 1542 Congress St Tel.

Contractor's Name and Address Elvis G Jones 173 Walton Tel. 773-8464

Location 1542 Congress St. Use of Building

Number of Families Apartments Stores Number of Stories

Description of Wiring: New Work Additions ✓ Alterations

Pipe Cable Metal Molding BX Cable Plug Molding (No. of feet)

No. Light Outlets Plugs Light Circuits Plug Circuits

FIXTURES: No. Light Switches Fluor. or Strip Lighting (No. feet)

SERVICE: Pipe Cable Underground No. of Wires Size

METERS: Relocated Added Total No. Meters

MOTORS: Number Phase H. P. Amps Volts Starter

HEATING UNITS: Domestic (Oil) No. Motors Phase H.P.

Commercial (Oil) No. Motors Phase H.P.

Electric Heat (No. of Rooms)

APPLIANCES: No. Ranges Watts Brand Feeds (Size and No.)

Elec. Heaters 2 Watts 4.5KW

Miscellaneous Watts Extra Cabinets or Panels

Transformers Air Conditioners (No. Units) Signs (No. Units)

Will commence 19/ Ready to cover in 19 Inspection 5/19/ 1965

Amount of Fee $ 3.00

Signed Elvis G. Jones

DO NOT WRITE BELOW THIS LINE

SERVICE METER GROUND

VISITS: 1 2 3 4 5 6

7 8 9 10 11 12

REMARKS:

INSPECTED BY F W Herbert

(OVER)

CS 203

LOCATION Congress St. 1372
INSPECTION DATE 5/17/65
WORK COMPLETED 5/19/65
TOTAL NO. INSPECTIONS 1
REMARKS:

FEES FOR WIRING PERMITS EFFECTIVE JULY 31, 1963

WIRING		
1 to 30 Outlets	(including switches)	$ 2.00
31 to 60 Outlets	(including switches)	3.00
Over 60 Outlets, each Outlet	(including switches)	.05
(Each twelve feet or fraction thereof of fluorescent lighting or any type of plug molding will be classed as one outlet).		
SERVICES		
Single Phase		2.00
Three Phase		4.00
MOTORS		
Not exceeding 50 H.P.		3.00
Over 50 H.P		4.00
HEATING UNITS		
Domestic (Oil)		2.00
Commercial (Oil)		4.00
Electric Heat (Each Room)		.75
APPLIANCES		
Ranges, Cooking Tops, Ovens, Water Heaters, Disposals, Dishwashers, etc. — Each Unit		1.50
TEMPORARY WORK (Limited to 6 months from date of permit)		
Service, Single Phase		1.00
Service, Three Phase		2.00
Wiring, 1-50 Outlets		1.00
Wiring, each additional outlet over 50		.02
Circuses, Carnivals, Fairs, etc.		10.00
MISCELLANEOUS		
Distribution Cabinet or Panel, per unit		1.00
Transformers, per unit		2.00
Air Conditioners, per unit		2.00
Signs, per unit		2.00
ADDITIONS		
5 Outlets, or less		

FILL IN AND SIGN WITH INK

APPLICATION FOR PERMIT FOR HEATING, COOKING OR POWER EQUIPMENT

PERMIT ISSUED

MAY 10 1965

Portland, Maine, May 10, 1965.

To the INSPECTOR OF BUILDINGS, PORTLAND, ME.

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location ~~159~~ 157½ Congress Street Use of Building Dwelling No. Stories New Building Existing "

Name and address of owner of appliance Guy Wescott, Steep Falls, Maine

Installer's name and address Dixon Bros., Gorham, Maine Telephone

General Description of Work

To install (2) oil burning equipments in connection with existing gravity water heat (conversions)

IF HEATER, OR POWER BOILER

Location of appliance basement Any burnable material in floor surface or beneath? no

If so, how protected? Kind of fuel? oil

Minimum distance to burnable material, from top of appliance or casing top of furnace

From top of smoke pipe From front of appliance From sides or back of appliance

Size of chimney flue Other connections to same flue

If gas fired, how vented? Rated maximum demand per hour

Will sufficient fresh air be supplied to the appliance to insure proper and safe combustion?

IF OIL BURNER

Name and type of burner American Standard Labelled by underwriters' laboratories? yes

Will operator be always in attendance? Does oil supply line feed from top or bottom of tank? bottom

Type of floor beneath burner concrete Size of vent pipe 1½" each

Location of oil storage concrete Number and capacity of tanks 2-275 gal.

Low water shut off Make No.

Will all tanks be more than five feet from any flame? yes How many tanks enclosed?

Total capacity of any existing storage tanks for furnace burners none

IF COOKING APPLIANCE

Location of appliance Any burnable material in floor surface or beneath?

If so, how protected? Height of Legs, if any

Skirting at bottom of appliance? Distance to combustible material from top of appliance?

From front of appliance From sides and back From top of smokepipe

Size of chimney flue Other connections to same flue

Is hood to be provided? If so, how vented? Forced or gravity?

If gas fired, how vented? Rated maximum demand per hour

MISCELLANEOUS EQUIPMENT OR SPECIAL INFORMATION

Amount of fee enclosed? 2.00 ($2.00 for one heater, etc., $1.00 additional for each additional heater, etc., in same building at same time.)

APPROVED:

O.K 5-10-65 FH

Will there be in charge of the above work a person competent to see that the State and City requirements pertaining thereto are observed? yes

Dixon Bros.

Signature of Installer By: G. Dixon

P.H.

CS 300

INSPECTION COPY

Permit No. 65/477

Location 1549 Congress Street

Owner Guy Wescott

Date of permit 5/10/65

Approved

NOTES

	Fill Pipe
2	Vent Pipe
3	Kind of Heat
4	Burner Rigidity & Supports
5	Name & Label
6	Stack Co
7	High Limit
8	Reliefe Co
9	Piping Su
10	Valves In Su
11	Capacity of T
12	Tank Rigidity & Supports
13	Tank Distance
14	Oil Gauge
15	Instruction Card
16	Low Water Shutoff

CITY OF PORTLAND, MAINE
Application for Permit to Install Wires

Permit No.
Issued 5/17

Portland, Maine May 10, 1965

To the City Electrician, Portland, Maine:

The undersigned hereby applies for a permit to install wires for the purpose of conducting electric current, in accordance with the laws of Maine, the Electrical Ordinance of the City of Portland, and the following specifications.

(This form must be completely filled out — Minimum Fee, $1.00)

Owner's Name and Address Amy Wescott Steep Falls, Me.

Contractor's Name and Address Nixon Bros, Gorham Tel. 839-3311

Location 15-17 Congress St Use of Building Dwelling

Number of Families 2 Apartments 2 Stores Number of Stories 2½

Description of Wiring New Work ✓ Additions Alterations

Install (2) Conversion oil burners

Pipe Cable Metal Molding BX Cable Plug Molding (No. of feet)

No. Light Outlets Plugs Light Circuits Plug Circuits

FIXTURES: No. Light Switches Fluor. or Strip Lighting (No. feet)

SERVICE: Pipe Cable Underground No. of Wires Size

METERS: Relocated Added Total No. Meters

MOTORS: Number Phase H. P. Amps Volts Starter

HEATING UNITS: Domestic (Oil) ✓ No. Motors 2 Phase S H.P. 1/3 HP

Commercial (Oil) No. Motors Phase H.P.

Electric Heat (No. of Rooms)

APPLIANCES: No. Ranges Watts Brand Feeds (Size and No.)

Elec. Heaters Watts

Miscellaneous Watts Extra Cabinets or Panels

Transformers Air Conditioners (No. Units) Signs (No. Units)

Will commence May 11 1965 Ready to cover in 19 Inspection 19

Amount of Fee $ 2.00

Signed Nixon Bros by C. Nelson

DO NOT WRITE BELOW THIS LINE

SERVICE METER GROUND

VISITS: 1 2 3 4 5 6

7 8 9 10 11 12

REMARKS:

INSPECTED BY F.W. Hutchins

CS 283

(OVER)

LOCATION (Cor. Express St. / Street)

INSPECTION DATE 5/19/65

WORK COMPLETED 5/19/65

TOTAL NO. INSPECTIONS 1

REMARKS:

FEES FOR WIRING PERMITS EFFECTIVE JULY 31, 1963

WIRING		
1 to 30 Outlets	(including switches)	$ 2.00
31 to 60 Outlets	(including switches)	3.00
Over 60 Outlets, each Outlet	(including switches)	.05
(Each twelve feet or fraction thereof of fluorescent lighting or any type of plug molding will be classed as one outlet).		
SERVICES		
Single Phase		2.00
Three Phase		4.00
MOTORS		
Not exceeding 50 H.P.		3.00
Over 50 H.P.		4.00
HEATING UNITS		
Domestic (Oil)		2.00
Commercial (Oil)		3.00
Electric Heat (Each Room)		.75
APPLIANCES		
Ranges, Cooking Tops, Ovens, Water Heaters Disposals, Dishwashers, etc. — Each Unit		1.50
TEMPORARY WORK (Limited to 6 months from date of permit)		
Service, Single Phase		1.00
Service, Three Phase		2.00
Wiring, 1-50 Outlets		1.00
Wiring, each additional outlet over 50		.02
Circus, Carnival		

FILL IN AND SIGN WITH INK

(N—

APPLICATION FOR PERMIT FOR HEATING, COOKING OR POWER EQUIPMENT

Portland, Maine, October 2, 1953

017386

To the INSPECTOR OF BUILDINGS, PORTLAND, MAINE

The undersigned hereby applies for a permit to install the following heating, cooking or power equipment in accordance with the Laws of Maine, the Building Code of the City of Portland, and the following specifications:

Location 15[illegible] Cor ress st. Use of Building [illegible] No. Stories [illegible] New Building / Existing "

Name and address of owner of appliance [illegible] Prescott, Deer Falls

Installer's name and address [illegible] Portland, Maine Telephone

General Description of Work

To install 2 gravity hot water boilers in basement

IF HEATER, OR POWER BOILER

Location of appliance basement Any burnable material in floor surface or beneath? no See letter

If so, how protected? Kind of fuel? coal

Minimum distance to burnable material, from top of appliance or casing top of furnace 2' side back

From top of smoke pipe 2' From front of appliance over 1' From sides or back of appliance 6" 3' protect with metal

Size of chimney flue Solo Other connections to same flue none

If gas fired, how vented? Rated maximum demand per hour

Will sufficient fresh air be supplied to the appliance to insure proper and safe combustion? yes

Permit Issued with Lette

IF OIL BURNER

Name and type of burner Labelled by underwriter's laboratories?

Will operator be always in attendance? Does oil supply line feed from top or bottom of tank?

Type of floor beneath burner

Location of oil storage Number and capacity of tanks

If two 275-gallon tanks, will three-way valve be provided?

Will all tanks be more than five feet from any flame? How many tanks fire proofed?

Total capacity of any existing storage tanks for furnace burners

IF COOKING APPLIANCE

Location of appliance Any burnable material in floor surface or beneath?

If so, how protected? Kind of fuel?

Minimum distance to wood or combustible material from top of appliance

From front of appliance From sides and back From top of smokepipe

Size of chimney flue Other connections to same flue

Is hood to be provided? If so, how vented? Forced or gravity?

If gas fired, how vented? Rated maximum demand per hour

MISCELLANEOUS EQUIPMENT OR SPECIAL INFORMATION

These two boilers on same flue

Amount of fee enclosed? 2.00 ($2.00 for one heater, etc., 50 cents additional for each additional heater, etc., in same building at same time.)

APPROVED: Oct. 10-53 [signature]

Will there be in charge of the above work a person competent to see that the State and City requirements pertaining thereto are observed? yes

10 13

Permit No. 53/1736

Location 1543 Congress St.

Owner Guy Tescatti

Date of permit 10/2/53

Approved 10.13.53.J.S.

NOTES

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16

@ 1542 Congress St.

October 2, 1953

Mr. Guy Wescott,
Steep Falls, Maine

Mr. . B. Pannafore,
Gorham, Maine

Gentlemen:

The building permit [illegible] installation of two gravity hot water boilers at 1542 Congress Street is issued to the installer with the following conditions:

The Building Code requires that the sides and back of such heating boilers shall not be closer than three feet to combustible material. This clearance may be reduced to two feet if the combustible surface is covered with incombustible material or equivalent protection is supplied.

The sides and back of such appliances to [illegible] insulation or applied insulation shall not be closer than one foot to combustible material.

Please be governed accordingly.

Very truly yours,

RMT/H

Warren McDonald
Inspector of Buildings