

BUILDING PERMIT REPORT

Date: 2/1/95
Address: Marginal W 7
Type of Permit: Removal - tank
Owner: Portland Water District
Contractor: Portland Pump
Applicant: _____
Approved: ✓ Denied: _____

Conditions:

1. All underground tank removal(s) and/or installation(s) shall be done in accordance with Department of Environmental Protection Regulations (Chapter 691).
2. No cutting of tanks on site. Cutting of tanks to be done at an approved tank disposal site.
3. Fire Dispatcher must be notified 48 hours in advance of removal and/or transportation of tanks.

Maine Department of Environmental Protection
Bureau of Hazardous Materials & Solid Waste Control
State House Station #17
Augusta, Maine 04333-0017
Attention: Tank Removal Notice
Telephone: (207) 287-2651

DATE 1/16/95

NOTICE OF INTENT
TO ABANDON (REMOVE) AN
UNDERGROUND OIL STORAGE FACILITY

THIS FORM MUST BE FILED WITH THE D.E.P. AND YOUR LOCAL FIRE
DEPARTMENT AT LEAST 30 DAYS PRIOR TO THE SCHEDULED REMOVAL

PLEASE TYPE OR PRINT IN INK:

Name of Facility Owner: Portland Water District
Mailing Address: P.O. Box 3553 Telephone #: (207) 774-5961
City: Portland, State: ME Zip Code: 04104
Contact Person (name, address & telephone #): Dick Clark, 774-5961

Name of Facility: NORTHEAST AIRPORT STATION Registration #: 4259
Facility Location (town & street): MADISON WAY, PORTLAND, ME 04104

1. Identify the tanks at this location which are going to be removed:

Tank #	Tank Age	Tank Size (gallons)	Type of Product Stored
1	15	3,000	Fuel Oil #2.
2			
3			
4			

2. Directions to this facility (be specific):

3. Is or was the tank(s) used to store Class I liquids (e.g. gasoline, jet fuel)? Yes No X
IF YES, REMOVAL OF THE TANK(S) MUST BE DONE UNDER THE
DIRECTION OF A CERTIFIED TANK INSTALLER.

Tank Installer's Name: _____ Certification Number: _____ Signature: _____

4. Environmental site assessments are required for all tanks except those used for storing
heating oil, not for resale, or for farm or residential motor fuel tanks under 1,100 gallons
where the product is used on site. Site Assessor's Name and Address (if applicable):
Acadia Environmental, 4 Milk Street, Portland, ME 04101

5. Name and telephone number of contractor who will do the tank removal:
Portland Pump Company, PO Box 1180, Scarborough, ME 04074

6. Telephone (207) 883-4317
Expected date of removal (month/day/year): 1/16/95

I hereby provide Notice that I intend to properly abandon the underground oil storage facility as
described above.

Date: 12/16/94 Signature: _____

Printed Name and Title: Jeffrey S. Wilson, Agent for Owner

Mail original and yellow copy to DEP; pink copy to fire department; retain good copy.
RETURN POSTCARD AFTER TANK(S) HAS BEEN REMOVED

City of Portland, Maine -- Building or Use Permit Application 389 Congress Street, 04101, Tel. (207) 874 8703, FAX: 874-8716

Location of Construction: Corner Congress Way and Preble St.		Owner: City of Portland	Phone: 874-8300	Permit No: 950640
Owner Address: 389 Congress St.		Lease/Buyer's Name: End-Time Outreach Ministries	Phone: 207-985-6719	Business Name:
Contractor Name: Tent owned by Rod Tine		Address: RR 2 Box 1270 Rt 9A, Wells ME 04090		
Past Use: parking lot		Proposed Use: parking lot with tent	COST OF WORK: \$	PERMIT FEE: \$ 35.00
Proposed Project Description: to erect tent from July 24, 1995 to July 31, 1995		FIRE DEPT. ☒ Approved ☐ Denied	INSPECTION: ☒ Approved ☐ Denied	
Permit Taken By: Latini		Date Applied For: 6/22/95		

1. This permit application doesn't preclude the Applicant(s) from meeting applicable State and Federal rules.
2. Building permits do not include plumbing, septic or electrical work.
3. Building permits are void if work is not started within six (6) months of the date of issuance. Failure to start work may invalidate a building permit and stop all work.

Special Permit: Wells Address above
Att: [Signature]

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit.

SIGNATURE OF APPLICANT *[Signature]* **ADDRESS:** **DATE:** **PHONE:**

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE **PHONE:**

White-Permit Desk Green-Assessor's Canary-D.P.W. Pl. Public File Ivory Card-Inspector

PERMIT ISSUED
JUN 26 1995
CITY OF PORTLAND

Zoning: **CAL**
Zoning Approval: **6/22/95**
Special Zone or Reviews:
☐ Shoreland
☐ Wetland
☐ Flood Zone
☐ Subdivision
☐ Site Plan major ☐ minor ☐ mm ☐

Zoning Appeal
☐ Variance
☐ Miscellaneous
☐ Conditional Use
☐ Interpretation
☐ Approved
☐ Denied

Historic Preservation
☐ Not in District or Landmark
☒ Does Not Require Review
☐ Requires Review

Action:
☐ Approved
☐ Approved with Conditions
☐ Denied
Date: **6/23/95**

CEO DISTRICT **2**

BUILDING PERMIT REPORT

DATE

6/26/95

ADDRESS

Preble and Main St. W. 1/2

REASON FOR PERMIT

erect tent

BUILDING OWNER

City of Portland

CONTRACTOR

PERMIT APPLICANT

Shimada Landscaping

APPROVED

✓

DENIED


CONDITIONS OF APPROVAL OR DENIAL:

1) Means at-gate shall be illuminated

END TIME OUTREACH MINISTRIES - GOSPEL TENT REVIVAL

JULY 24-31, 1995

MARGINAL WAY

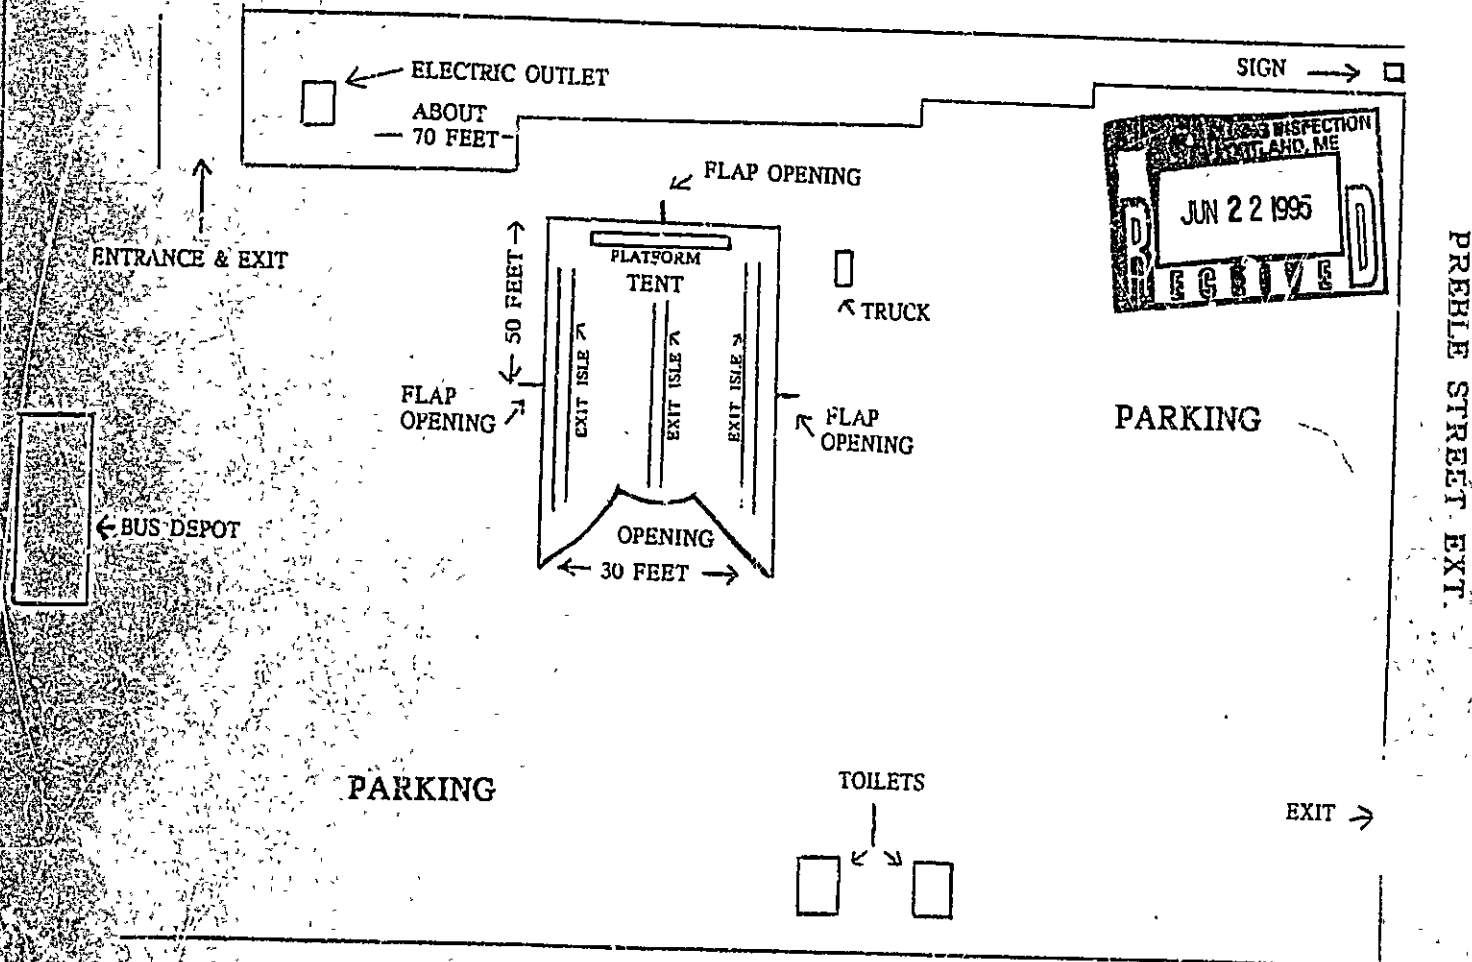

7-24-95 - 7-31-95

I-295

Certificate of Flame Resistance



REGISTERED
Fabric No.

F - 204

ISSUED BY

L & A TENT AND AWNING CO.

240 RIVER ROAD
LEWISTON, MAINE 04240

Date 6-17-92
manufactured

This is to certify that the materials described on the reverse side hereof have been flame-retardant treated (or are inherently nonflammable).

FOR Terry Courtney ADDRESS Mount Zion Farm
CITY Wells STATE Maine 04090

Certification is hereby made that: (Check "a" or "b")



- (a) The articles described on the reverse side of this Certificate have been treated with a flame-retardant chemical approved and registered by the State Fire Marshal and that the application of said chemical was done in conformance with the laws of the State of California and the Rules and Regulations of the State Fire Marshal.

Name of chemical used Chem. Reg. No.
Method of application



- (b) The articles described on the reverse side hereof are made from a flame-resistant fabric or material registered and approved by the State Fire Marshal for such use.

Trade name of flame-resistant fabric FRV No. F-140.01

The Flame Retardant Process Used WILL NOT Be Removed By Washing
(will or will not)


SNYDER MANUFACTURING

Name of Applicator or Production Superintendent

By

President THL

CONTROL NO. CT 101
CUSTOMER ORDER NO.
CUSTOMER INVOICE NO.
YARDS OR QUANTITY 30' X 50' one piece rent
COLOR
STYLE
DATE PROCESSED 6-17-97



City of Portland, Maine -- Building or Use Permit Application 389 Congress Street. 04101, Tel. (207) 874-8703, FAX: 874-8716

Location of Construction: 3 Marginal Way		Owner: 3 Marginal Way Associates (K. McQuinn)		Phone: 774-1885		Permit No: 960020
Owner Address:		Lease/Buyer's Name:		Business Name:		
Contractor Name:		Address:		Phone:		Permit Issued: ISSUED JAN 17 1996
Past Use:		Proposed Use: Car leasing agency		COST OF WORK: \$ FIRE DEPT. ☒ Approved ☐ Denied INSPECTION: Use Group 3 Type 2A		
Bank/Office		Signature: <i>[Signature]</i>		Signature: <i>[Signature]</i>		Zoning Approval: ☒ OK <i>[Signature]</i> Special Zone or Reviews: ☐ Shoreland ☐ Wetland ☐ Flood Zone ☐ Subdivision ☐ Site Plan map ☐ minor Limm ☐
Proposed Project Description: Interpretation Appeal change use		PEDESTRIAN ACTIVITIES DISTRICT (P.A.D.) Action: ☐ Approved ☐ Approved with Conditions ☐ Denied Signature:		Date:		
Permit Taken By: Victoria A. Dover		Date Applied For: November 30, 1995				

1. This permit application doesn't preclude the Applicant(s) from meeting applicable State and Federal rules.
2. Building permits do not include plumbing, septic or electrical work.
3. Building permits are void if work is not started within six (6) months of the date of issuance. False information may invalidate a building permit and stop all work.

APPEAL SUSTAINED 1-4-96

CERTIFICATION

I hereby certify that I am the owner of record of the named property, or that the proposed work is authorized by the owner of record and that I have been authorized by the owner to make this application as his authorized agent and I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in the application issued, I certify that the code official's authorized representative shall have the authority to enter all areas covered by such permit at any reasonable hour to enforce the provisions of the code(s) applicable to such permit.

SIGNATURE OF APPLICANT: *[Signature]* Kevin McQuinn
 ADDRESS: 59 Woodmont St Portland, ME 04102
 DATE: 11/30/95
 PHONE: 774 1885

RESPONSIBLE PERSON IN CHARGE OF WORK, TITLE:

White-Permit Desk Green-Assessor's Canary-D.P.W. Pink-Public File Ivc y Card-Inspector

Zoning Appeal	
☐ Variance	
☐ Miscellaneous	
☐ Conditional Use	
☐ Interpretation	
☐ Approved	
☐ Denied	
Historic Preservation	
☒ Not in District or Landmark	
☐ Does Not Require Review	
☐ Requires Review	
Action:	
☐ Approved	
☐ Approved with Conditions	
☐ Denied	
Date: <i>[Signature]</i> 1/4/96	
CEO DISTRICT <i>[Signature]</i>	

ELECTRICAL PERMIT
City of Portland, Me.



To the Chief Electrical Inspector, Portland Maine:
The undersigned hereby applies for a permit to make electrical installations in accordance with the laws of Maine, the City of Portland Electrical Ordinance, National Electrical code and the following specification:

Date 11 October 1996

Permit # 7765

LOCATION: Marginal Way/Salt Shed

OWNER

City of Portland

ADDRESS

TOTAL EACH FEE

City of Portland

WHIR _____

** City electrician installed all underground pipe and wire.

_____ connections at meter and _____

***** City electrician installed all underground pipe and wire.							
OUTLETS	Electrical contractor made connections at	meter and panel only!!!!					
	Receptacles	Switches	Smoke Detector			.20	
FIXTURES	(number of)					.20	
	incandescent	fluorescent				.20	
	fluorescent strip						
SERVICES			TTL AMPSTO	800		15.00	
	Overhead			800	100	15.00	15.00
	Underground						
TEMPORARY SERV.			AMPS OVER	800		25.00	
	Overhead			800		25.00	
	Underground				1	1.00	1.00
METERS	(number of)					2.00	
MOTORS	(number of)					1.00	
RESID/COM	Electric units					5.00	
HEATING	oil/gas units					2.00	
APPLIANCES	Ranges	Cook Tops	Wall Ovens			2.00	
	Water heaters	Fans	Dryers			2.00	
	Dishwasher	Compactors	Others (denote)			3.00	
Disposals	Air Cond/win					10.00	
MISC. (number of)	Air Cond/cent					5.00	
	Signs					10.00	
	Pools					5.00	
	Alarms/res					15.00	
	Alarms/com					2.00	
	Heavy Duty						
	Outlets					25.00	
	Circus/Carnv					5.00	
	Alterations					15.00	
	Fire Repairs					1.00	
	E Lights					20.00	
	E Generators					4.00	
	Panels					5.00	
TRANSFORMER	0-25 Kva					8.00	
	25-200 Kva					10.00	
	Over 200 Kva						
				TOTAL AMOUNT DUE			
				MINIMUM FEE			25.00
							Waived
MINIMUM FEE/COMMERCIAL 35.00							

INSPECTION:

Will be ready _____

or will call

CONTRACTORS NAME T.A. Napolitano
P.O. Box 2301 S

ADDRESS _____ P.O. BOX 2504 SOT. 1111

TELEPHONE 799-0538

MASTER LICENSE No. 7765

LIMITED LICENSE No.

SIGNATURE OF CONTRACTOR

ELECTRICAL INSTALLATIONS—

INSPECTION: Service 10/17/96 by me
 Service called in _____
 Closing in _____ by _____

PROGRESS INSPECTIONS: 10/17/96 (SERVICE)
10/24/96 (SERVICE)

Permit Number _____
 Location: _____
 Owner: _____
 Date of Permit: _____
 Final Inspection 10/24/96
 By Inspector [Signature]

DATE:	REMARKS:
10/17/96	Violation found regarding # 1104
10/24/96	Employees (working with at 1104) or
10/24/96	inspection for code (1104)
10/24/96	needs providing bulb at (1104) 11
10/24/96	code violation regarding

Jim Pritchard
 Kevin Noyes City Employees